

SHARK MULTI-PARAMETER CONTROLLER & ANALYZER USER'S MANUAL

Rev 3

AquaMetrix Inc.
1245 Maple Hill Ct., Unit 7
Newmarket, ON
Canada, L3Y 9E8

Tel: (800) 742-1413
(905) 954-0841
Fax: (905) 954-0415
www.aquametrix.com



Table of Contents

<u>Subject</u>	<u>Page No.</u>
Introduction	1
Section 1 - Specifications	2
Section 2 - Installation	3 - 5
Section 3 - Electrical Connections & Setup	6 - 14
<i>Differential Probe connection & setup</i>	7
<i>Combination Probe connection & setup</i>	8
<i>Conductivity Cell (Contacting style) connection & setup</i>	9
<i>Paddle Wheel Flow Sensor connection & setup</i>	10
<i>Relay connections</i>	11
<i>Relay A & B setup</i>	12
<i>Alarm relay setup</i>	13
<i>Manual test mode & Relay override</i>	14
<i>4-20mA Isolated Outputs Channel 1 & Channel 2</i>	15
<i>Service & Fuse Replacements</i>	16
Section 4 - Using the SHARK in pH Mode	17
<i>LCD Menu</i>	18 - 44
<i>LED Menu</i>	45 - 46
Section 5 - Using the SHARK in ORP Mode	47
<i>LCD Menu</i>	48 - 73
<i>LED Menu</i>	74
Section 6 - Using the SHARK in Conductivity Mode	75
<i>LCD Menu</i>	76 - 102
<i>LED Menu</i>	103
Section 7 - Using the SHARK in Flow Mode	104
<i>LCD Menu</i>	105 - 128
Appendix A - Probe Configuration Table	129
Return Policy and Warranty Plan	130



Introduction

The SHARK multi-parameter controller is a microprocessor based controller capable of measuring one of the following parameters, pH, ORP, conductivity or flow.

When shipped from the factory, the SHARK is not set to measure any one parameter. When the SHARK is powered up for the first time, it will display the meter selection screen where the meter type must be selected. (refer to section 4.6 Meter Selection)

This meter selection screen will only be displayed when the SHARK is powered up for the first time.

After the user selects a meter type the SHARK will remain set to that meter type until it is changed with the meter selection menu function in the Utilities menu.

To return the SHARK to its factory settings, the user must re-select the current meter type from the meter selection menu function. This will override all set-points and return all settings back to the factory settings.

The SHARK User's menu has been divided into five main categories

- Calibration, used to calibrate the SHARK with the selected sensor
- Utilities, Used to manually control or override the outputs.
- Setup, used to configure the SHARKs many options
- Diagnostics, used to troubleshoot any problems with the SHARK
- Outputs, used to configure the SHARK's outputs.

There are two displays on the SHARK. A bright LED numeric display with bar graph on the outside front panel, and a 2-line, 16-character LCD display on the inside. The LED readout on the outside panel can be seen several yards away. The distinctive, color-coded bar graph will immediately indicate if you are within the process parameters that you set (green), if the control relays are on (yellow) and if you are in alarm condition (red). This makes diagnosing pump and alarm malfunctions easy. All configuration and control functions are performed on the LCD menu on the inside front panel.

A universal mounting kit is included for surface, panel and pipe-mount applications. The 1/4 DIN enclosure makes panel-mount cutouts and engineering simple.

SHARK is packaged in a rugged NEMA 4X polycarbonate enclosure making it ideally suited for heavy-duty applications such as industrial wastewater neutralization, municipal water and wastewater, pulp and paper, and process control.



Section I - Specifications

	pH	ORP	Conductivity	Flow																	
Display	Front Panel: 4 x 7 segment 1/2" LED display, 1 LED indicator On-line, 7 LED Bar Graph Inside Panel: 2 x 16 alpha-numeric LCD display																				
Power Requirements	120Vac (±10%) 50/60Hz (less than 12VA) or 240Vac (±10%) 50/60Hz (less than 12VA)																				
Measuring Range	pH: 0.01 to 14.00 Temp: 0 to 100°C or 32° to +212°F	ORP: -1999 to +1999mV (Dependent on sensor) Temp: 0 to 100°C or 32° to +212°F	<table><tr><td>MΩ/cm³</td><td>0 to 19.99</td><td>0.01</td></tr><tr><td rowspan="4">uS/cm³</td><td>0 to 2.000</td><td>0.01</td></tr><tr><td>0 to 20.00</td><td>0.1</td></tr><tr><td>0 to 200.0</td><td>0.1</td></tr><tr><td>0 to 2000</td><td>1.0</td></tr><tr><td rowspan="2">mS/cm³</td><td>0 to 20.00</td><td>10</td></tr><tr><td>0 to 200.0</td><td>50</td></tr></table> Temp: 0 to 100°C or 32° to +212°F	MΩ/cm³	0 to 19.99	0.01	uS/cm³	0 to 2.000	0.01	0 to 20.00	0.1	0 to 200.0	0.1	0 to 2000	1.0	mS/cm³	0 to 20.00	10	0 to 200.0	50	Flow: 0 to 9999 with selectable flow rate units Volume: 0 to 9999 with Auto Range Flow rate units: Gallons (GP), Cubic Feet (CF), Liters (LP), Cubic Meters (CM), custom by entering factor related to Gallons Time units: Seconds (S), Minutes (M), Hours (H)
MΩ/cm³	0 to 19.99	0.01																			
uS/cm³	0 to 2.000	0.01																			
	0 to 20.00	0.1																			
	0 to 200.0	0.1																			
	0 to 2000	1.0																			
mS/cm³	0 to 20.00	10																			
	0 to 200.0	50																			
Temperature Compensation	Automatic or Manual 0 to 100°C (32° to +212°F)	Not required	Automatic or Manual User selectable temperature compensation slope 0.0 to 10.0%/°C. 0 to 100°C (32° to +212°F)	Not required																	
Temperature Unit	°C or °F			Not required																	
Temperature Sensor	User selectable: 300Ω NTC Thermistor, 3000Ω NTC Thermistor or Pt. 1000 RTD			Not required																	
Calibration Modes	Auto-Calibration Manual Calibration Temperature Calibration	Manual Calibration Temperature Calibration	Dry Calibration Sample Calibration Temperature Calibration	K factor Input																	
Ambient Conditions	Temperature: -20°C to +60°C or -4°F to +140°F Humidity: 0 to 90% RH (non-condensing)																				
Menu Access Front Panel	Auto-Calibration, Manual Calibration, Temperature Display	Manual-Calibration, Temperature Display	Manual Calibration Temperature Display	Not available																	
Menu Access Inside Panel	Full Access to all parameters of operations menu																				
Sensor to SHARK Distance	Differential Sensor: 3000 ft Combination Sensor: 10 ft		300 ft	2000 ft																	
Relay Outputs	Two Control Relays, 10A / NO, 5A / NC @ 240VAC or 28VDC. Mode: Process control, Adjustable parameters: process direction,(rising or falling) on-set-point, off set-point, (0 to 100% of full scale), cycle timer (on / off, 0 to 600 seconds), failsafe (on / off). One Alarm Relay, 10A / NO, 5A / NC @ 240VAC or 28VDC. Mode: High / Low Alarm, Adjustable parameters: Low on / Low off set-point (0 to 100% of full scale, low on must be less than low off), High On / High Off set-point (0 to 100% of full scale, High on must be greater than High off).																				
Analog Outputs	4 to 20mA Channel 1 Isolated Output, Range expand 0 - 100% of full scale (min segment 10% of full scale), max. load 800Ω 4 to 20mA Channel 2 Isolated Output, Range expand 0 - 100% of full scale (min segment 10% of full scale), max. load 800Ω Can be set to track temperature if sensor is equipped with a temperature sensor																				
Memory Back-up	All user settings are retained indefinitely in memory (EEPROM)																				
Mechanical	Enclosure: NEMA 4X, 1/4 DIN, polycarbonate enclosure with four 1/2" conduit holes Mounting: Universal Mounting kit for surface, pipe and panel mount, is included																				
Sensor Input	Probe: -600 to +600mV Temp. Sensor: 0 to 9999Ω	Probe: -1999 to +1999mV Temp. Sensor: 0 to 9999Ω	Cell: 0 to 9999Ω Temp. Sensor: 0 to 9999Ω	Paddle: 0 to 2000Hz																	
Invalid Entries	Invalid entries cannot be stored																				
Manual Test Mode	Process value can be simulated with arrow keys to verify correct setup of outputs																				
Manual Relay Override	Relays can be set to on / off / auto, to verify correct wiring of auxiliary devices, or to manually adjust process																				
Output Hold	All outputs are placed on hold when SHARK is in Menu mode																				
Calibration Data	Recall data from last calibration, calibration mode, 1st & 2nd accepted buffer value and probe mV output, calibration temperature, calibration slope, and probe efficiency		Recall data from last calibration, calibration buffer accepted value, and cell resistance, calibration temperature	Recall store K factor.																	
Auto Return	User selectable auto return if SHARK is left in menu mode or if relays are left in manual override mode for more than 10 min.																				
Display Damping	User can select rate at which SHARK updates display. Enables display damping of unstable process																				
Net Weight	2.2lbs (1kg)																				
Approvals	ULC (pending)																				



Section 2 - Installation

2.1 Unpacking


Save the shipping carton and packing material in case the instrument needs to be stored or returned. Inspect the instrument and packing material for shipping damage and report any problems immediately.

2.2 Location

Locate the controller/analyzer close to the sensor. The list below gives typical maximum distances for various sensors. Refer to the sensor specifications for exact information.

- | | |
|------------------------------------|----------------------|
| • Aquametrix Differential PH Probe | 3000 ft (914 meters) |
| • Aquametrix Combination PH Probe | 10 ft (3 meters) |
| • Aquametrix Conductivity Probe | 300 ft (91 meters) |
| • Aquametrix Flow sensor | 2000 ft (610 meters) |


2.3 Mounting

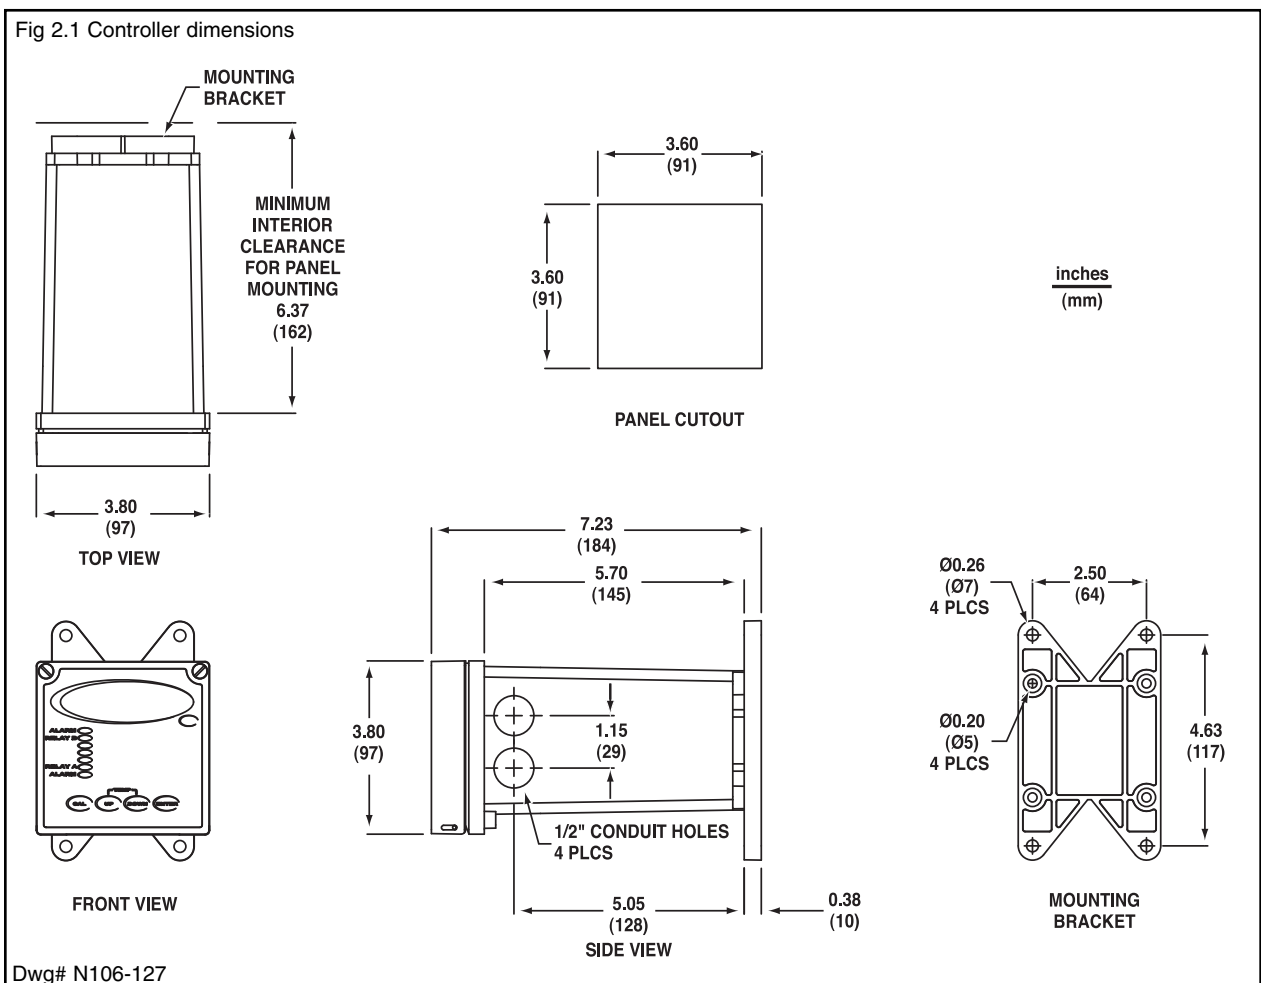




Section 2 - Installation

Panel Mount – The Shark can be panel mounted to a panel using the hardware kit provided. The panel cutout dimensions are shown in fig. 2.1.

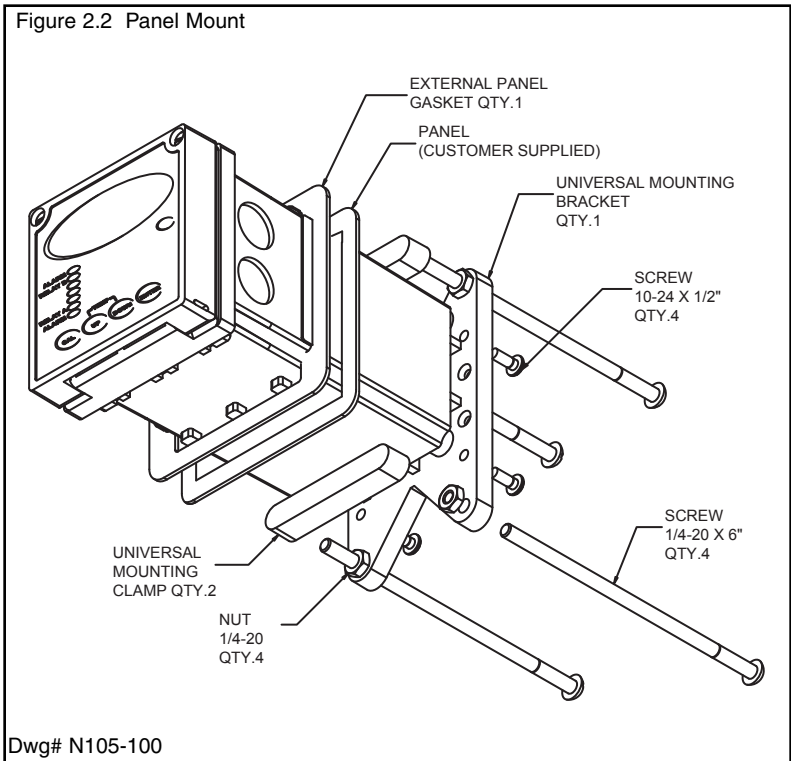

Pipe Mount – The Shark can also be mounted to a horizontal or vertical pipe with:


- a minimum outside diameter of 1.30" (33mm) (for example 1" CPVC pipe)
- and a maximum of 2.375" (60mm) (for example 2" CPVC pipe)

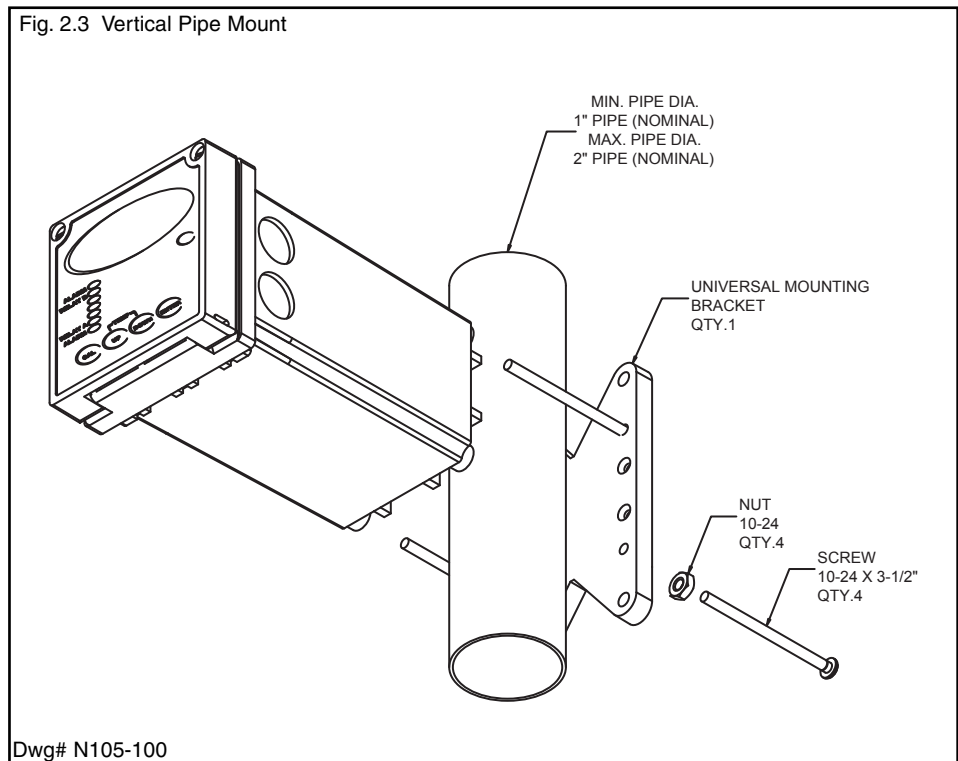



Section 2 - Installation


Figure 2.4 Horizontal Pipe Mount

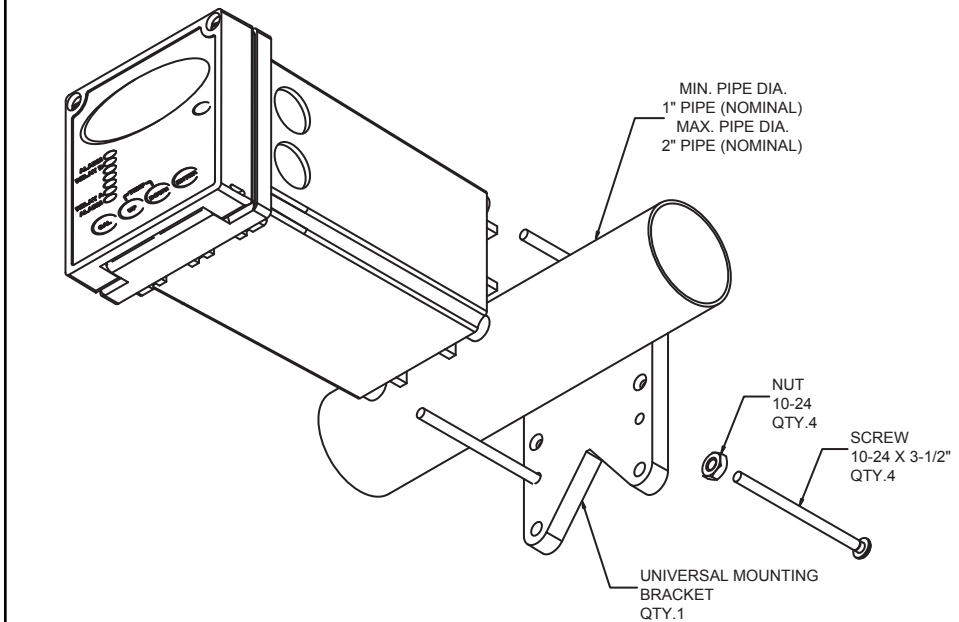

Dwg# N105-100

Surface Mount – The Shark can be surface mounted using the hardware kit provided with the unit.

Figure 2.5 Surface Mount

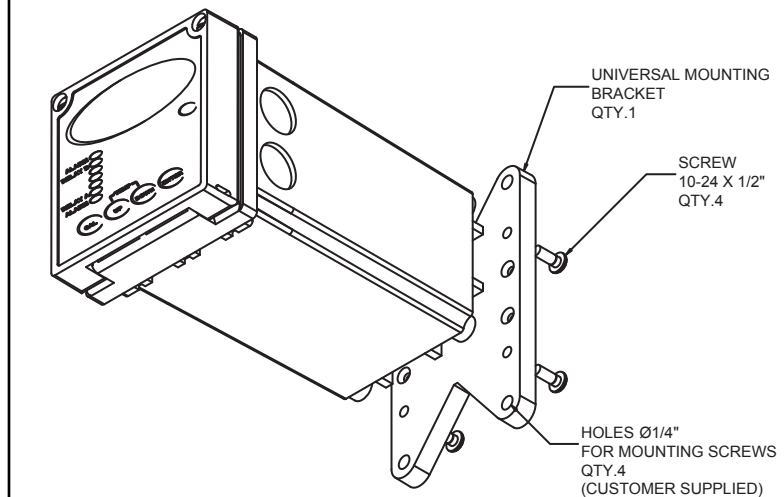

Dwg# N105-100



Section 3 - Electrical Connections and Setup

3.1 Conduit Connections

The Shark has four 1/2" conduit holes, 2 on each side of the enclosure as shown on fig. 2.1. The unit is shipped with these holes plugged with liquid tight conduit seals. These must be left in unused holes to maintain the NEMA 4X integrity. Use approved conduit hubs to connect the conduit, connect these to the conduit before connecting to the enclosure.

Wire Specification: Size and fuse wire according to local electrical code. Maximum current not to exceed 10A when used to power auxiliary devices powered via internal connections.

3.2 A.C. Power Connections


Caution: This instrument uses 120 or 240 50/60 Hz AC power. Opening the enclosure door exposes you to potentially hazardous line power voltage which might be present on the terminals of plug P3 and P4. Always remove line power before working in this area. If the relay contacts on P4 are powered from a separate source from the line power on P3, be sure to disconnect that power before proceeding. The Shark flip out door contains only low voltage and is safe to handle.

The Shark is available in two power models.

The Shark-240 is designed to operate at 240 VAC.

The Shark-120 is designed to operate at 120 VAC.

To connect power to the Shark, remove the terminal block plug P3 and connect the wiring as shown below.

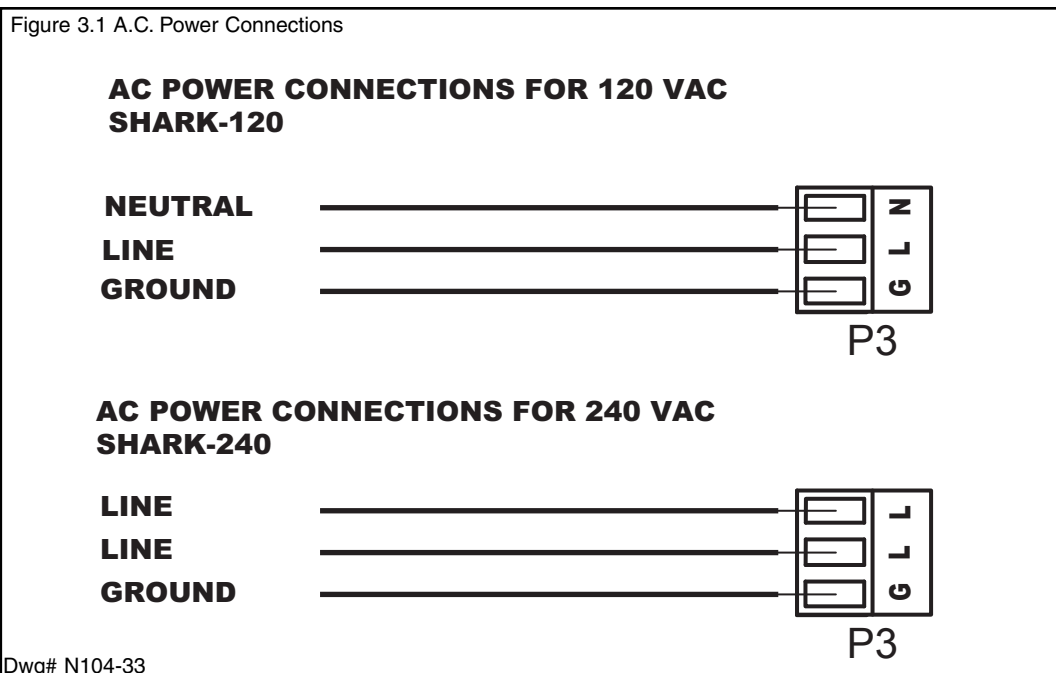



Section 3 - Electrical Connections and Setup

3.3 pH and ORP Differential Probe connections and setup

The drawing shows the connections for the Aquametrix Differential (5 wire) probe. The cable should be run in a conduit separate from AC power wires, and via a separate conduit hole.


Note: Leave 4" to 6" slack for all wires connected to the terminals of P6. Slack required so that wires do not interfere with opening or closing of the front door.

If the cable of the differential probe is cut, the blue wire is not used.

CAUTION:

Always remove line power before unplugging or plugging in the P6 connector

Figure 3.2 Connections for Differential (5 wire) pH or ORP probe

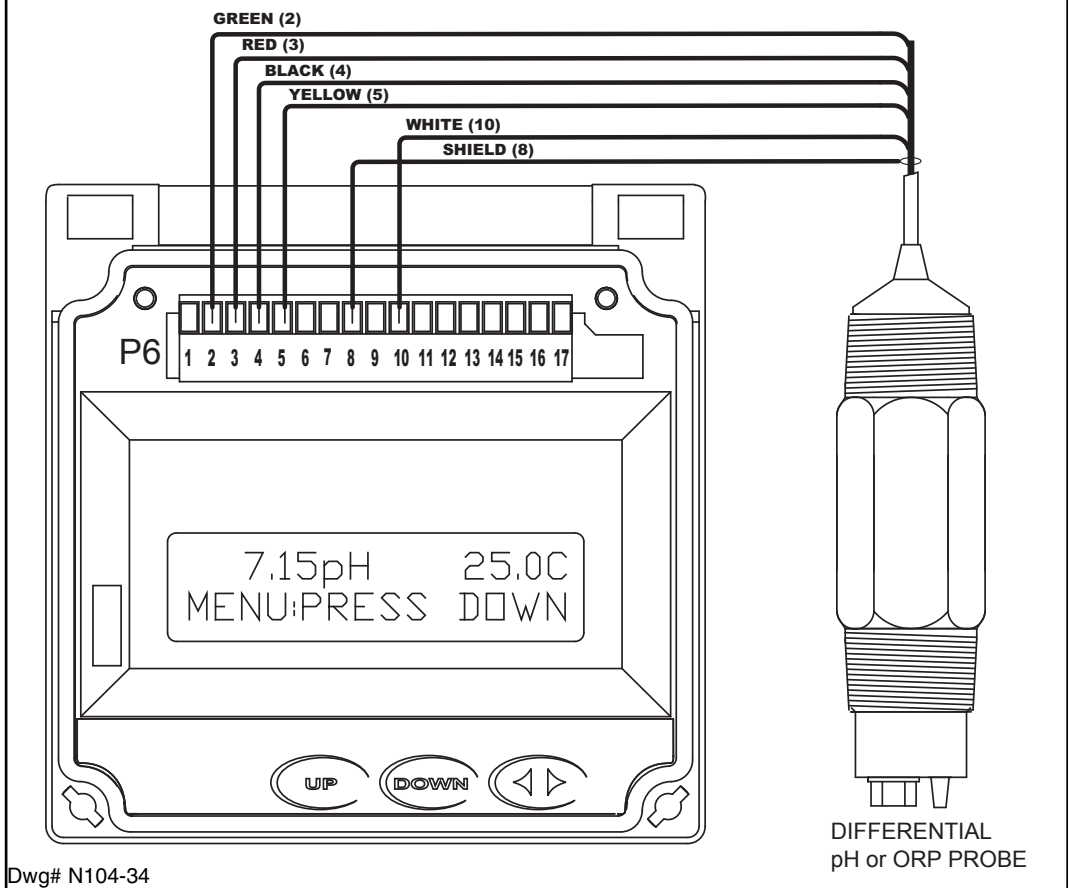

Once connected, step through the LCD menus to select the probe in the order shown. The first two steps may be skipped if the meter is already configured for pH or ORP and a Differential Probe. When using a pH probe, it is important to ensure that the Shark is reading the probe temperature correctly for accurate temperature compensation. The ORP probe does not require temperature compensation, although the Shark can display process temperature measured by the probe. The factory temperature calibration is usually accurate enough that no adjustments are necessary.

METER SELECTION

SELECT pH SEC. 4.6
or ORP SEC. 5.5
(IF NECESSARY)

PROBE SELECT

SELECT DIFFERENTIAL PROBE
pH SEC. 4.7 or ORP SEC. 5.6
(IF NECESSARY)

MANUAL CAL PH

MANUAL CALIBRATE
pH PROBE SEC. 4.1
or ORP PROBE SEC. 5.1

7.15pH 25.0C

RUN MODE



Section 3 - Electrical Connections and Setup

3.4 pH or ORP Combination Probe connections and setup

The drawing shows the connections for the Aquametrix Combination probe. The cable should be run in a conduit separate from AC power wires, and via a separate conduit hole. The cable length should not exceed 10 feet (3 meters).

The **2 wire** version has no temperature sensor and is connected via a coaxial wire.

In a **pH meter**, the user should set the **T COMP OVERRIDE** menu to **ON** (Section 4.11) and adjust the temperature setting to the actual probe temperature.

In an **ORP meter**, the user should set the **T.DISP OVERRIDE** to **ON** (Section 5.10) to blank the temperature reading on the display.


The **4 wire** version has two additional wires for the probe internal temperature sensor. Ensure that the **T COMP OVERRIDE** or **T.DISP OVERRIDE** is **OFF**.

Note: Leave 4" to 6" slack for all wires connected to the terminals of P6. Slack required so wires do not interfere with opening/closing of front door.

CAUTION:


Always remove line power before unplugging or plugging in the P6 connector

Fig. 3.3 Connections for the 2 and 4 wire Combination Probe

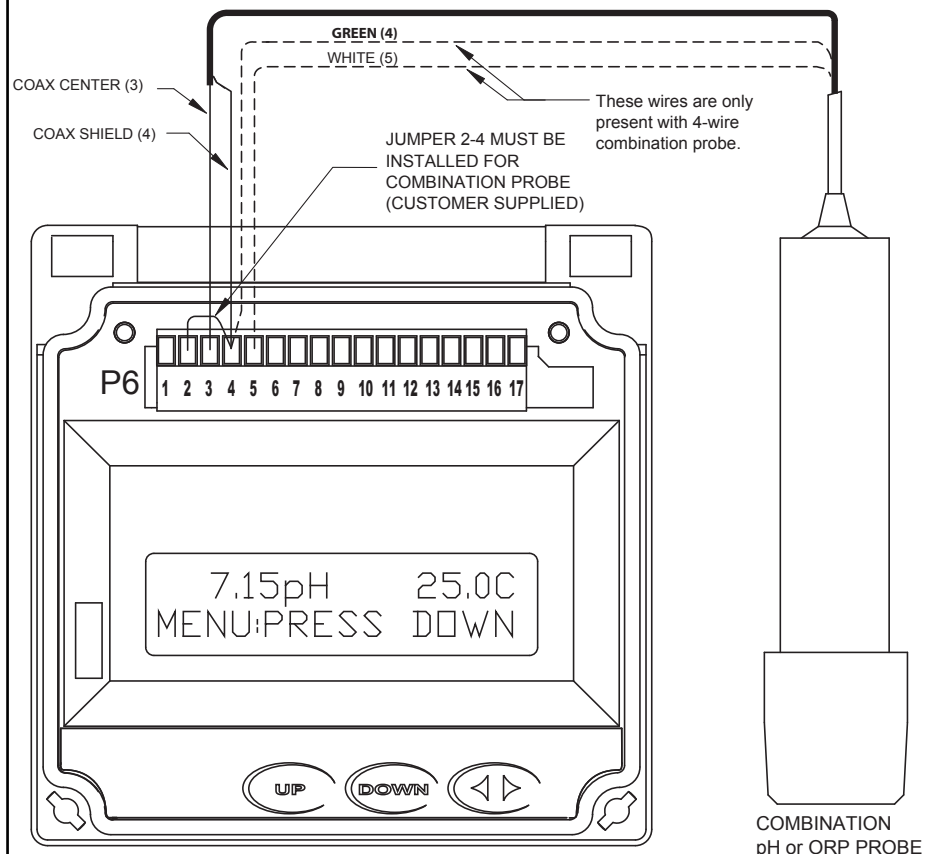

Dwg# N104-35

Once connected, step through the LCD menus to select the probe in the order shown. The first two steps may be skipped if the meter is already configured for a Combination Probe. If a two wire pH probe is used, which has no temperature sensor, ensure that the Temp. Comp. Override is set to same temperature as the buffer before calibrating. If a two wire ORP probe is used, you can blank the Temp display with the T DISP OVERRIDE menu.

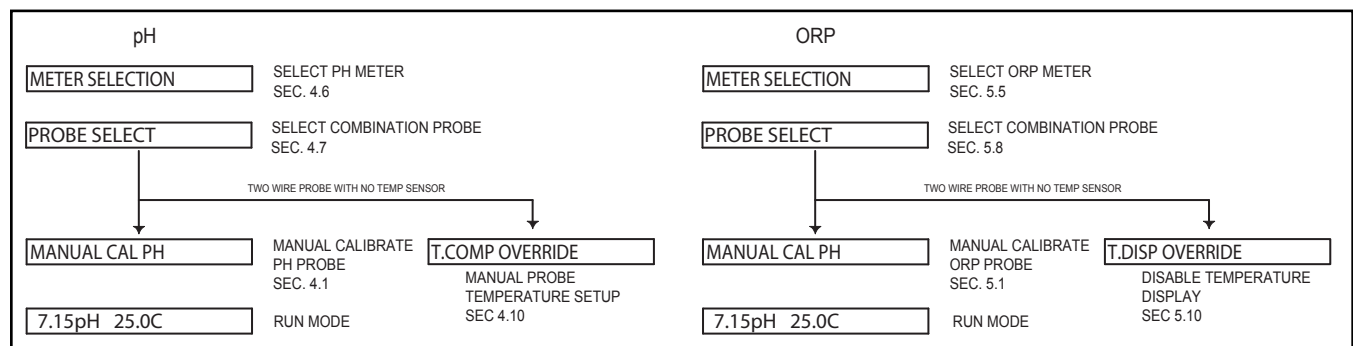



Section 3 - Electrical Connections and Setup


3.5 Conductivity Cell (Contacting style) connections and setup

The drawing shows the connections for the Aquamatrix Conductivity Cells (Contacting style). The cable should be run in a conduit separate from the AC power wires, and via a separate conduit hole. The cell cable length should not exceed 300ft. (91 meters).


Note: Leave 4" to 6" slack for all wires connected to the terminals of P6. Slack required so that wires do not interfere with opening or closing of the front door.

CAUTION:

Always remove line power before unplugging or plugging in the P6 connector

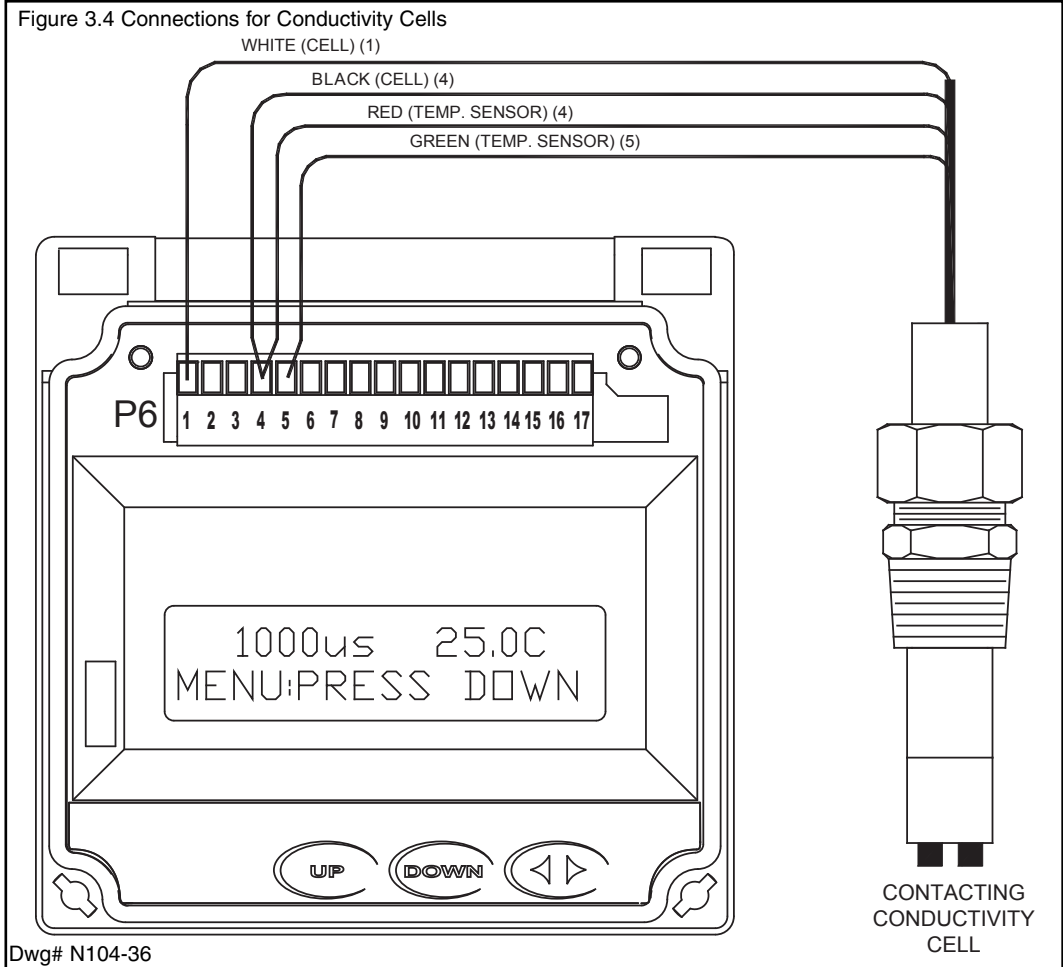

Once connected, step through the LCD menus to select the cell in the order shown. The TEMP COMP CURVE setup default is 1.8%/deg C. This is acceptable for most process applications. If your process is significantly different from this, change the setting in the TEMP COMP CURVE menu.

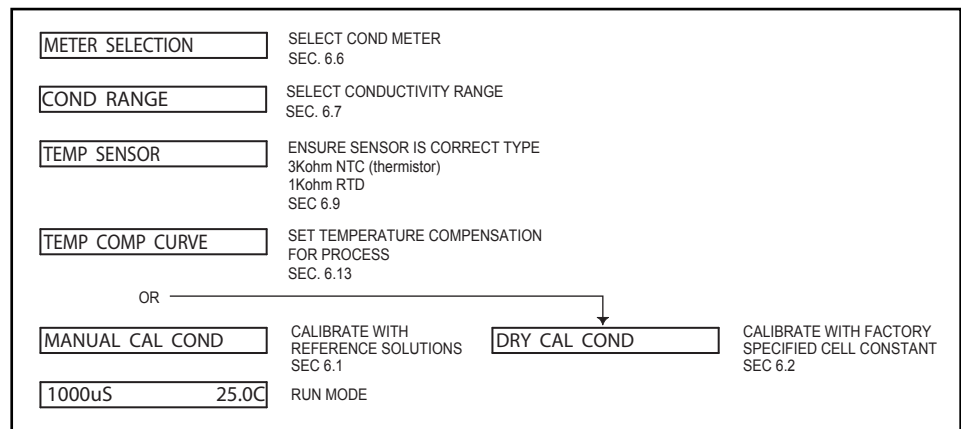




Section 3 - Electrical Connections and Setup

3.6 Paddle Wheel Flow Sensor connections and setup

The drawing shows the connections for a typical paddle wheel flow sensor. The cable to the sensor should not exceed 2000' (600 meters).

The Shark controller also supports the use of an external "flow switch". When the flow switch input is grounded, either through a dry contact or solid state input, the flow display will be held at zero. This is useful to ensure the flow reading remains locked at zero when conditions require it. The flow will start reading again when the input is opened. If the flow switch function is not desired, simply leave it disconnected and the flow meter will read as normal.

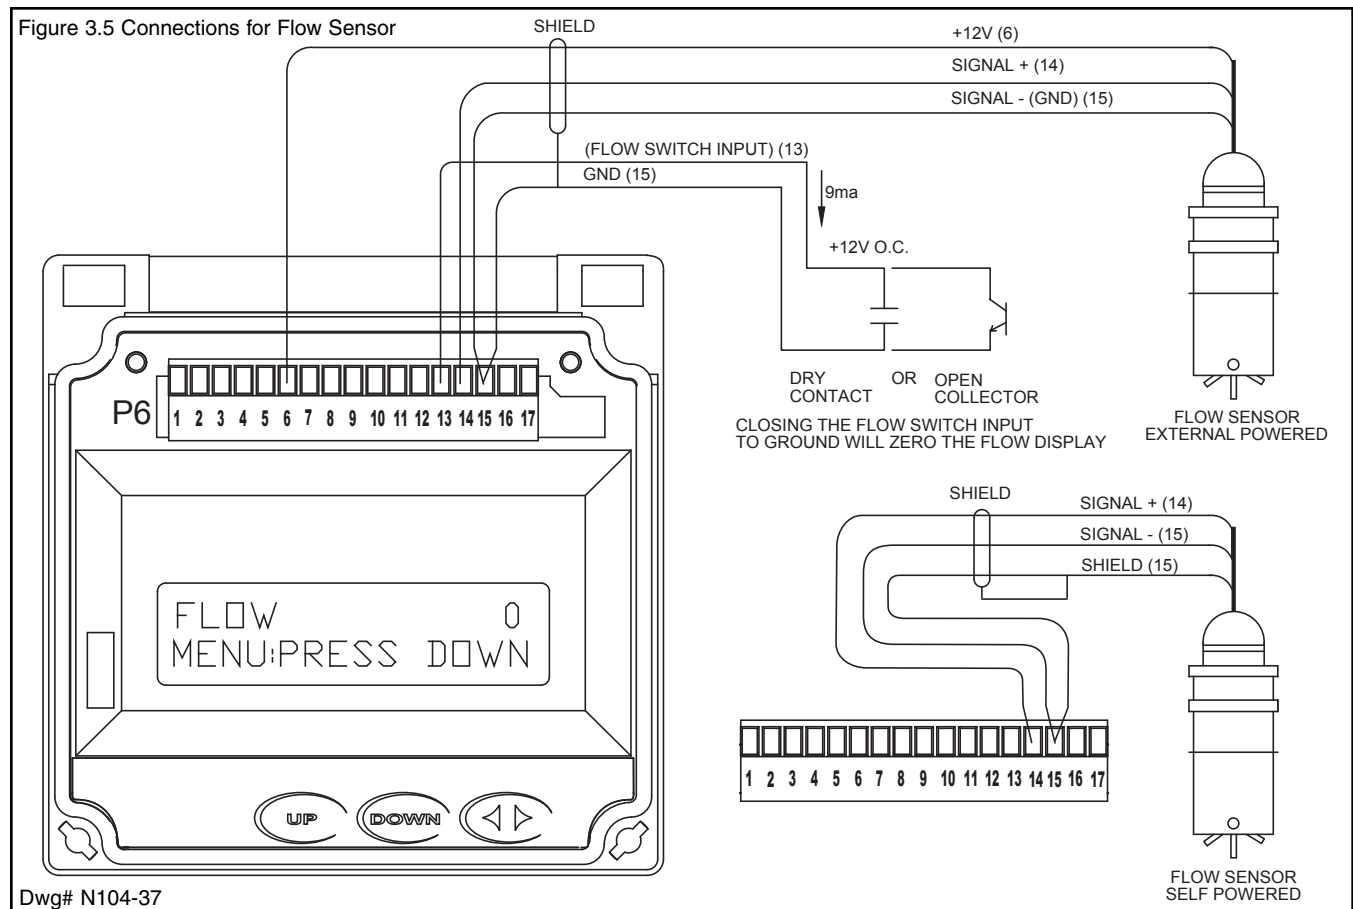

Note: Leave 4" to 6" slack for all wires connected to the terminals of P6. Slack required so that wires do not interfere with opening or closing of the front door.

CAUTION:

Always remove line power before unplugging or plugging in the P6 connector

Once connected, step through the LCD menus to select the sensor in the order shown. The Sensor K factor (pulses per U.S. Gallon) is usually printed on the side of the sensor or on a label attached to the sensor cable.

METER SELECTION	SELECT FLOW METER SEC. 7.4
K FACTOR	ENTER FLOW SENSOR CALIBRATION FACTOR SEC. 7.1
UNITS OF VOLUME	SETUP OF UNITS OF VOLUME SEC. 7.5
UNITS OF TIME	SETUP OF UNITS OF TIME SEC. 7.6
TOTALIZER RESET	RESET TOTALIZER TO ZERO SEC. 7.0
TOTAL 0	RUN MODE



Section 3 - Electrical Connections and Setup

3.7 Relay connections

The Shark controller has three internal relays. Relays A and B are for control, the Alarm Relay can be configured for alarm functions or as an additional control relay.


The connections to the relays are shown in the drawing. Note that the AC power is internally connected to the relay terminal plug P4. This is used to provide 120V or 240V AC power for the relay contacts.

Wire Specification: Size and fuse wire according to local electrical code. Wire size not to exceed 14 AWG.

WARNING

DISCONNECT POWER FROM CONTROLLER AND LOADS WHILE CONNECTING TO THE RELAY OUTPUT TERMINAL PLUG.

Figure 3.6 Connections for Relay A, B and Alarm

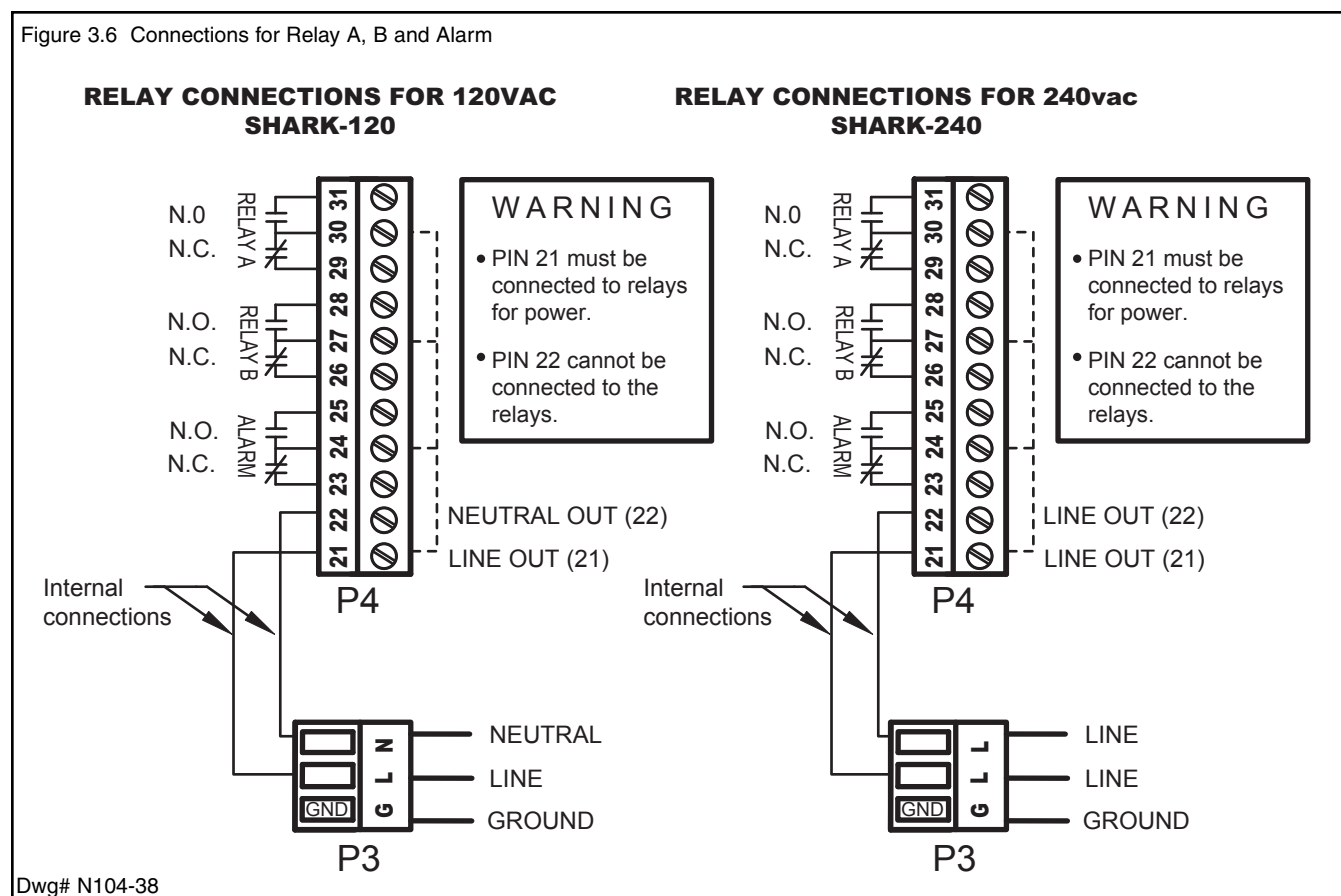

Caution:

The contacts are rated at 10 amp N.O. and 5 amp N.C. Do not exceed this rating. When switching larger currents, use an auxiliary relay switched by the controller relay to extend the controller relay life. If the relays are controlling an inductive load, use appropriate transient suppression at the load.



Section 3 - Electrical Connections and Setup

3.8 RELAY A and B Setup

(LCD MENU SECTIONS - pH: 4.18 & 4.19, ORP: 5.17 & 5.18,
Conductivity: 6.18 & 6.19, Flow: 7.15 & 7.16)

Relay A & Relay B on the SHARK are SPDT dry contact relays. They are configurable to operate in response to rising or falling process values. Each relay has independently adjustable on and off set-points, cycle times, and fail-safe options.

The operator would use the control relays if the device to be controlled is a simple on/off device. For example a pump, solenoid valve, fan, or an indicating light.

The control relays have 6 user configurable settings:

DIRECTION: The relay can be set to control either a rising or falling process. If for example the relay is set to control a falling process, the ON set-point must be set lower than the OFF set-point. If the relay is set to control a falling process the SHARK will not allow the RELAY OFF set point to be set lower than the RELAY ON set-point. This rule will also apply to a rising process.

RELAY ON set-point: This is the process value at which the relay will energize. This value can be set anywhere between 0-100% of the range.

RELAY OFF set-point: This is the process value at which the relay will de-energize. Depending on the direction for which the relay is configured, the RELAY OFF set-point will only be settable in a limited range.

CYCLE ON time: To obtain a tighter process control, and limit over-shoot, the control relay can be set with the cycling feature. This feature, if enabled, will cause the control relay to cycle when the process is between the RELAY ON set-point and RELAY OFF set-point. The cycle on time is the amount of time in seconds that the relay will be energized. It can be set between 0 and 600 seconds.

CYCLE OFF time: The CYCLE OFF time is the amount of time in seconds that the relay will be de-energized, it can be set between 0 and 600 seconds. To disable the cycling feature set the cycle off time to 0.

OVERFEED TIMER: The overfeed timer is designed to help safeguard against a process or instrumentation error causing one of the control relays to remain energized for extended periods of time.

When enabled, the overfeed timer will time out if the control RELAY OFF set point is not reached inside the overfeed time out. The control relays will de-energize, the alarm relay will energize and an LED will flash at the front.

FAILSAFE: The FAILSAFE feature is designed to reverse the normal action of the control relay.

When the relay is set to FAILSAFE OFF the relay will operate as a normal relay. When the relay is de-energized the NO contacts are open and the NC contacts are closed. Thus the device connected via the NO contacts will be off. When the relay becomes energized the device will be on.

When the relay is set to FAILSAFE ON, the normal action of the relay is reversed. Thus the NO contacts act as the NC contact and the NC act as the NO. The device connected to the NC contacts will be energized when the RELAY ON set-point is reached. The relay will be de-energized but because it is acting in reverse the device will be energized. When the RELAY OFF set-point is reached the relay will energize and the device connected to the NC contact will de-energize.

The purpose of the Fail Safe option is to have the device turned on in the event of a power interruption.

The factory default for FAILSAFE is OFF.



Section 3 - Electrical Connections and Setup

3.9 ALARM RELAY Setup

(LCD MENU SECTIONS - pH: 4.20, ORP: 5.19, Conductivity: 6.20, Flow: 7.17)

The third relay (Relay C) is used as an alarm relay. The alarm relay on the SHARK is a SPDT dry contact relay.

This relay will respond to both a rising and falling process. The alarm relay will act as a low alarm (falling process) and a high alarm (rising process). Both relays will have independently adjustable on and off set-points. The ALARM ON set-points will always be set before the ALARM OFF set-points. The shark will not let the user input a value below the ALARM ON set-point. The same rule holds true for the high alarm.

The control relays have 5 user configurable settings:

ALARM LOW ON set-point: This is the low process value that will cause the relay to energize. This value can be set anywhere between 0-100% of the range.

ALARM LOW OFF set-point: This is the value that the process must reach in order to de-energize the alarm relay after it has dropped below the ALARM LOW ON set-point. This value must be higher than the ALARM LOW ON set-point.

ALARM HIGH ON set-point: This is the process value that will cause the relay to energize. This value can be set anywhere between 0-100% of the range.

ALARM HIGH OFF set-point: This is the value that the process must reach in order to de-energize the alarm relay after it has increased over the ALARM HIGH ON set-point. This value must be lower than the ALARM HIGH ON set-point.

FAILSAFE: This option can be turned on or off. It reverses the normal action of the relay. (see description under control relay)

ALARM SET-POINT ERROR: If the ALARM LOW ON set-point is set higher than the factory default ALARM LOW OFF set-point, when the user advances from the ALARM LOW ON set-point to the ALARM LOW OFF set-point the shark will adjust the ALARM LOW OFF set-point to be equal to the ALARM LOW ON set-point. If the user then tries to decrease the ALARM LOW OFF set-point the Shark will display the ALARM LOW ALARM setup error screen.

This screen will be displayed for 10 seconds, then return back to the setup screen that was previously displayed. If the user presses the down key again the error message will be displayed again for 10 seconds. The user must accept the LOW OFF set-point, equal to, or greater than the LOW ON set-point.

The same conditions apply to the ALARM HIGH set-points. Except the ALARM HIGH OFF set-point must be lower than the ALARM HIGH ON set-point. If the user tries to increase the ALARM HIGH OFF set-point higher than the ALARM HIGH ON set-point the High Alarm setup error screen will be displayed.

ALARM RELAY DISABLE: If the user sets the ALARM LOW ON set-point and the ALARM LOW OFF set-point equal to 0% of the range. It will disable the low alarm relay.

If the user sets the ALARM HIGH ON set-point and the ALARM HIGH OFF set-point equal to 100% of the range. It will disable the high alarm relay.



Section 3 - Electrical Connections and Setup

3.10 MANUAL TEST MODE

(LCD MENU SECTIONS - pH: 4.4, ORP: 5.3, Conductivity: 6.4, Flow: 7.2)

Once the relays are configured, the setup can be tested using Manual Test Mode to simulate process changes.

MANUAL TEST MODE is used to simulate a process reading in order to verify the correct response of the outputs. When in the MANUAL TEST MODE, the relays and outputs are no longer placed on hold as they are when in the rest of the menu. The relays and outputs will react to the simulated change in process as if the Shark was in RUN MODE.

Note that when the user exits the MANUAL TEST MODE, the relays and outputs will remain in the MANUAL TEST MODE state until the user enters RUN MODE.

3.11 RELAY OVERRIDE

(LCD MENU SECTION - pH: 4.5, ORP: 5.4, Conductivity: 6.5, Flow: 7.3)

Relay Override is used to manually override the state of the relays. The user is able to set the operating mode of the relay as AUTO/ON/OFF (the default and RUN MODE states are AUTO).

This feature can be used to energize or de-energize the relays to manually correct the process, or to shut down an ancillary device to perform maintenance. When in the RELAY OVERRIDE mode, the relays are no longer placed on hold as they are when in the other menus.

Note that if the RELAY AUTO RETURN is set to "ON", the controller will place all the relay settings back to AUTO 10 minutes after the Shark returns to the run mode..



Section 3 - Electrical Connections and Setup

3.12 4-20 mA Isolated Outputs Channel 1 and Channel 2

(LCD MENU SECTIONS - pH: 4.21 & 4.22, ORP: 5.20 & 5.21,
Conductivity: 6.21 & 6.22, Flow: 7.18 & 7.19)

The Shark Controller has two 4 to 20mA outputs, electrically isolated from each other and ground. Either output can source current into a maximum of 800 ohms.

Channel 1 (the primary output) is located on the flip out door, terminal plug P6. Channel 1 is dedicated to track the process and has fully independent and fully adjustable 4 & 20 mA output setpoints. This will enable the operator to span the output over the desired range.


Channel 2 (the secondary output) is located in the enclosure terminal plug P1. Channel 2 can be selected to track the process value or temperature and has fully independent and adjustable 4 & 20 mA output setpoints.

Both Channel 1 and 2 can be precisely trimmed through the LCD menu for precision applications.

The drawing shows the connections for both outputs.

Wire Specification: 22 AWG 7/30,
insulation 0.010"

Figure 3.7 Connections for the 4-20mA outputs

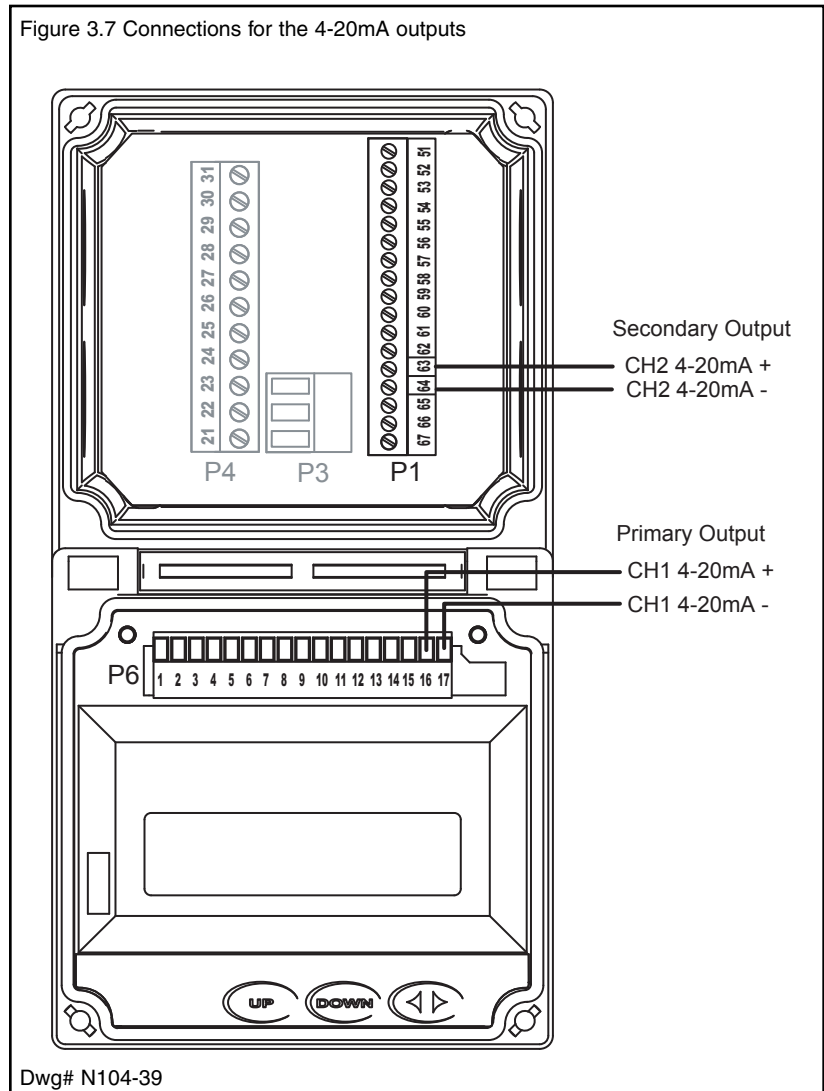

Note: Leave 4" to 6" slack for all wires connected to the terminals of P6. Slack required so that wires do not interfere with opening or closing of the front door.




Section 3 - Electrical Connections and Setup

3.13 Service


SHARK SERVICE TO BE PERFORMED BY QUALIFIED PERSONNEL ONLY.

3.14 Fuse Replacement

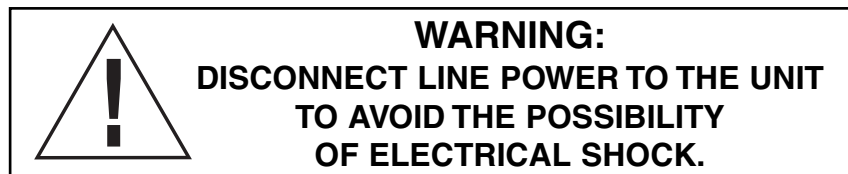

1. Proceed **after** disconnecting line power from the instrument.
2. Open the front panel by rotating the quarter-turn fasteners, using a flat blade screwdriver, to expose the relay board.
3. The fuse, F1, is located in the middle of the relay board, directly above the three terminal connectors.
4. Remove the open fuse and replace it only with a fuse of the same type and rating. REFER TO THE FUSE RATING TABLES BELOW.
5. Close the front panel and secure using the quarter-turn fasteners.
6. Restore power to the unit.

Figure 3.8 Fuse Location

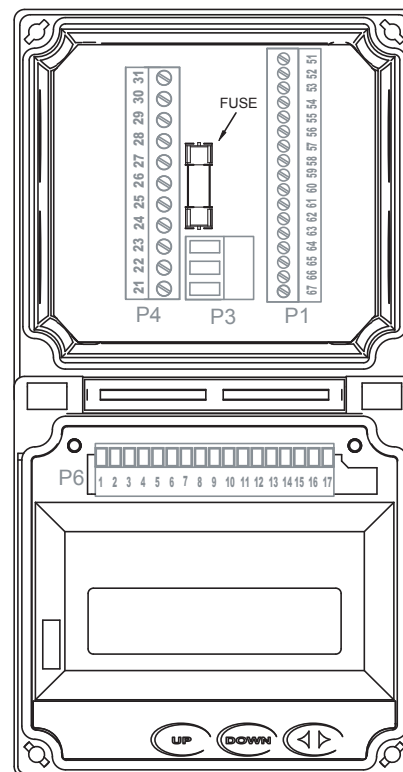

Dwg# N104-40

Fuse Rating Table for **120** volt operation


Fuse Type: Slo-Blo fuse 5 x 20mm	Fuse Ratings: 250 VAC, 100mA
-------------------------------------	---------------------------------

Fuse Rating Table for **240** volt operation

Fuse Type: Slo-Blo fuse 5 x 20mm	Fuse Ratings: 250 VAC, 50mA
-------------------------------------	--------------------------------




Section 4 - Using the SHARK in pH Mode

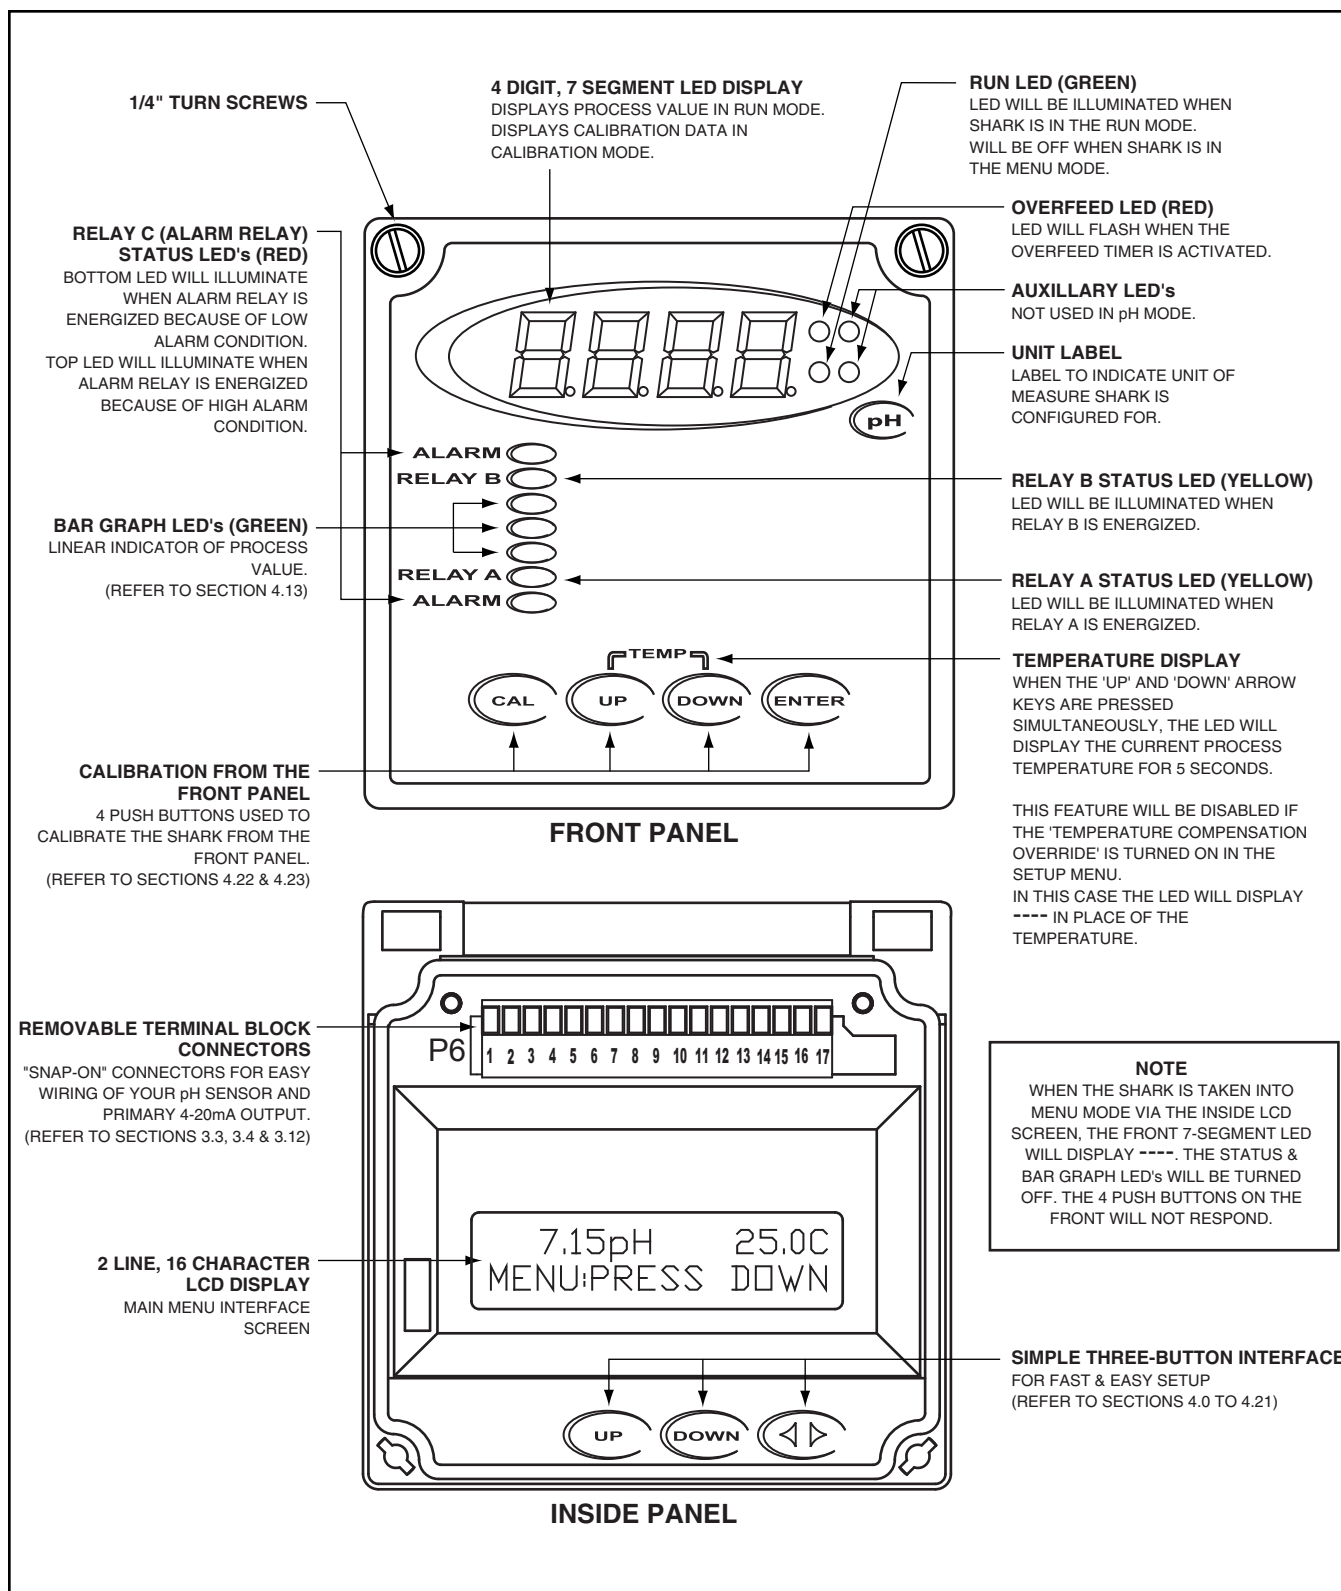




pH - Menu Overview 4.0

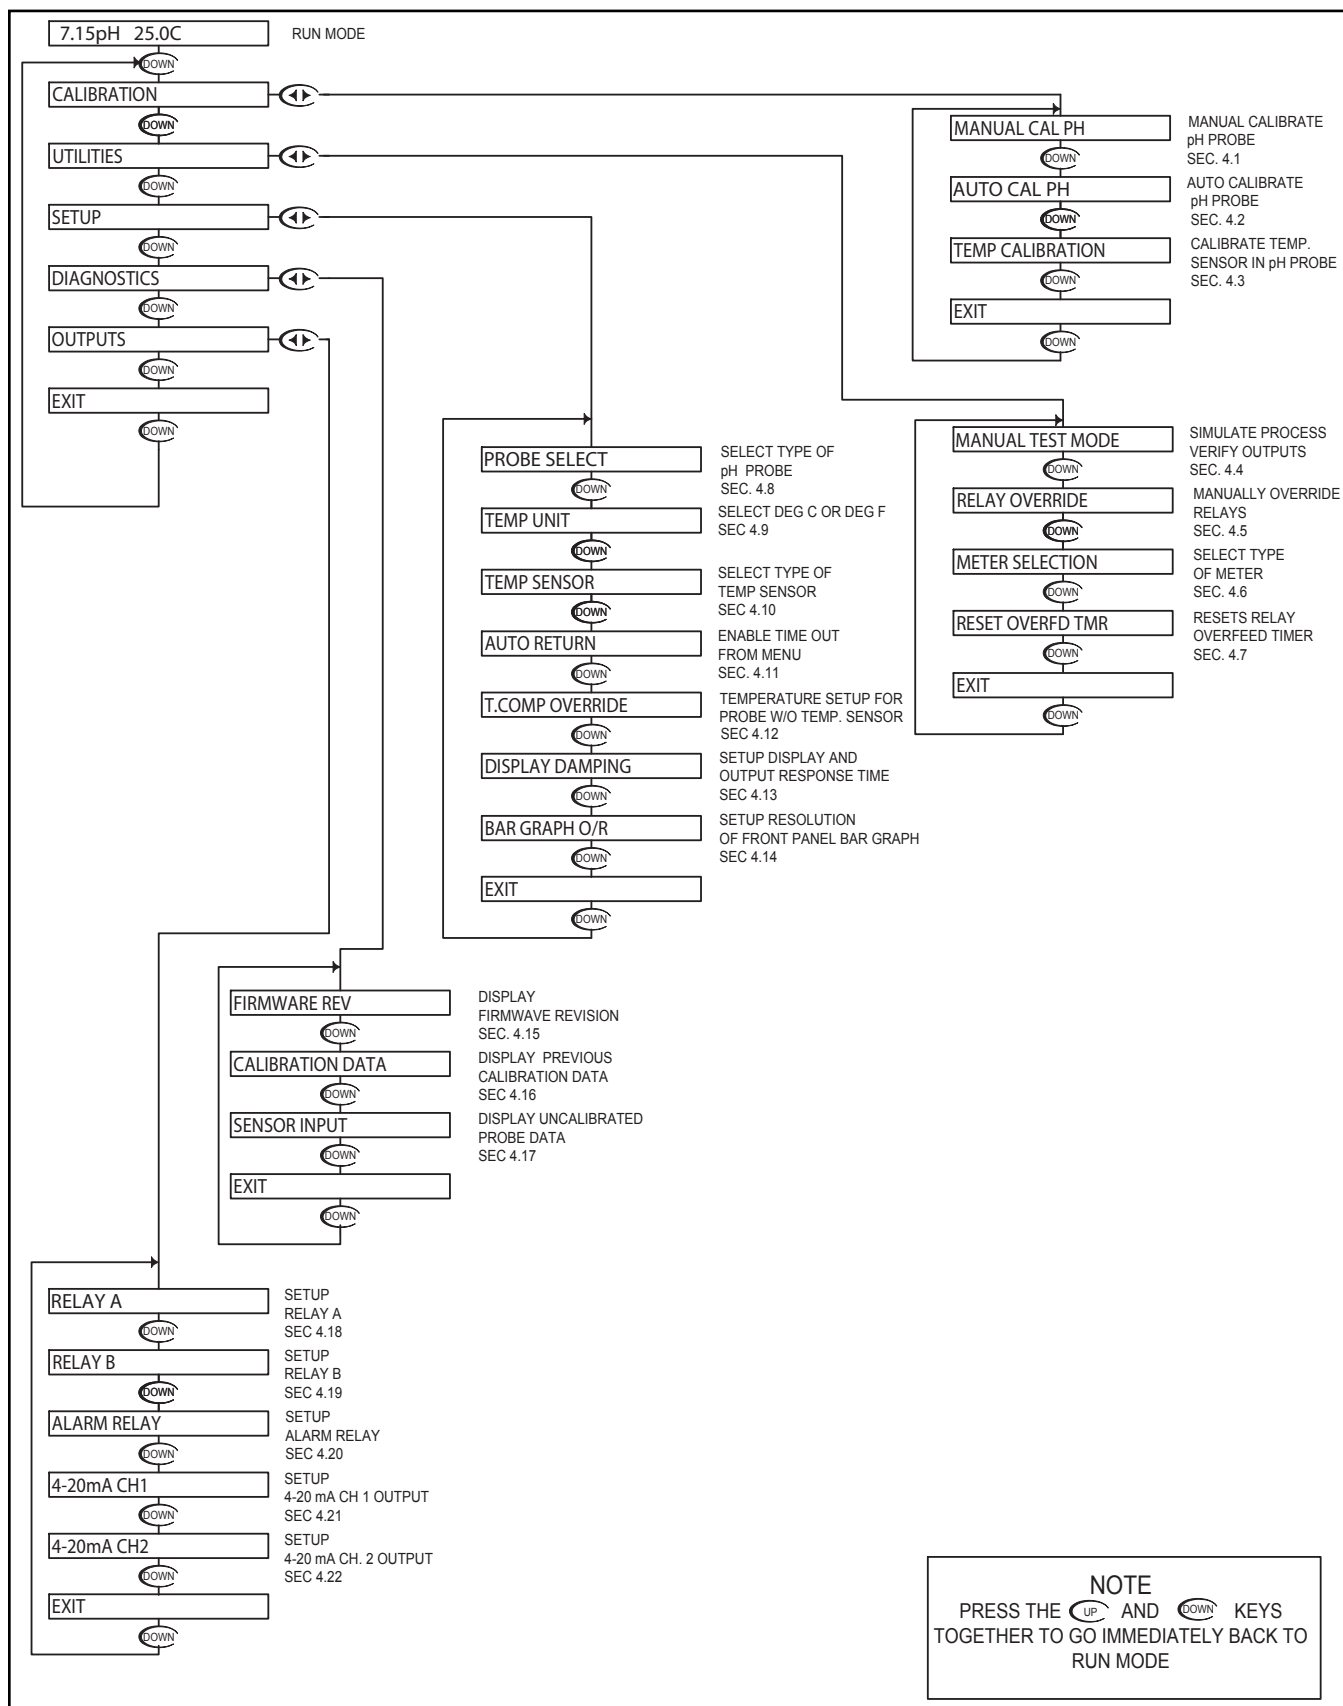


pH - Calibration Menu - Manual Calibrate 4.1

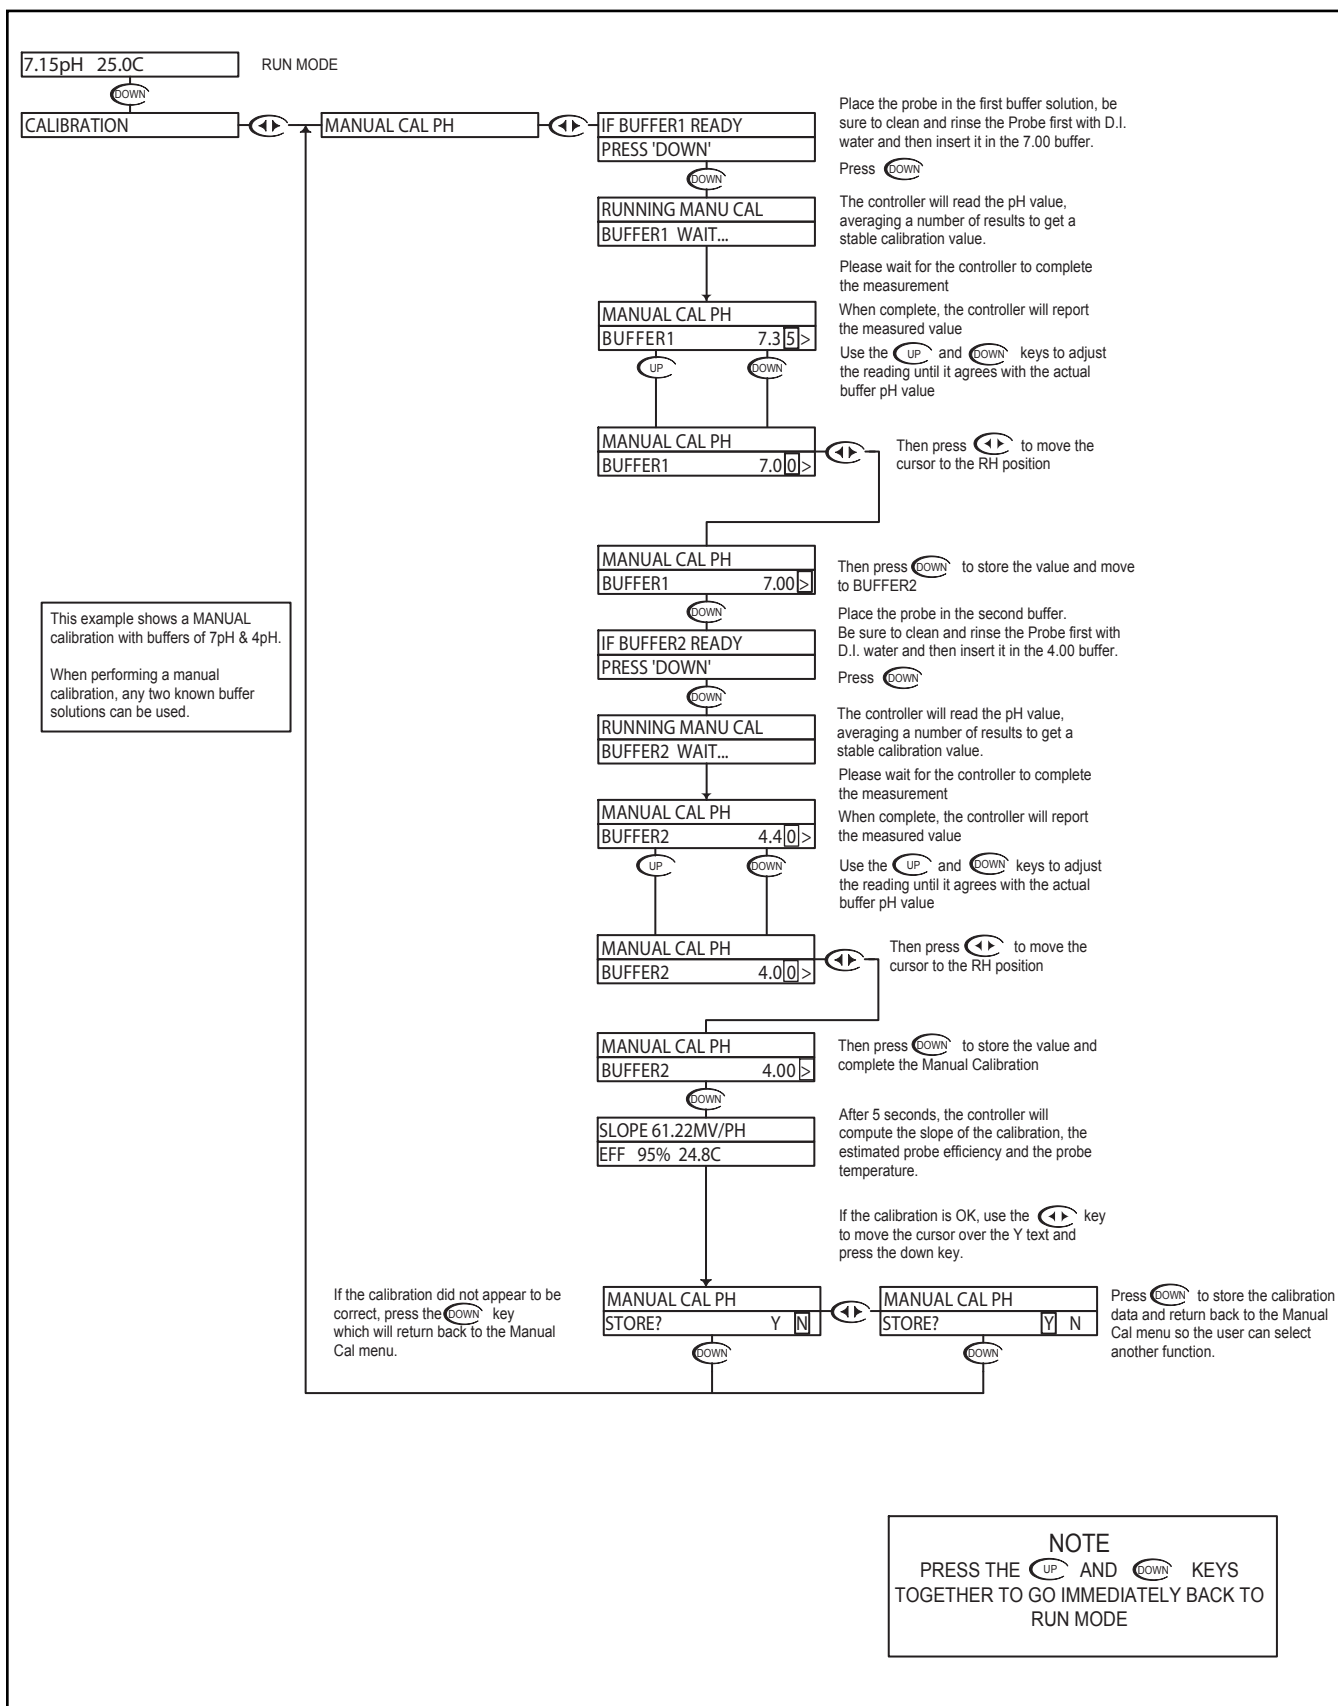




pH - Calibration Menu - Auto Calibrate 4.2

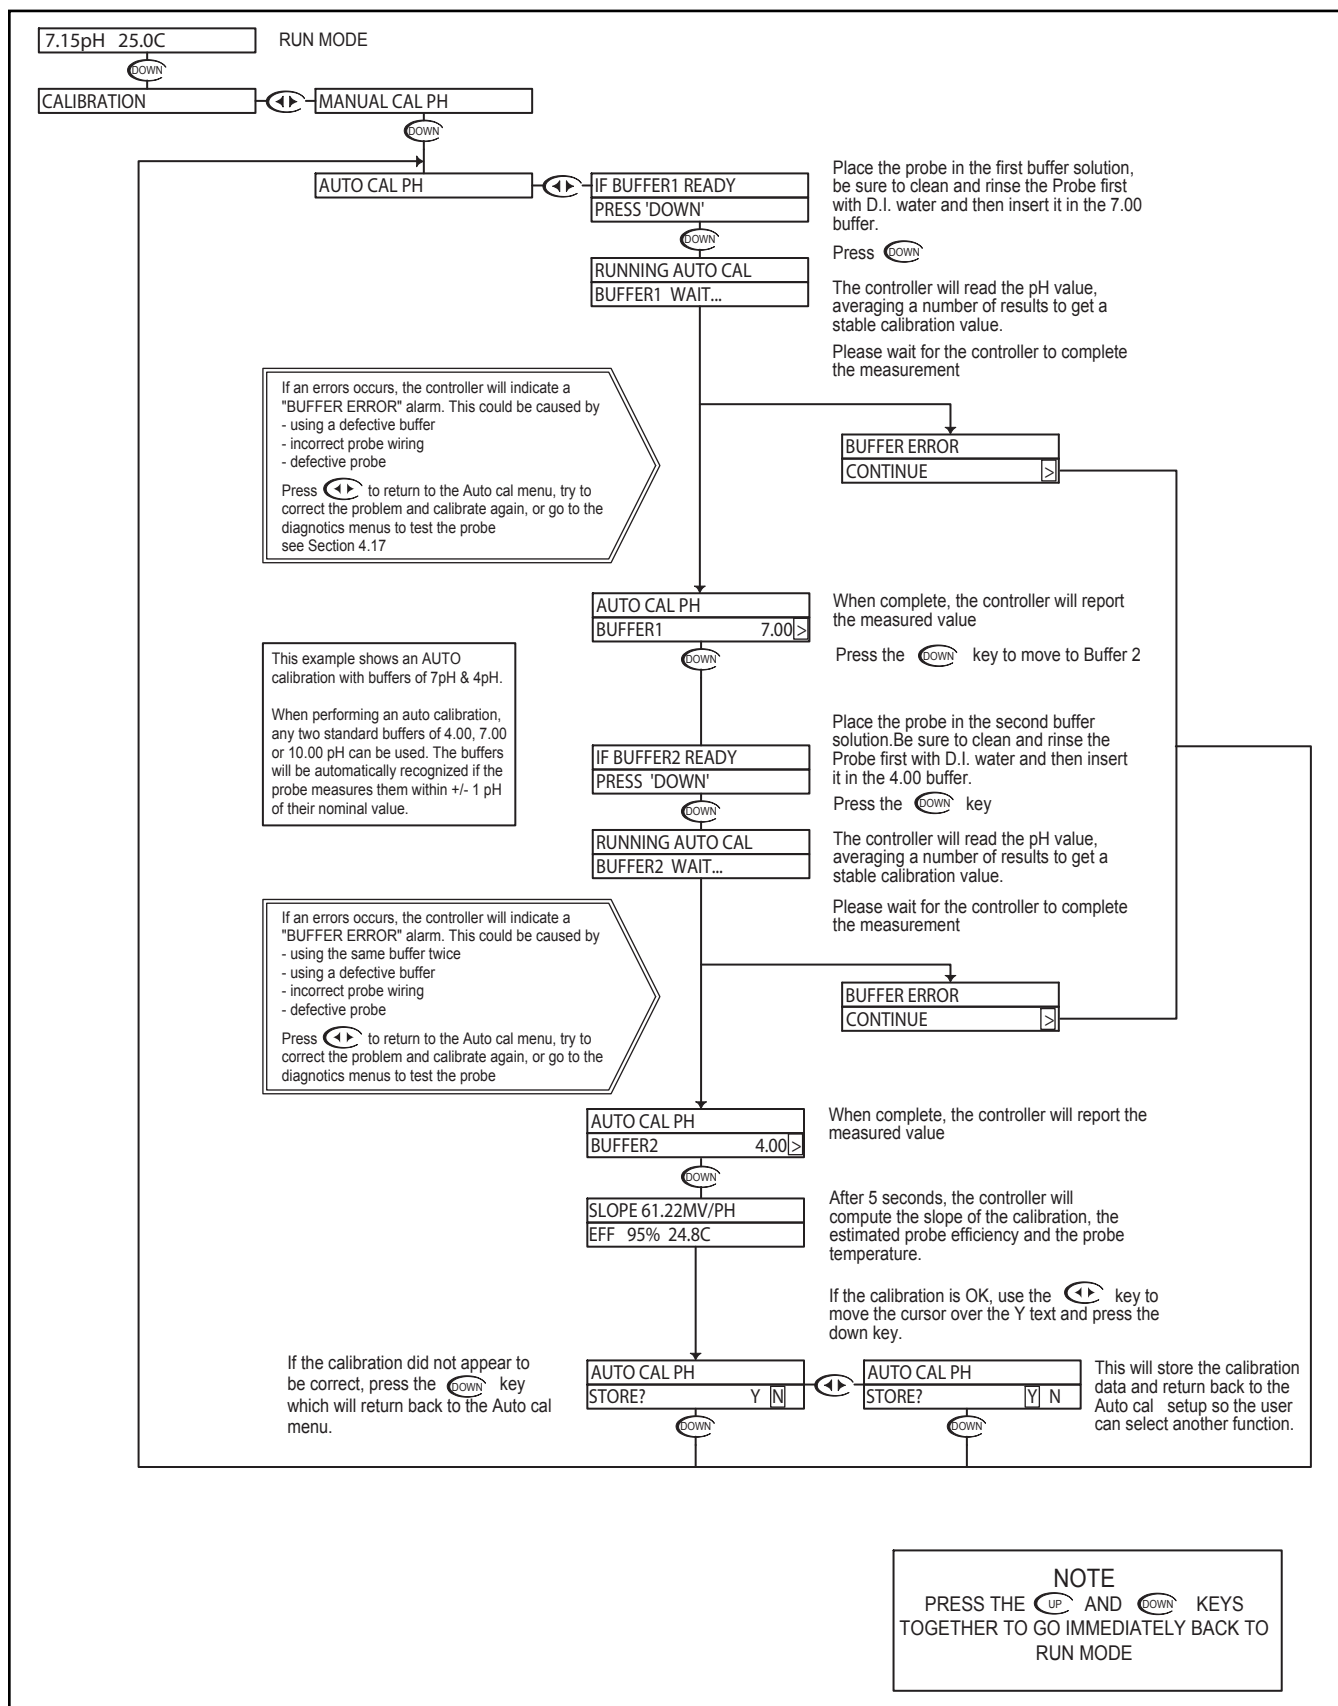




pH - Calibration Menu - Temperature Calibration 4.3

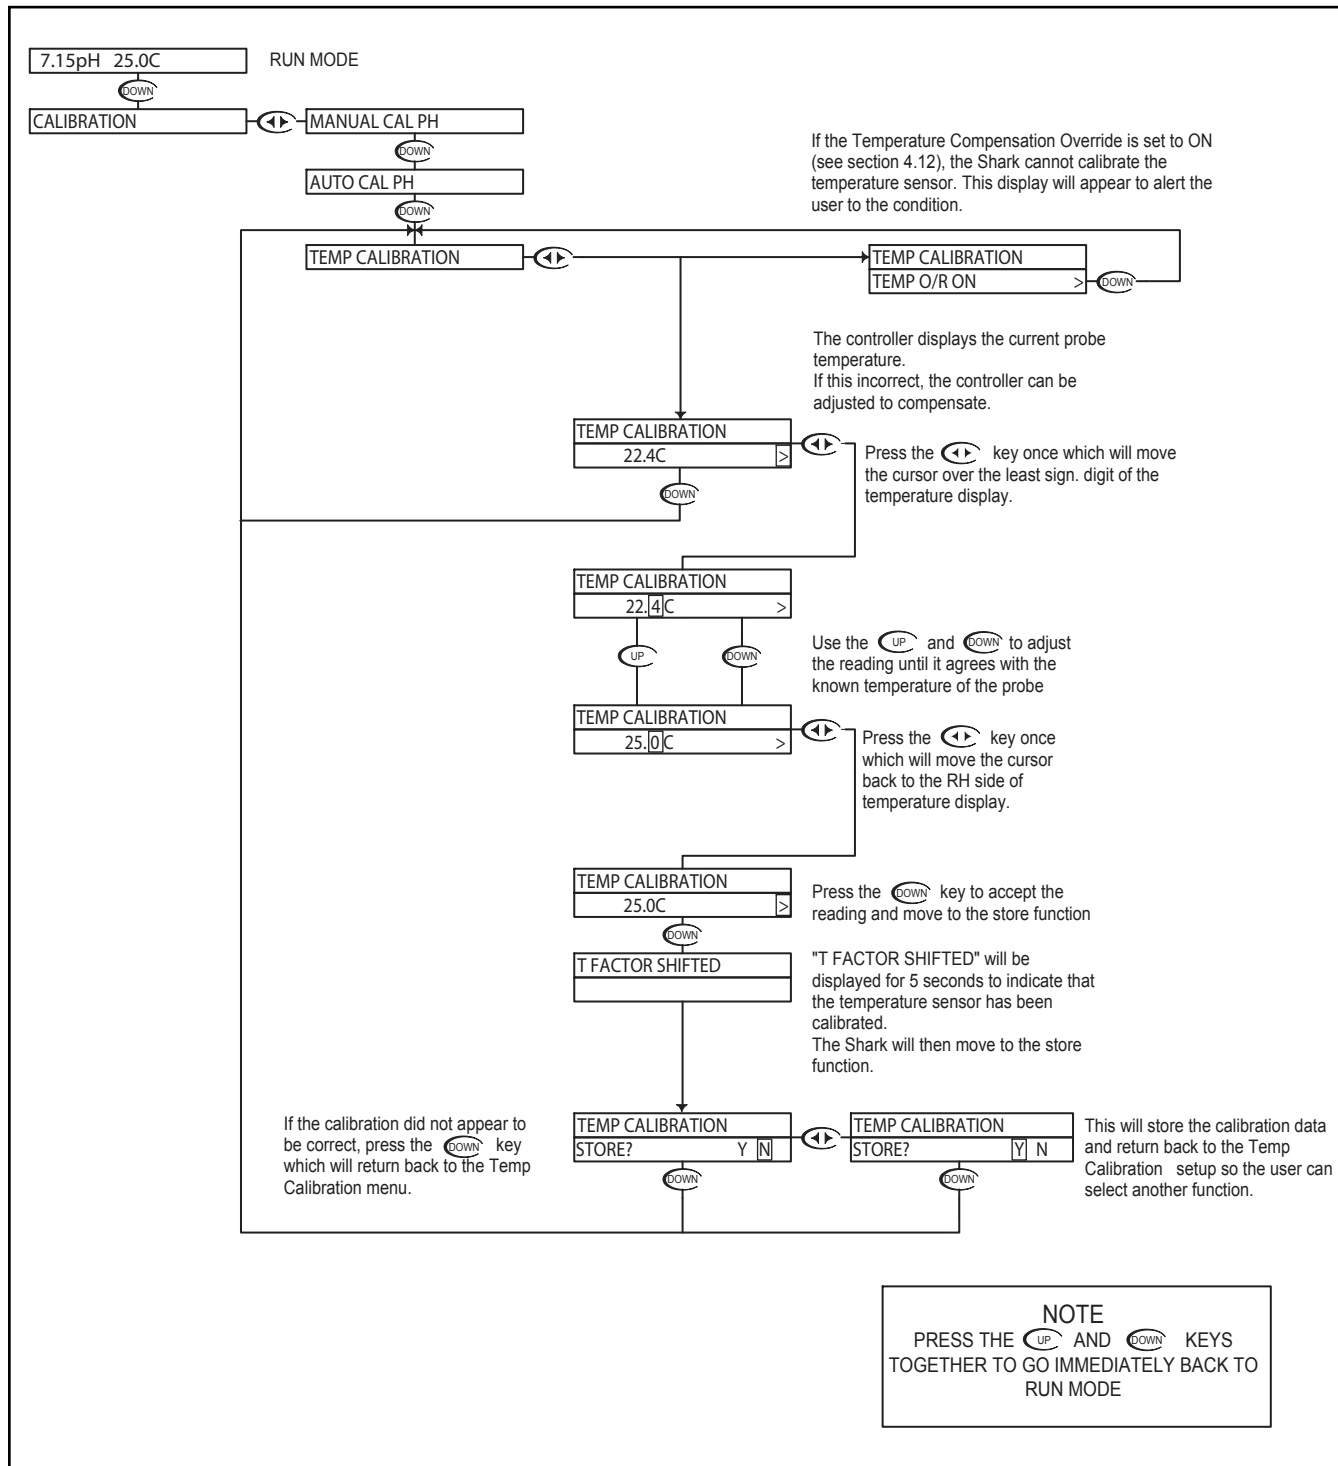




pH - Utilities Menu - Manual Test Mode 4.4

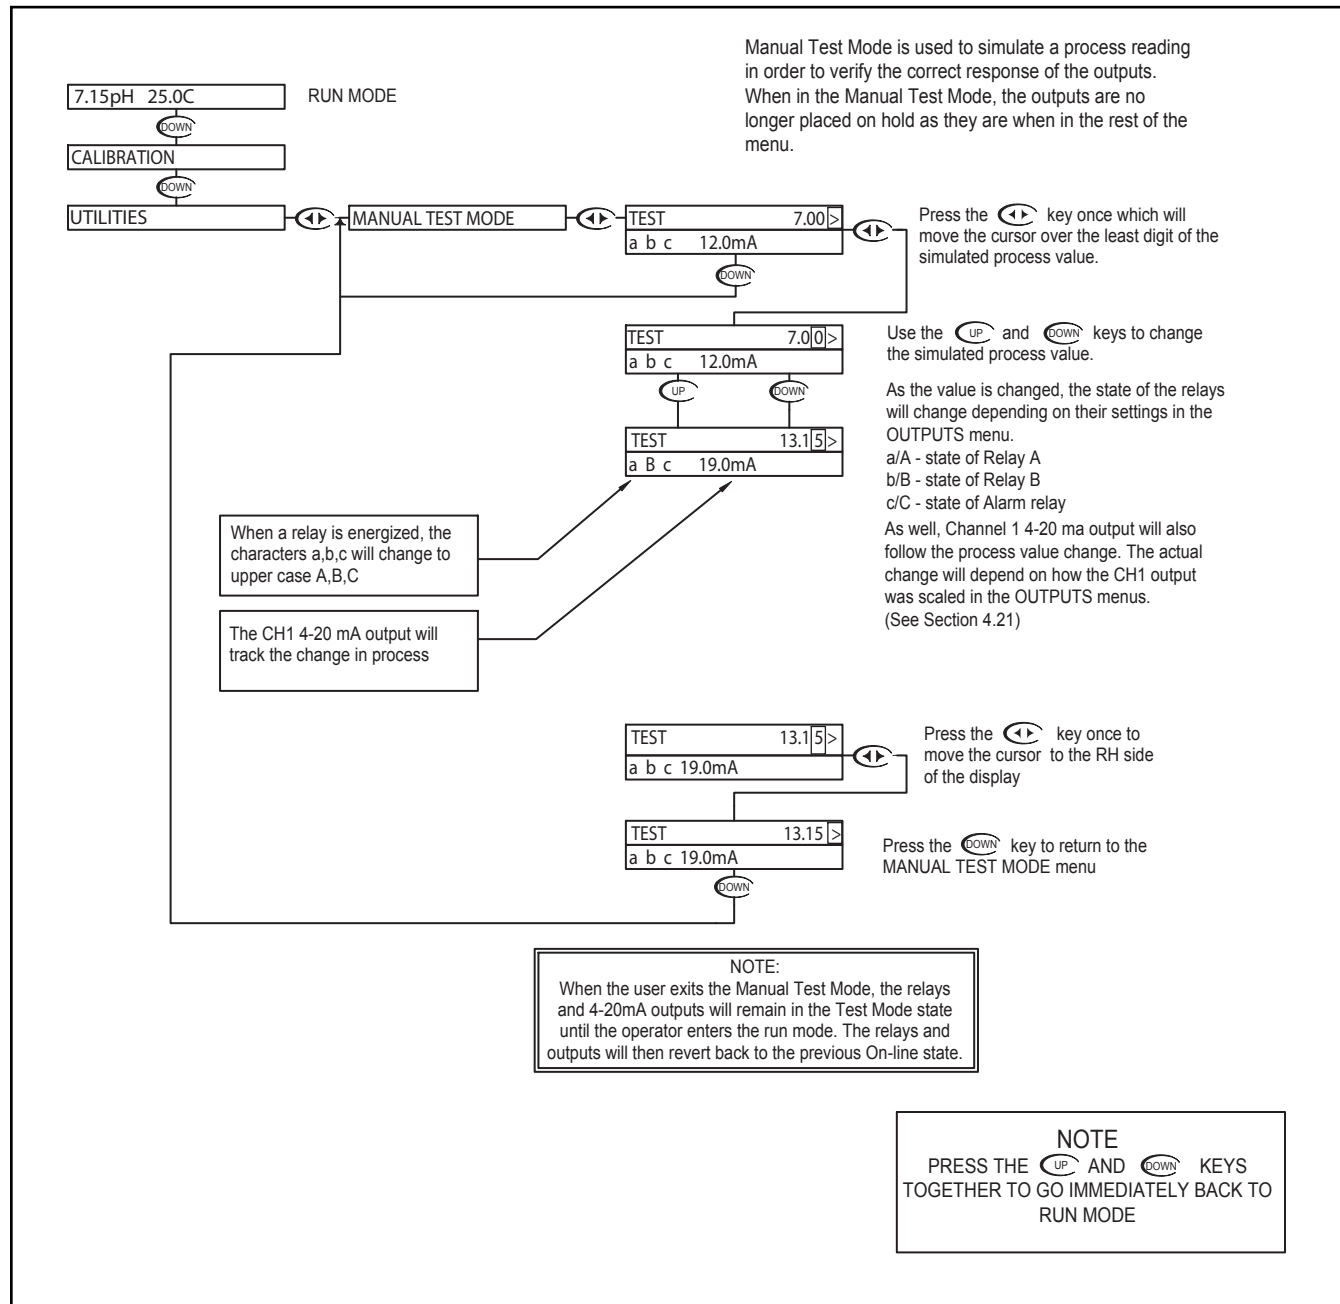


pH - Utilities Menu - Relay Override 4.5

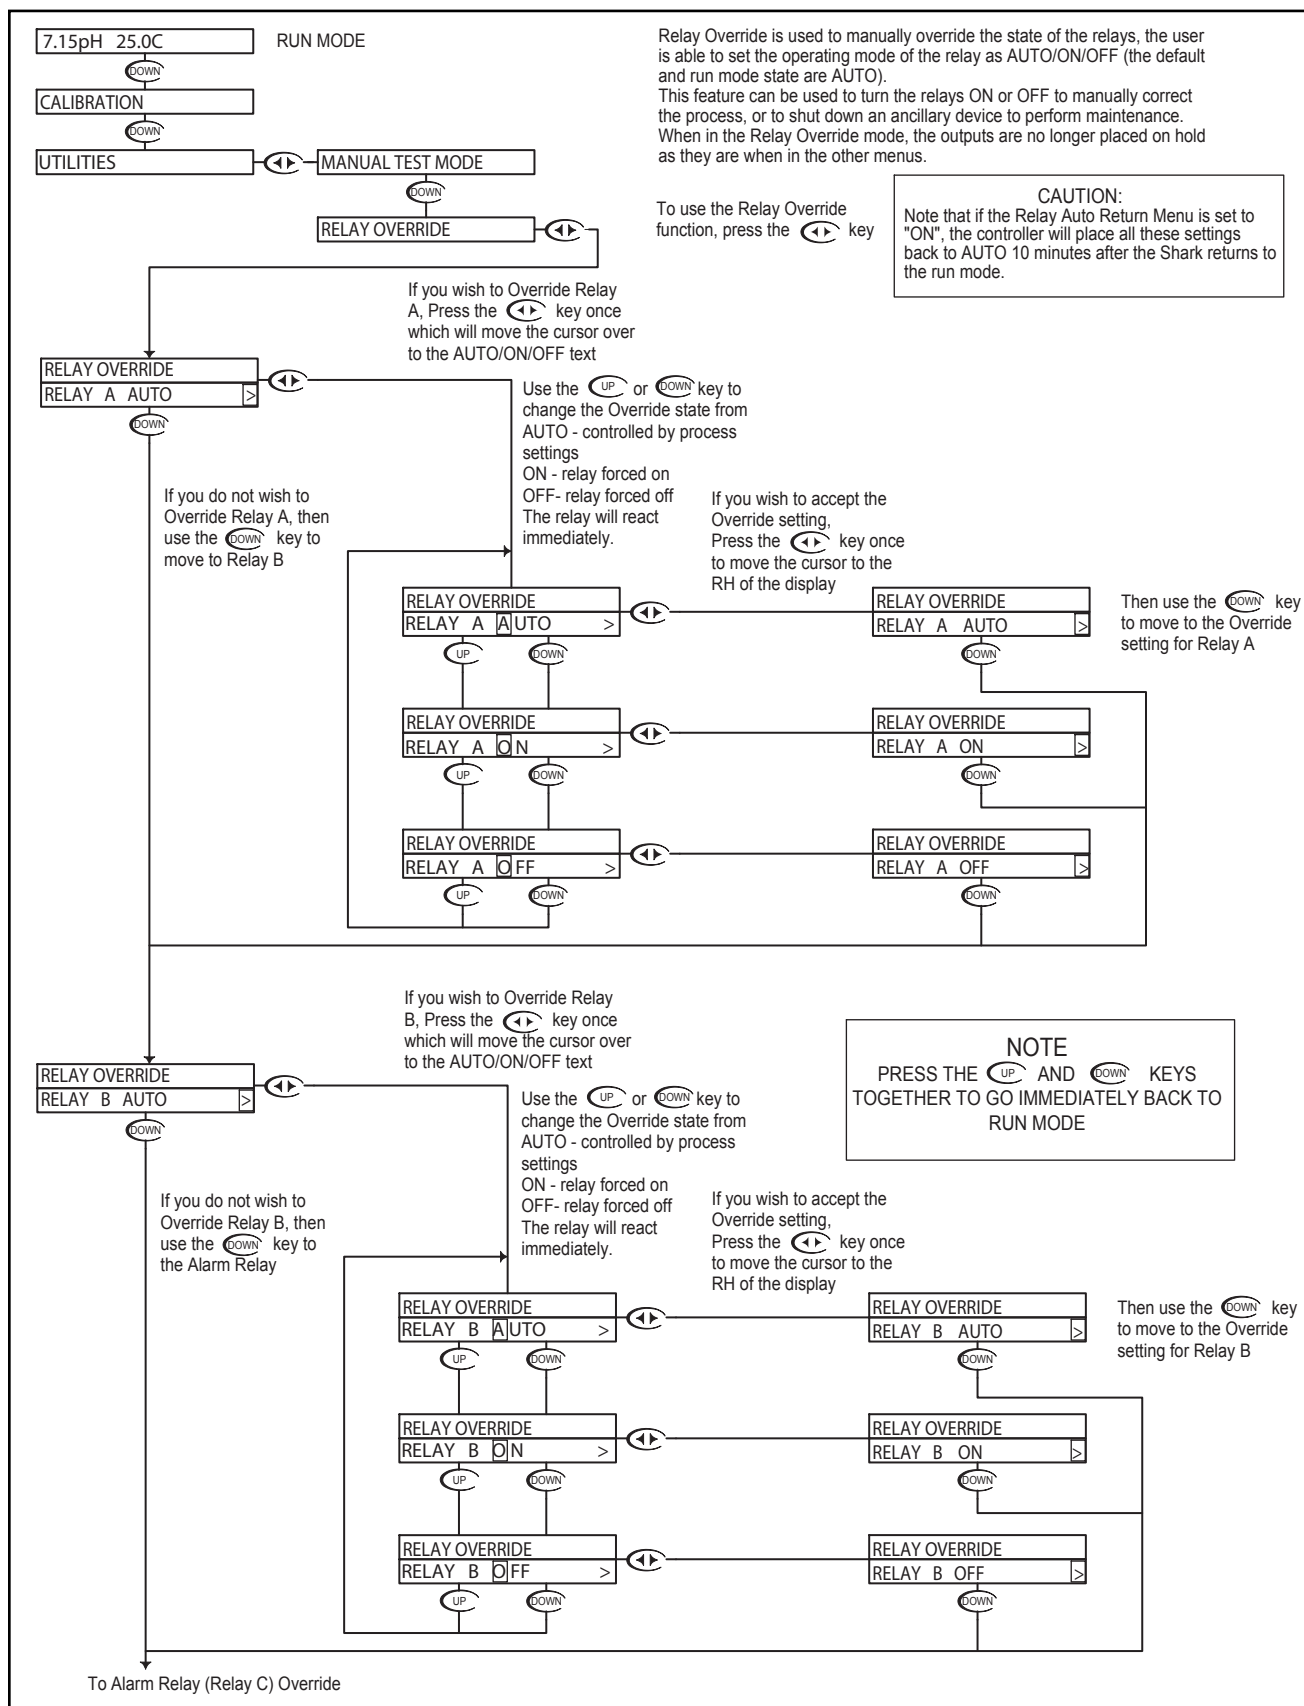




pH - Utilities Menu - Relay Override 4.5

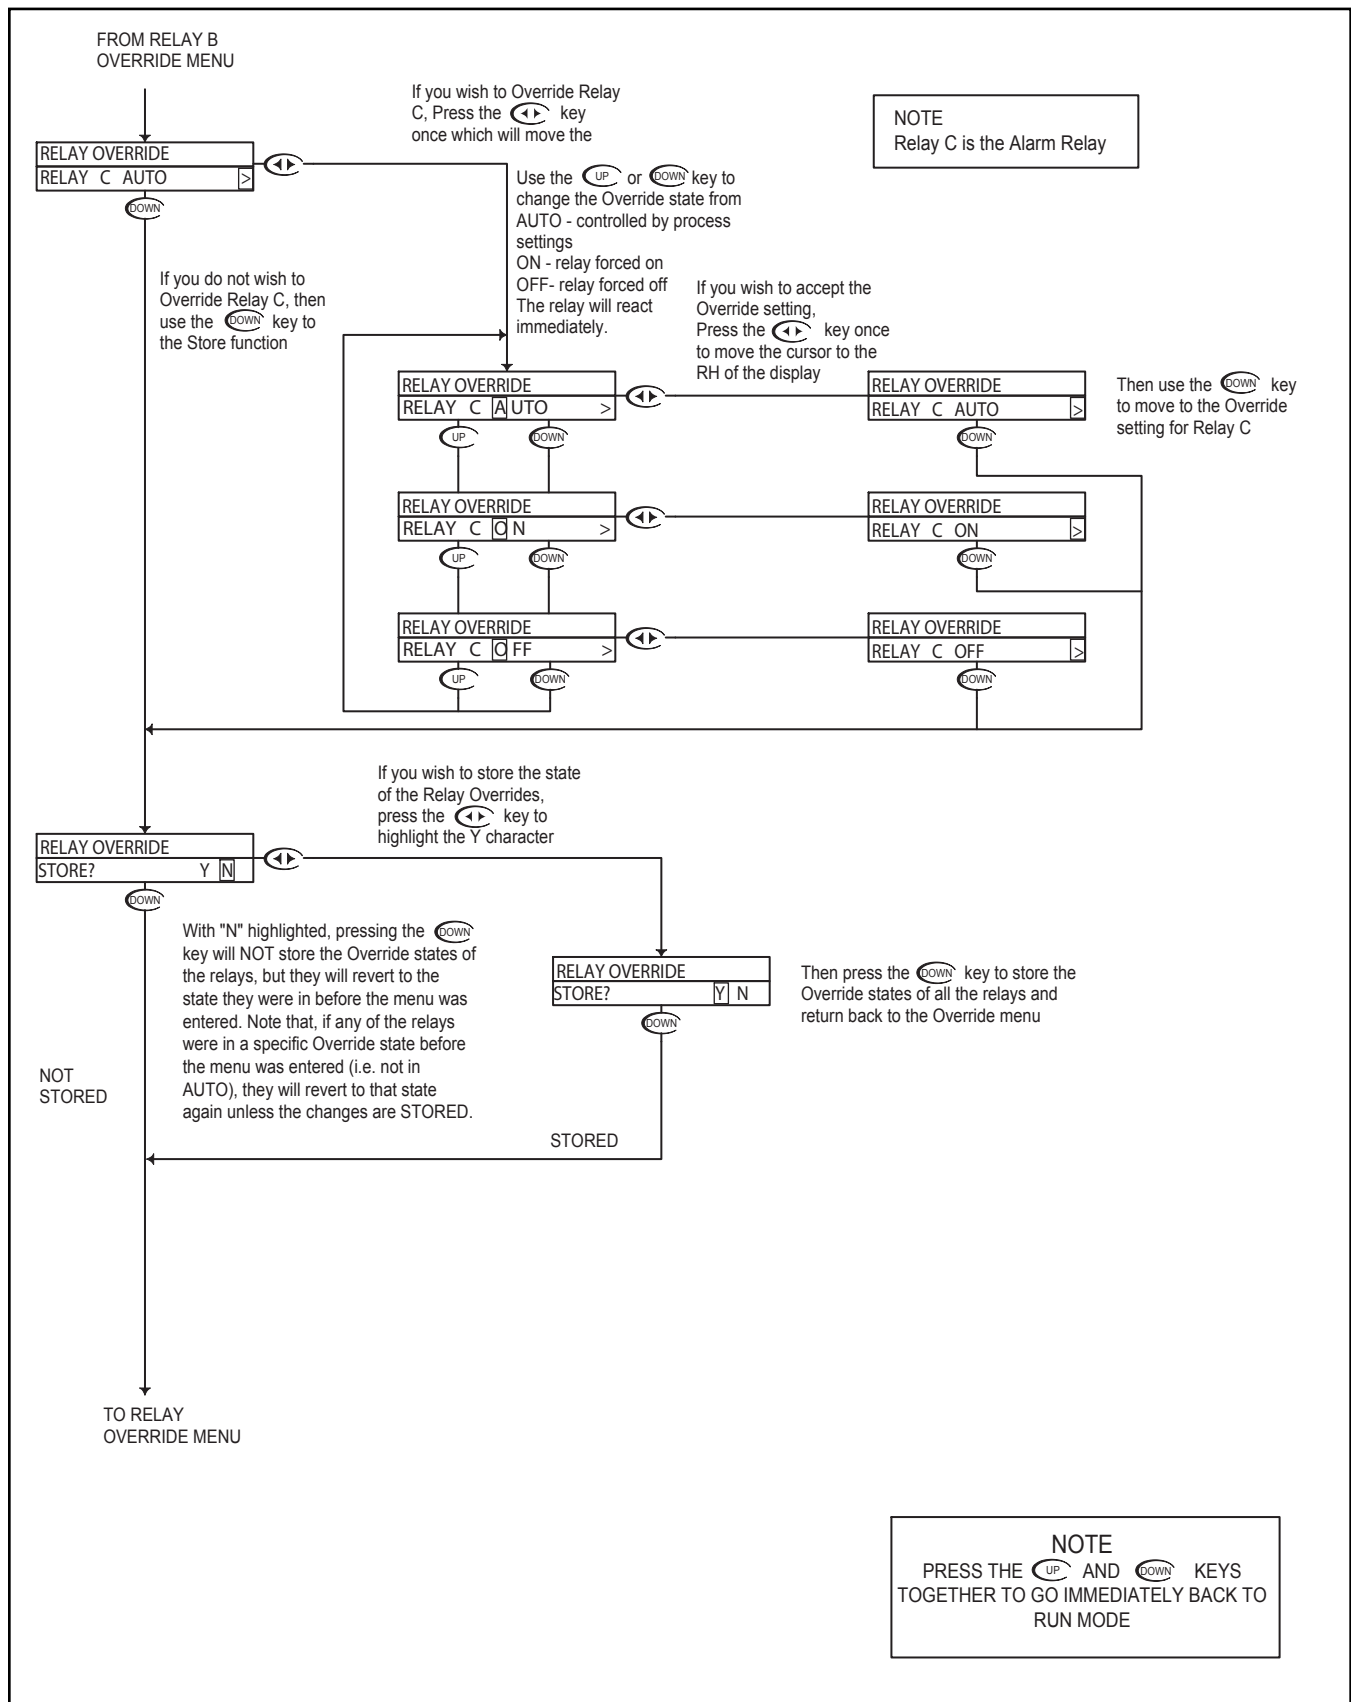

pH - Utilities Menu - Meter Selection 4.6

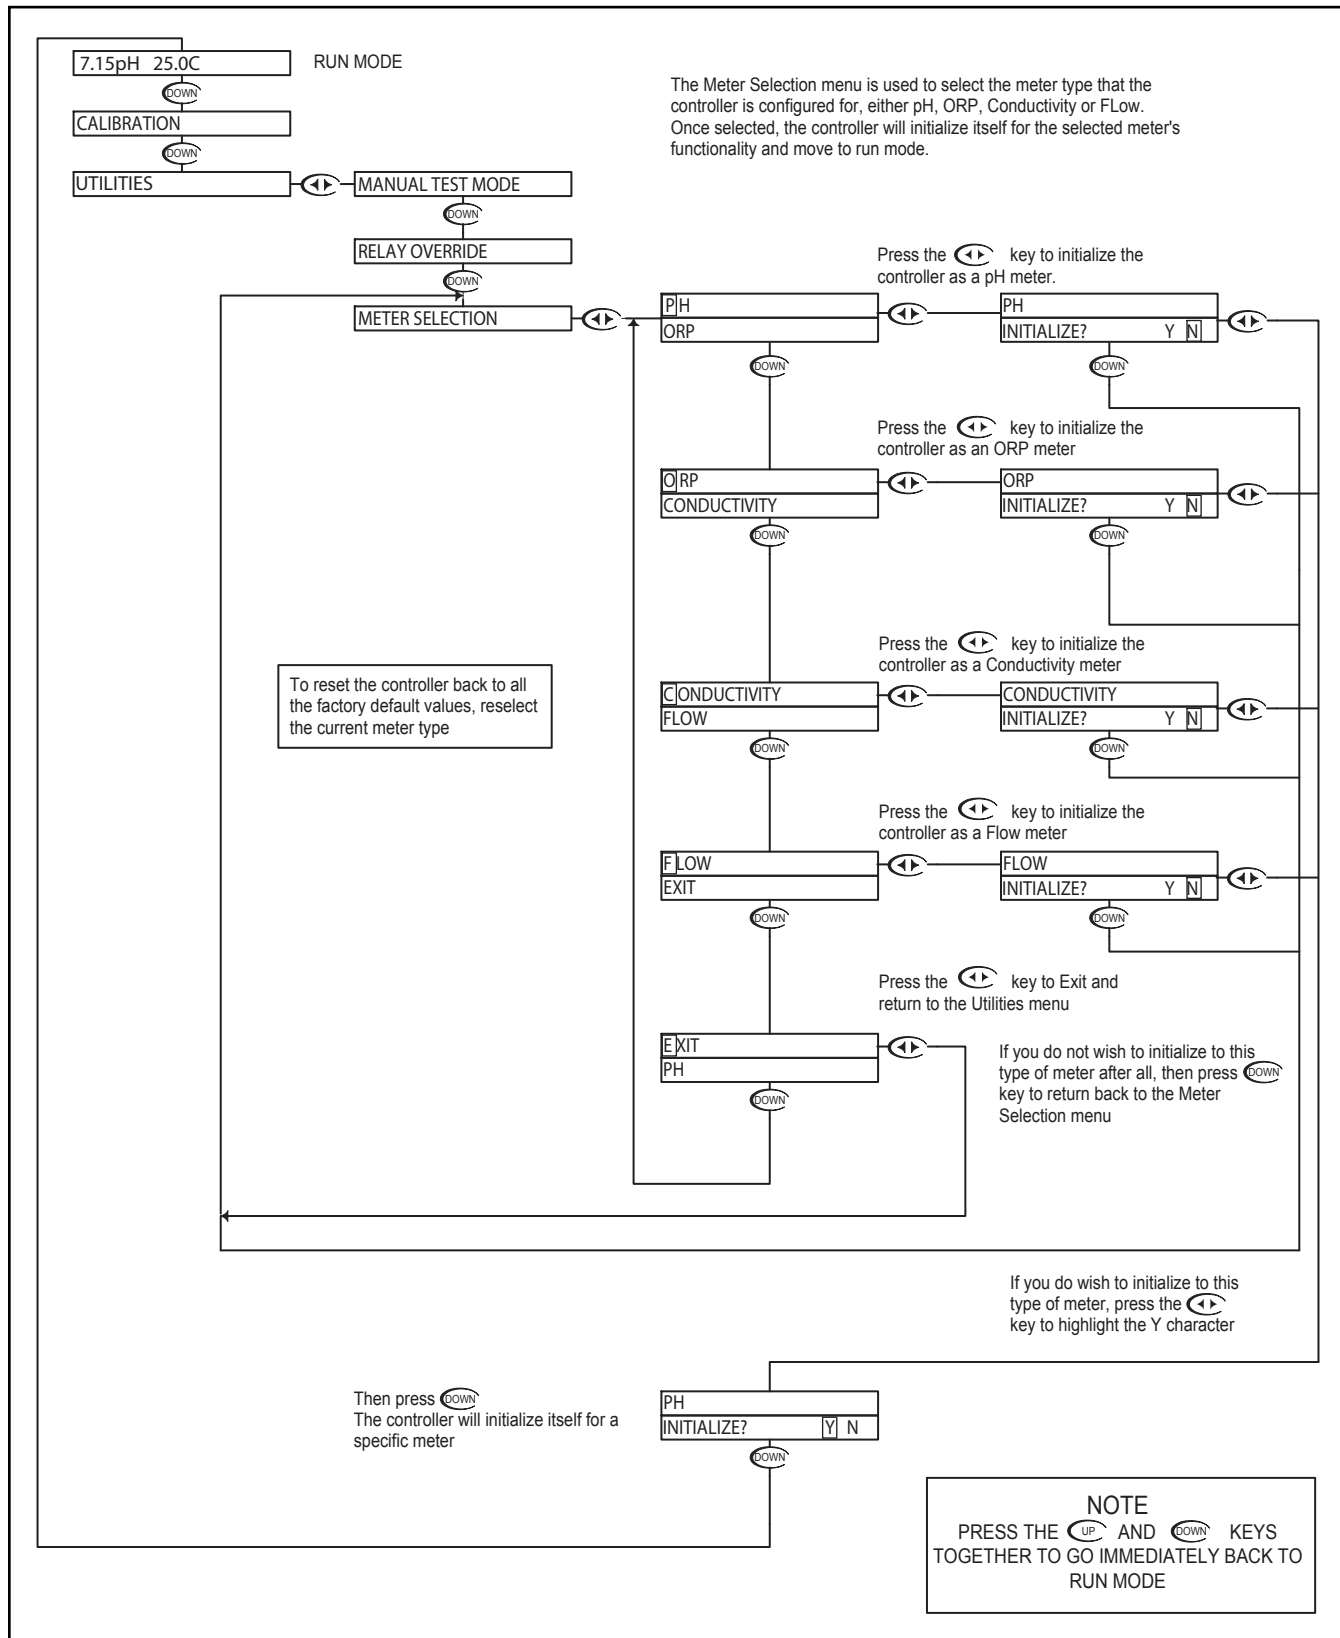



pH - Utilities Menu - Overfeed Timer Reset 4.7

7.15pH 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

LEFT/RIGHT

MANUAL TEST MODE

DOWN

RELAY OVERRIDE

DOWN

METER SELECTION

DOWN

RESET OVERFD TMR

If the control relay overfeed timer has been enabled, the relay will "time out" after the specified overfeed time. When the relay times out, it must be manually reset. The time out will be signaled by the time out LED flashing on the front panel.

The reset overfeed timer will reset the timers for both relay A & relay B at the same time.

Press the key to choose between Y or N.

RESET OVERFD TMR

Y N

LEFT/RIGHT

RESET OVERFD TMR

Y N


If you wish to reset the overfeed timer, then press the key to proceed and return back to the Utilities menu.

If you do not wish to reset the overfeed timer after all, press the key to highlight the N character and press the key to return back to the Utilities menu.

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




pH - Setup Menu - Probe Select 4.8

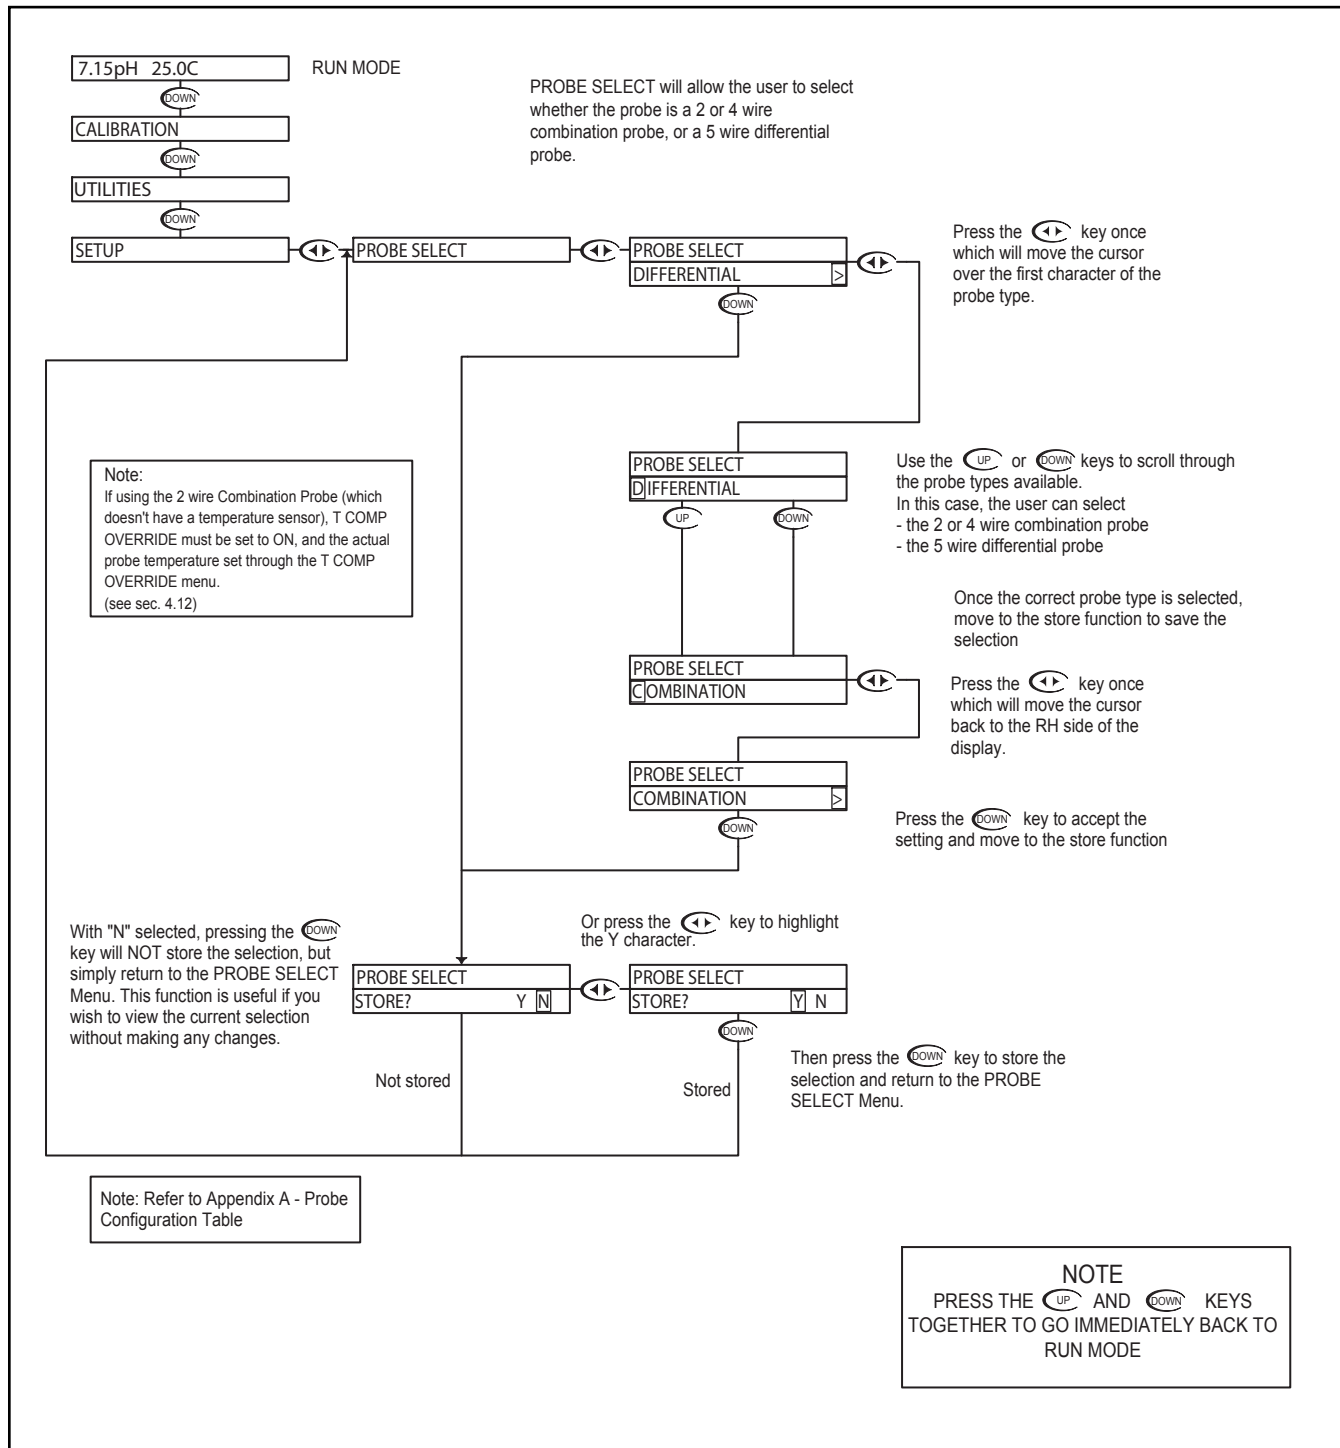



pH - Setup Menu -Temp Unit 4.9

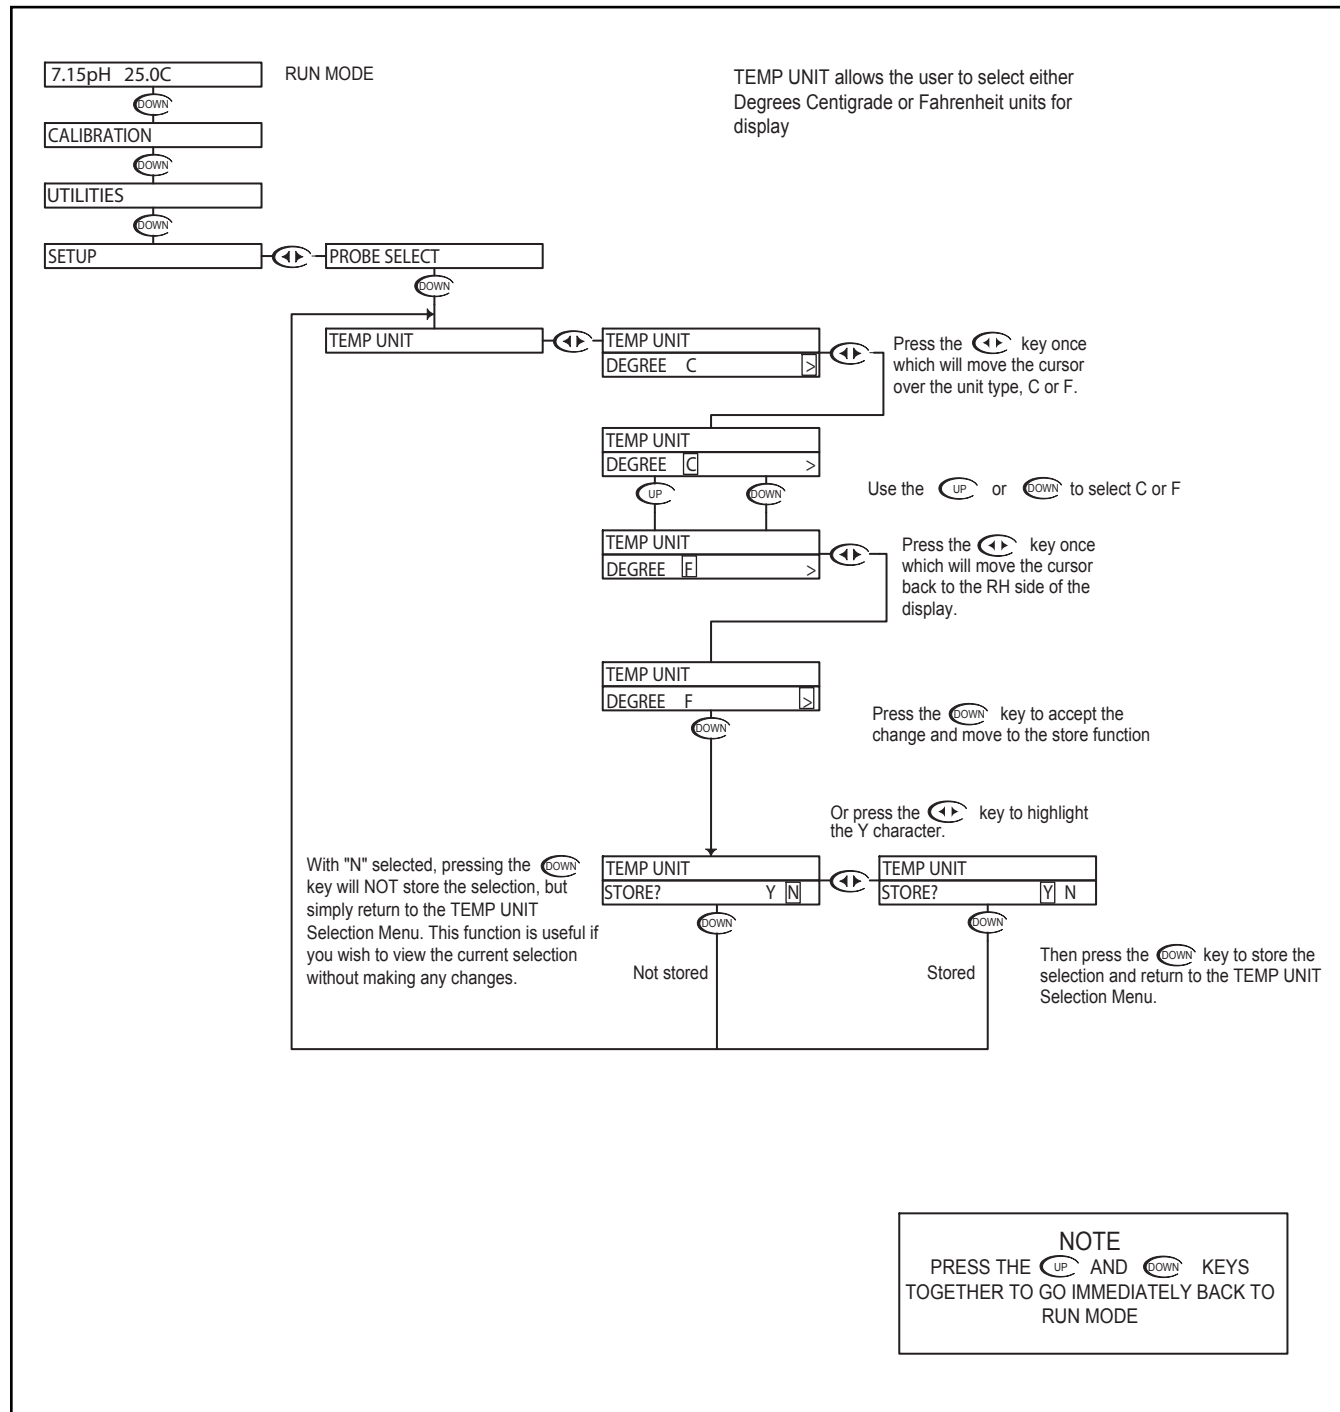



pH - Setup Menu - Temp. Sensor 4.10

7.15pH 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

RUN MODE

LEFT

PROBE SELECT

DOWN

TEMP UNIT

TEMP SENSOR

TEMP SENSOR

300 Ω NTC

Press the **RIGHT** key once which will move the cursor over to the sensor type.

Use the **UP** or **DOWN** to select the sensor type

TEMP SENSOR

300 Ω NTC

UP

DOWN

Once the correct Sensor has been selected press the **RIGHT** key once which will move the cursor back to the RH side of the display.

TEMP SENSOR

1000 Ω RTD

UP

DOWN

TEMP SENSOR

3000 Ω NTC

Press the **DOWN** key to accept the change and move to the store function

TEMP SENSOR

300 Ω NTC

DOWN

Or press the **RIGHT** key to highlight the Y character.

TEMP SENSOR

STORE? Y N

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the TEMP SENSOR Selection Menu. This function is useful if you wish to view the current selection without making any changes.

Not stored

TEMP SENSOR

STORE? Y N

DOWN

DOWN

Then press the **DOWN** key to store the selection and return to the TEMP SENSOR Selection Menu.


Stored

NOTE

PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




pH - Setup Menu - Auto Return 4.11

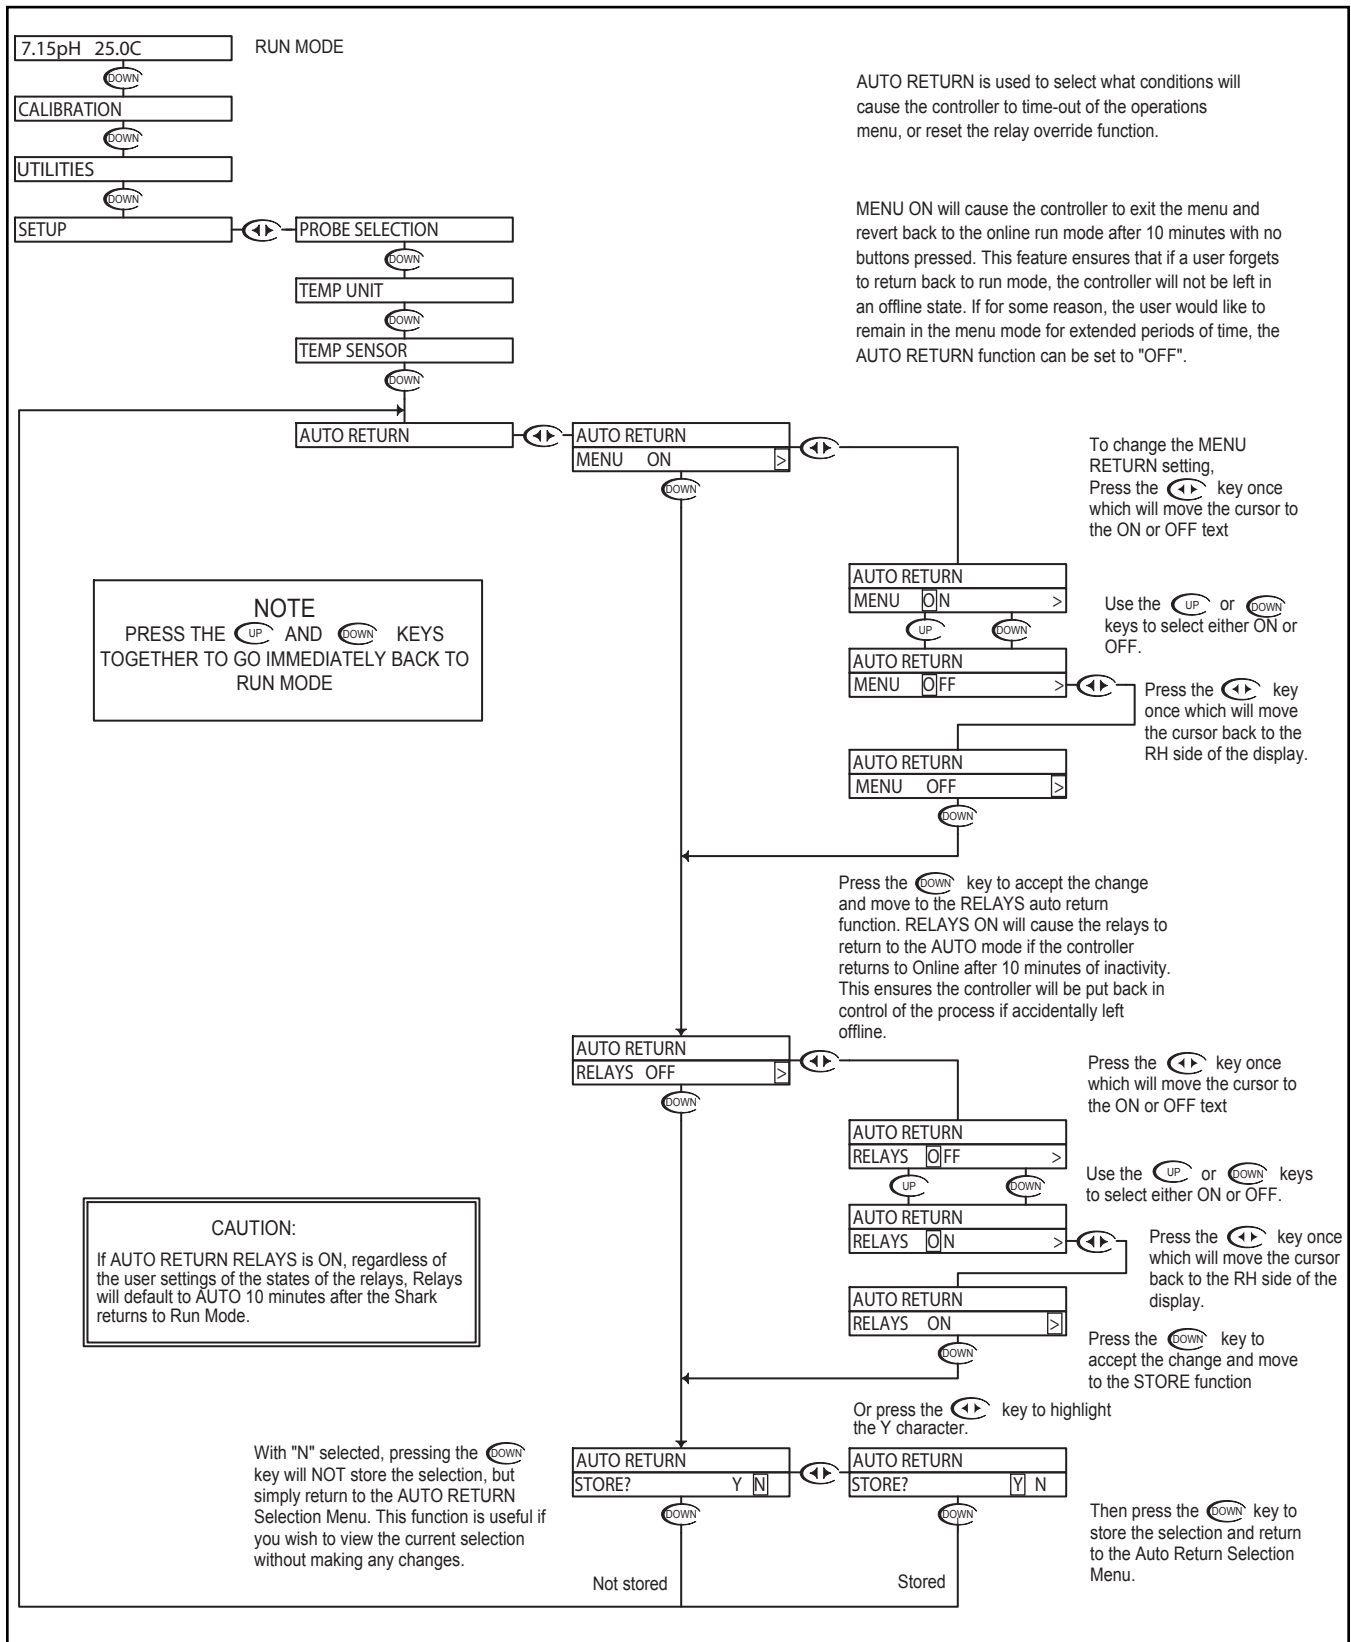




pH - Setup Menu - T.Comp Override 4.12

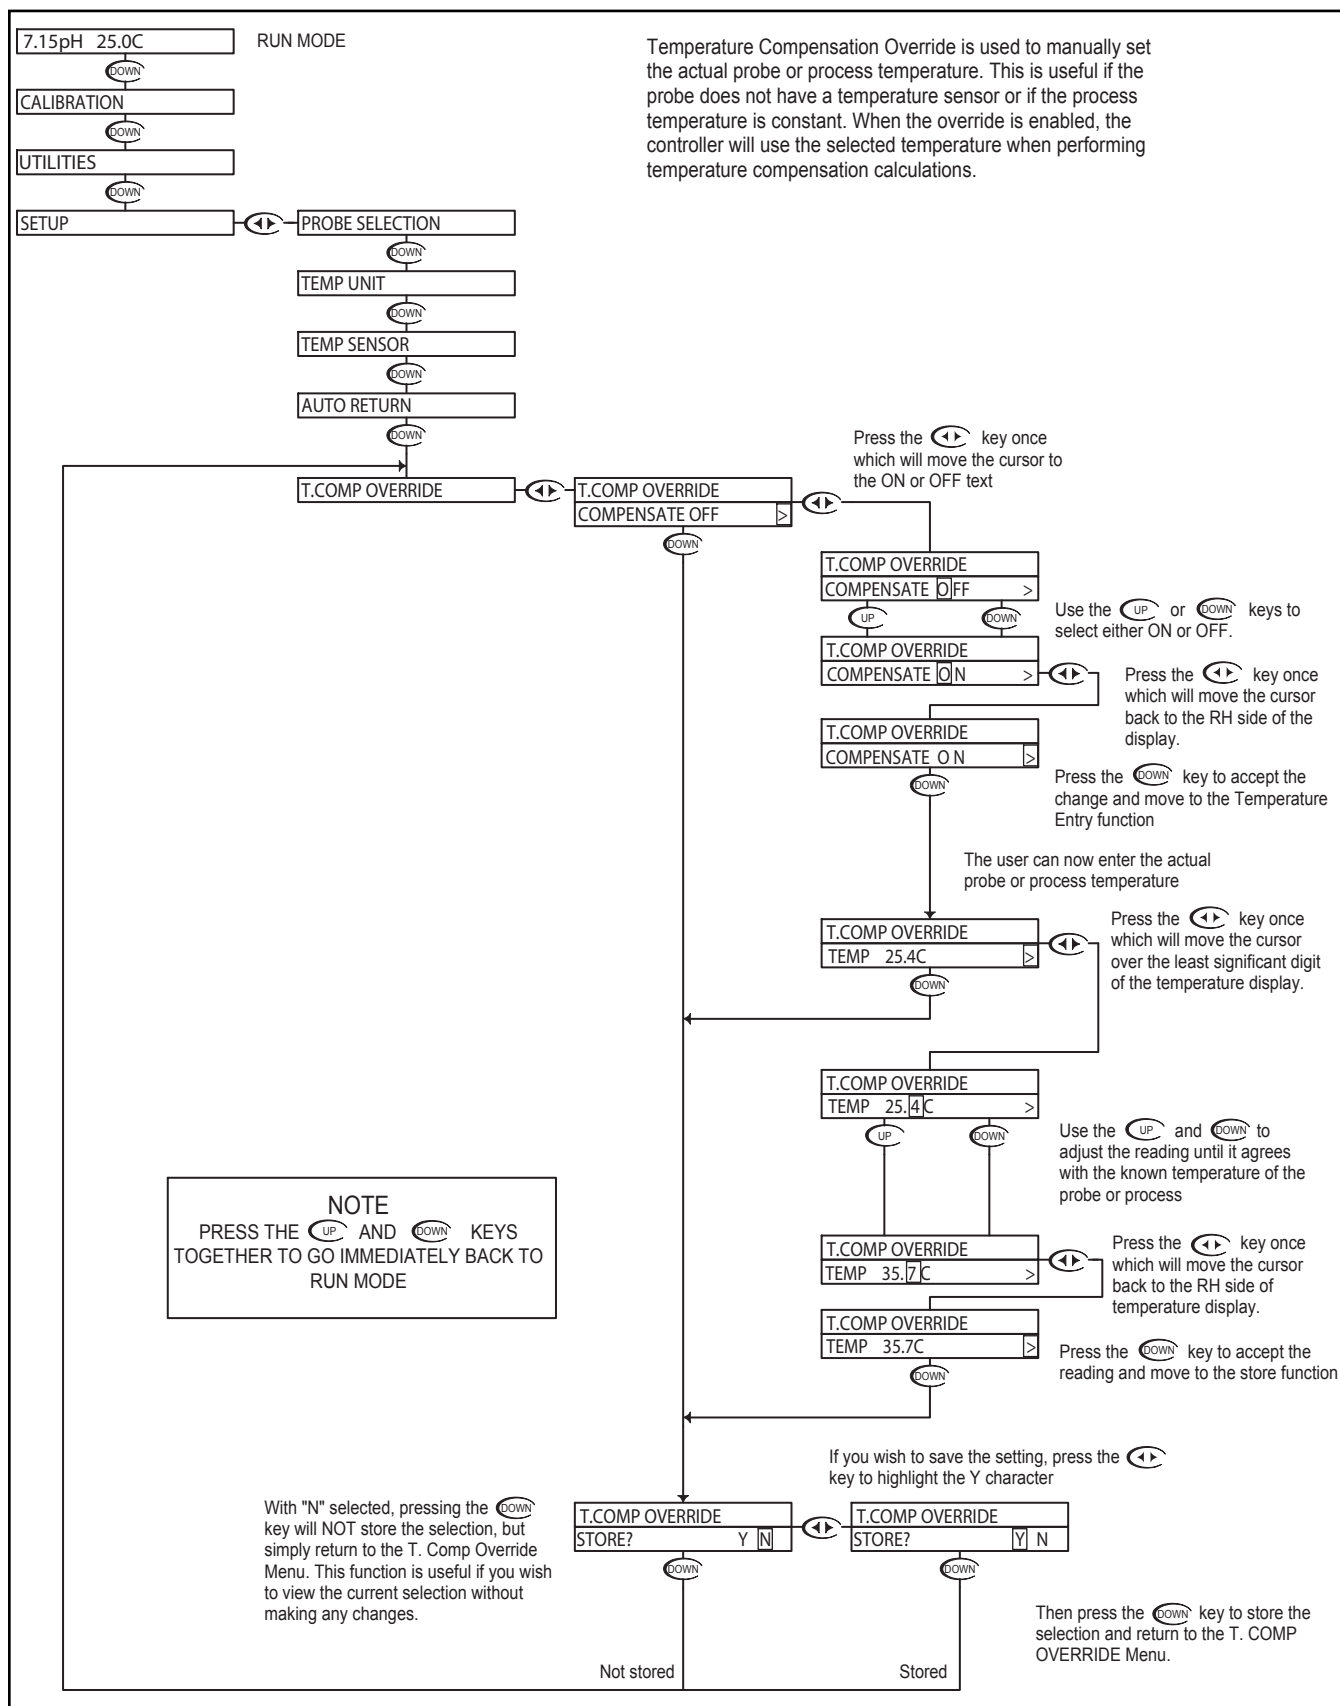




pH - Setup Menu - Display Damping 4.13

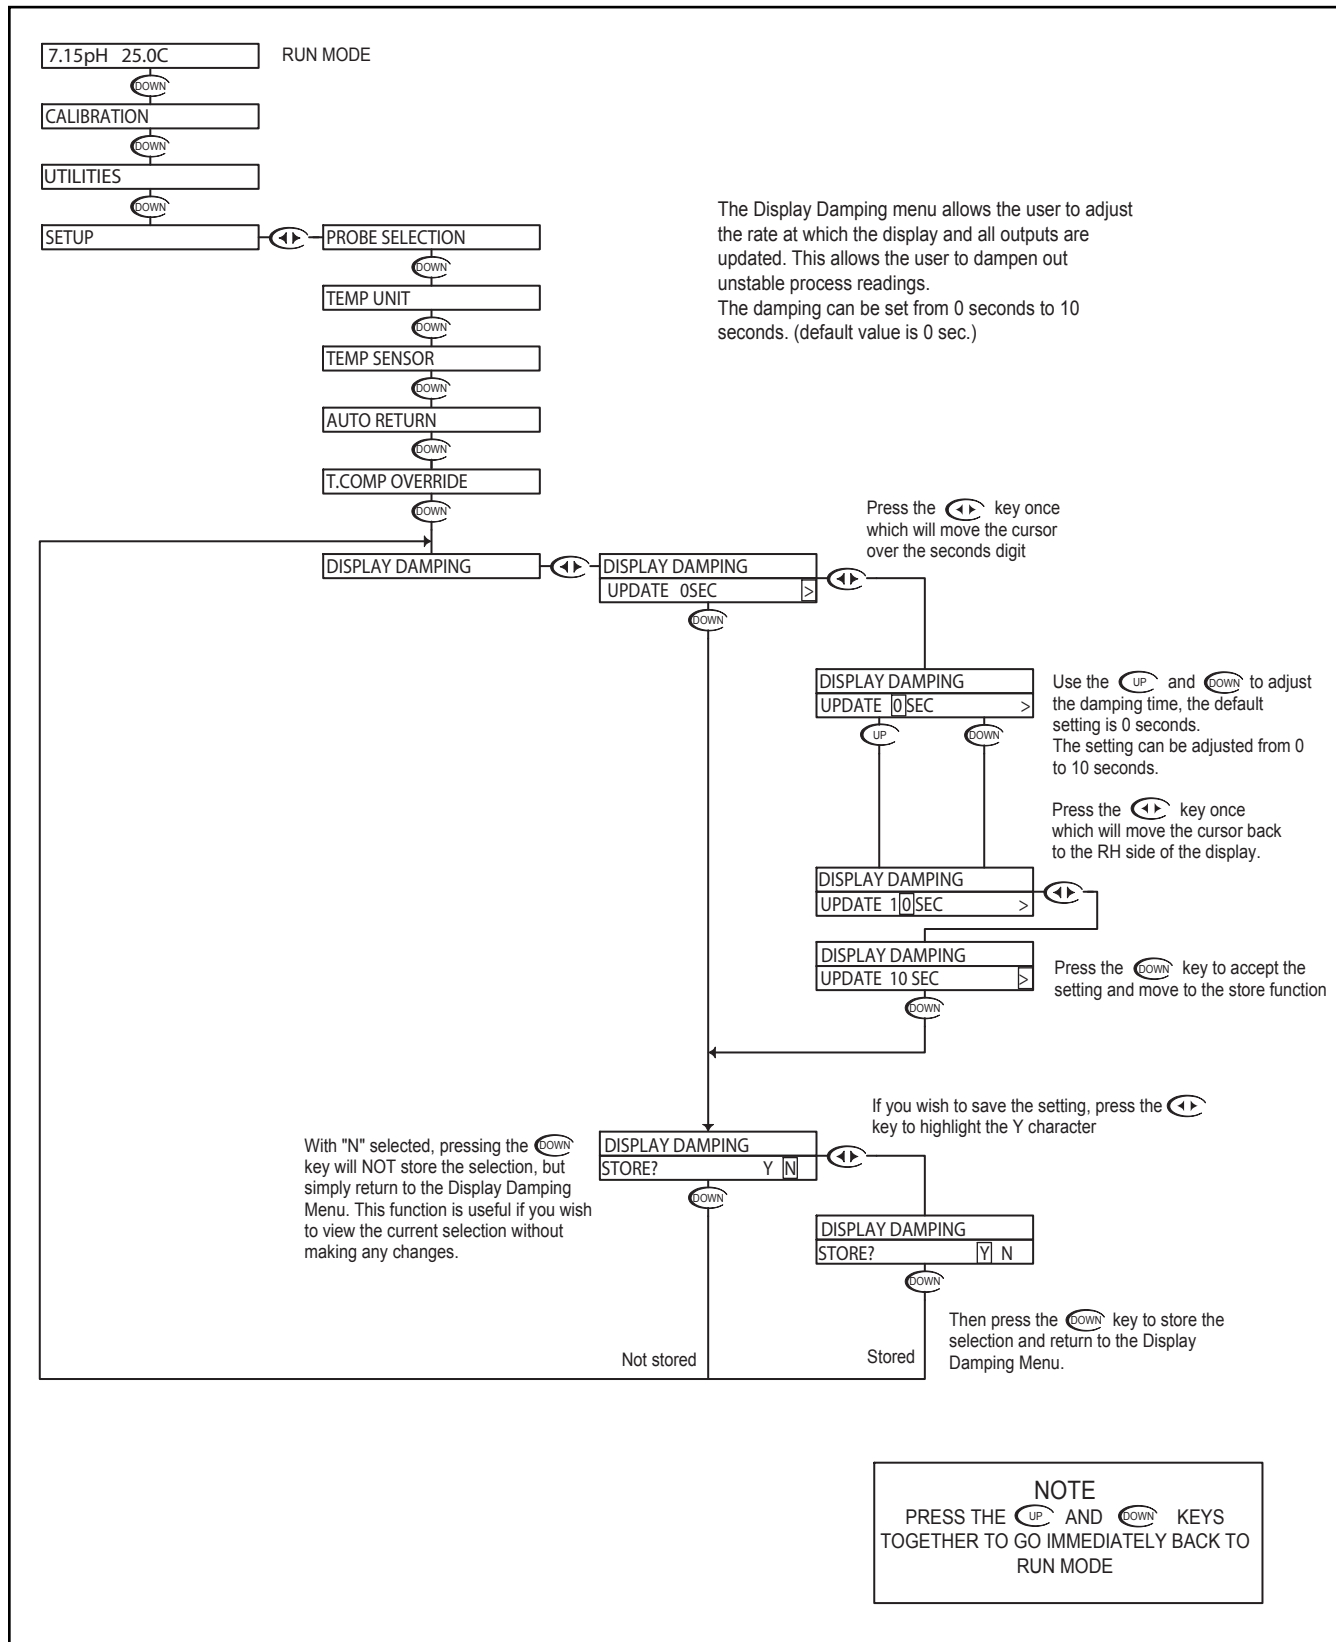




pH - Setup Menu - Bar Graph O/R 4.14

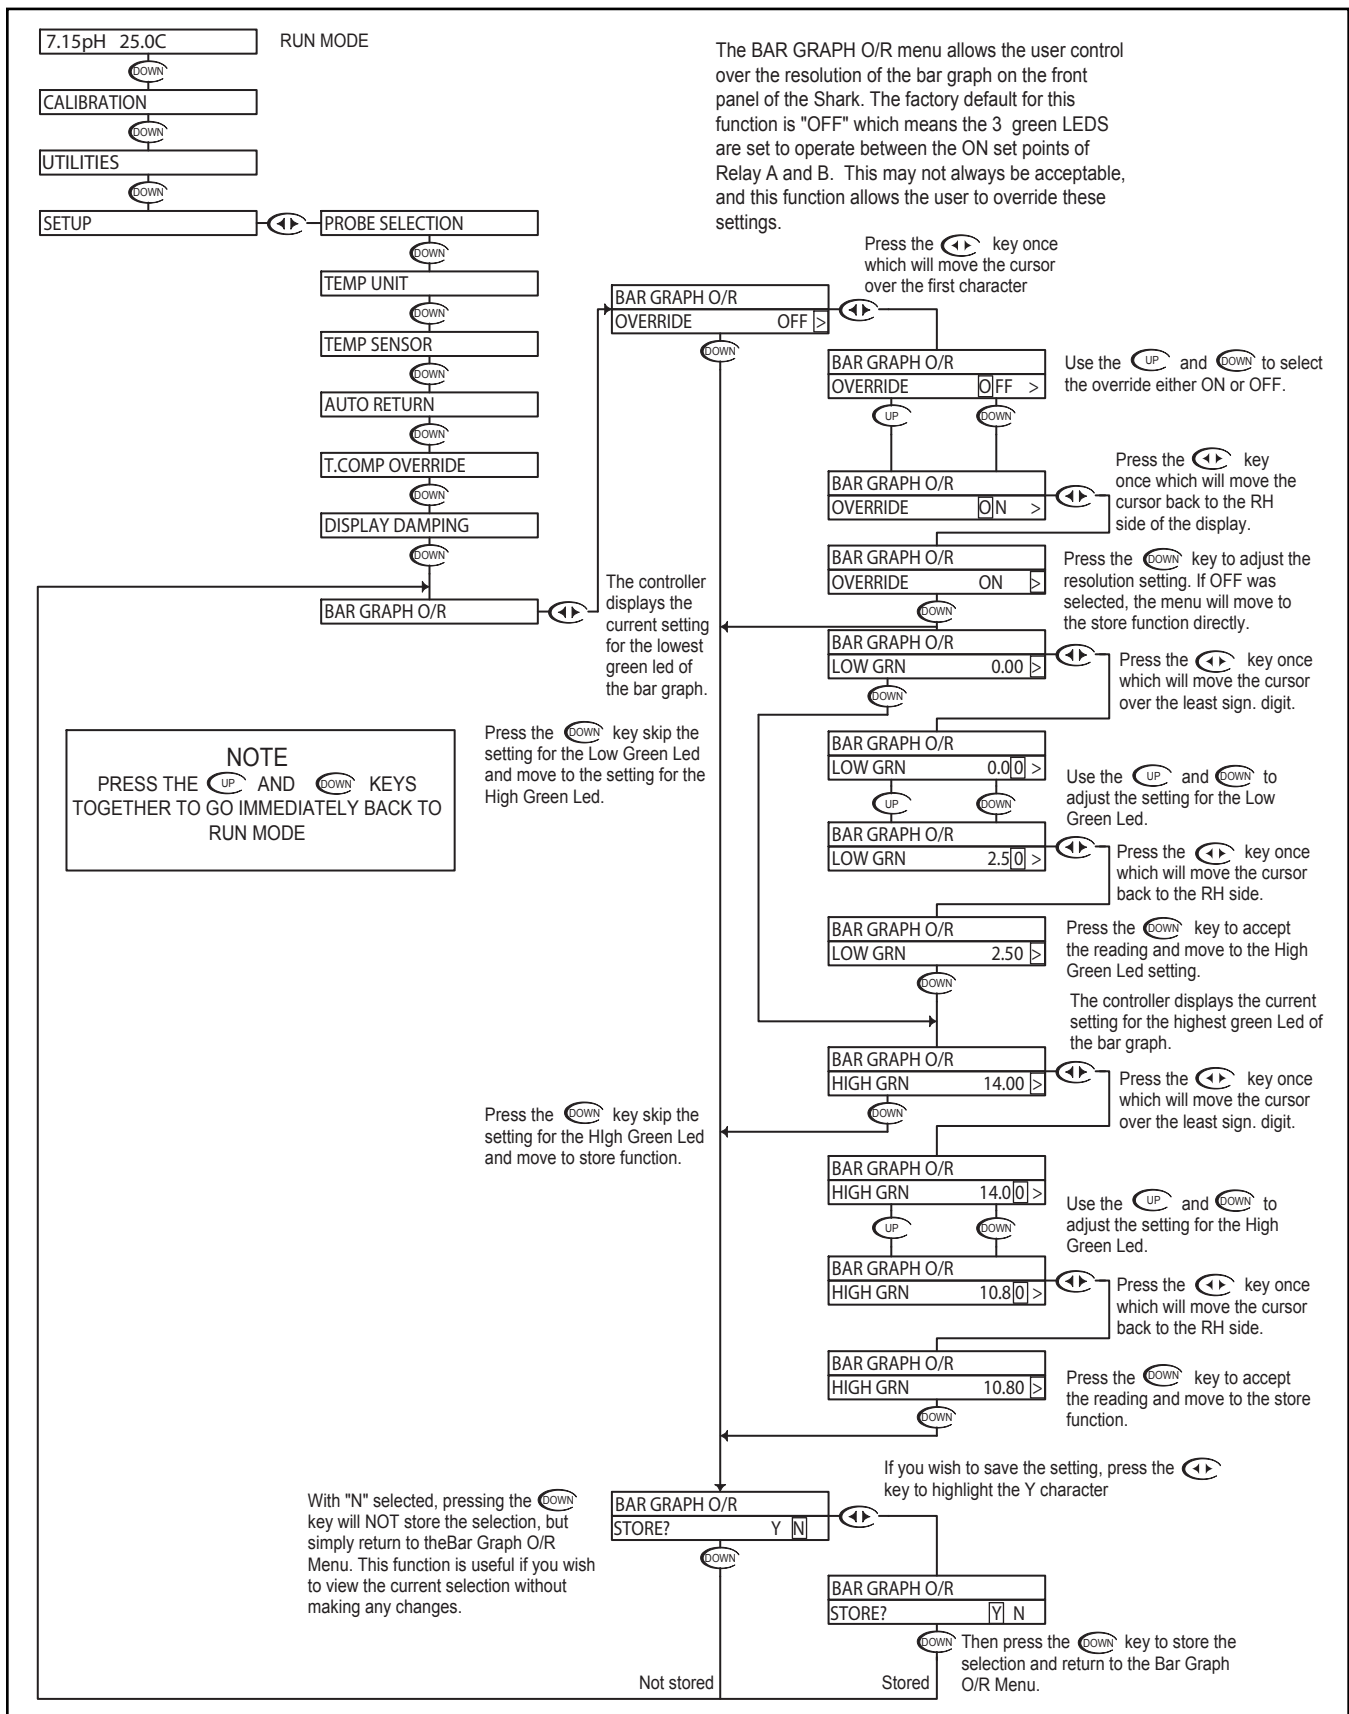



pH - Diagnostics Menu - Firmware Rev 4.15

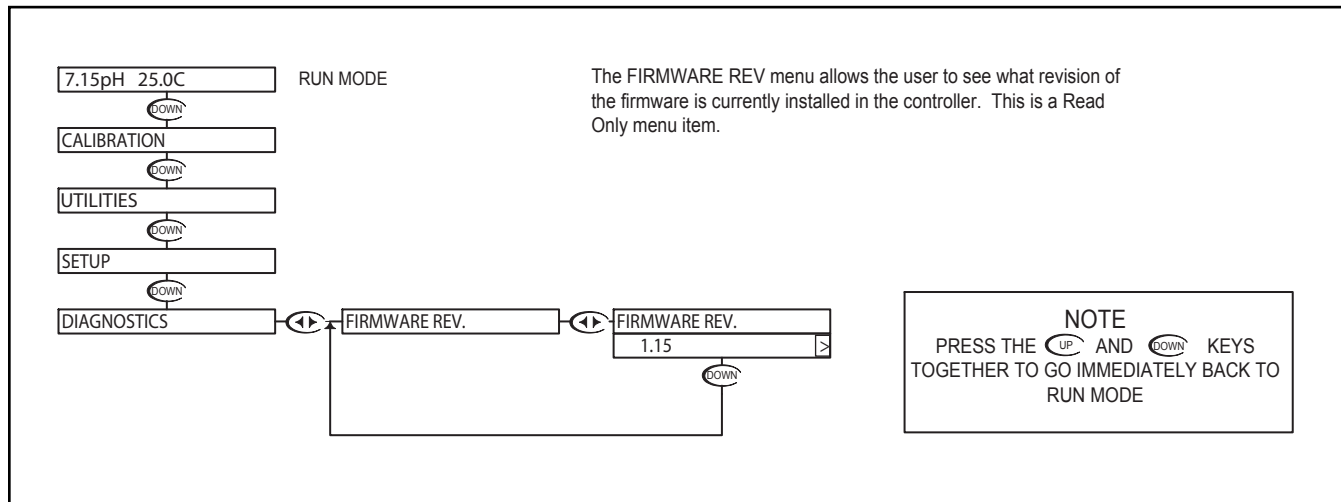



pH - Diagnostics Menu - Calibration Data 4.16

7.15pH 25.0C RUN MODE

DOWN
CALIBRATION

DOWN
UTILITIES

DOWN
SETUP

DOWN
DIAGNOSTICS

LEFT RIGHT FIRMWARE REV.

DOWN
CALIBRATION DATA

The Calibration Data menu is a series of read only screens which allow the user to view the data collected during the last calibration.

Press LEFT RIGHT to view the first Calibration Data screen.

LEFT RIGHT CALIBRATION DATA
MODE 2PT

Calibration Mode
2 point calibration

Press DOWN to view the next Calibration Data screen.

DOWN
CALIBRATION DATA
1P 7.00/ -19

1st POINT PH = 7.00
INPUT FROM PROBE = - 19 mV

DOWN
CALIBRATION DATA
2P 4.00/ 143

2nd POINT PH = 4.00
INPUT FROM PROBE = + 143 mV

DOWN
CALIBRATION DATA
CAL TEMP 19.4C

Probe Temperature at which
calibration was performed = 19.4°C

DOWN
CAL SLOPE
59.16MV/PH

Calculated slope based on 2
point calibration = 59.16 mV/pH


DOWN
CAL EFFICIENCY
EFF 91%

Calculated efficiency based on 2
point calibration = 91 %

NOTE
PRESS THE UP AND DOWN KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



pH - Diagnostics Menu - Sensor Input 4.17

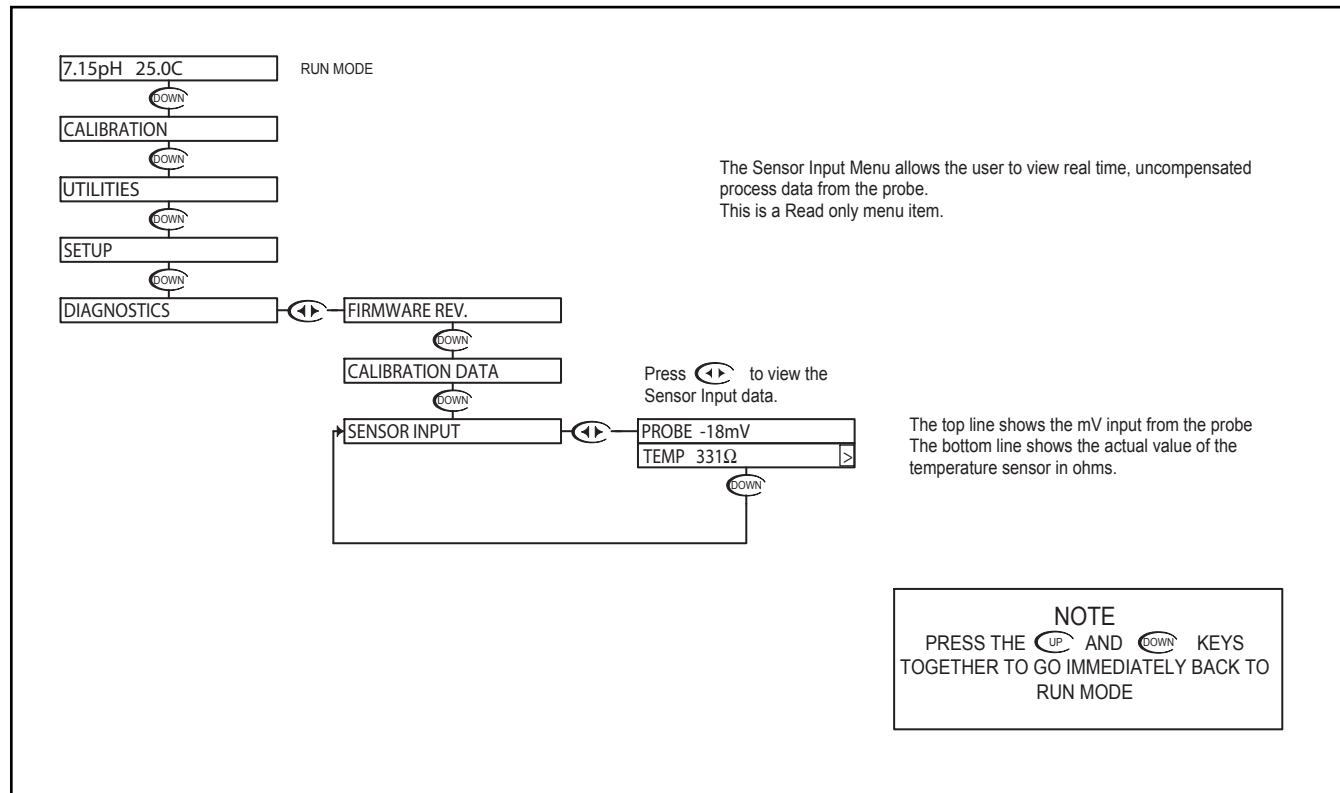

Troubleshooting a pH probe using the sensor input

Sensor input displays the uncompensated sensor input data. The pH probe values are displayed in mV (millivolts). The temperature sensor value is displayed in Ω (ohm).

Connect the pH probe as per Probe Configuration Table in Appendix A.

1. Place the probe in buffer 7pH (allow temperature to stabilize)
 - Probe should read 0mV [± 50 mV]
 - Temperature should read 300 Ω [$\pm 50\Omega$] @ 25°C
 - Record both of these numbers.
2. Place the probe in buffer 4pH
 - Probe should read +160mV more than probe value at 7pH
 - Temperature should read the same as in 7pH
3. Place the probe in buffer 10pH
 - Probe should read -160mV less than probe value at 7pH
 - Temperature should read the same as in 7pH



pH - Outputs Menu - Relay A 4.18

7.15pH 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

DOWN

OUTPUTS

RELAY A

Relay A can be configured for the following operations

- Response to rising or falling process values
- Adjustable on and off set-points
- Cycle on and off times
- Failsafe operation

The relay can be set to control either a RISING or FALLING process.

In a FALLING process, the control relay will energize when the process falls below a set value. In this case, the ON set-point must be set lower than the OFF set-point.

In a RISING process, the control relay will energize when the process rises above a set value. In this case, the ON set-point must be set higher than the OFF set-point.

The RELAY ON setting is the process value at which the relay will energize. It may be set anywhere between 0-100% of the range.

The RELAY OFF setting is the process value at which the relay will de-energize. The setting must be rationalized against the On setting. For example, in a falling process, the Off setting must be higher than the On setting.

The controller will not allow you to select the RELAY OFF value on the wrong side of the RELAY ON value for the selected direction. If the user tries to set the RELAY OFF on the wrong side, the following errors will be displayed:

FALLING PROCESS
ON SPT < OFF SPT

Error when trying to set OFF point lower than ON point when set to falling.

RISING PROCESS
ON SPT > OFF SPT

Error when trying to set OFF point higher than ON point when set to rising.

RELAY A
DIRECTION FALL

DOWN

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY A
DIRECTION FALL

UP DOWN

RELAY A
DIRECTION RISE

UP DOWN

RELAY A
DIRECTION FALL

UP DOWN

RELAY A
DIRECTION FALL

DOWN

Use the and keys to change the setting

Press the key once which will move the cursor back to the RH side of the display.

Press the key to accept the setting and move to the next setting

RELAY A
RELAY ON 4.20

DOWN

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY A
RELAY ON 4.20

UP DOWN

RELAY A
RELAY ON 4.00

UP DOWN

RELAY A
RELAY ON 4.00

DOWN

Use the and keys to change the setting

Press the key once which will move the cursor back to the RH side of the display.

Press the key to accept the setting and move to the next setting

RELAY A
RELAY OFF 5.60

DOWN

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY A
RELAY OFF 5.60

UP DOWN

RELAY A
RELAY OFF 4.50

UP DOWN

RELAY A
RELAY OFF 4.50

DOWN

Use the and keys to change the setting

Press the key once which will move the cursor back to the RH side of the display.

NOTE
PRESS THE AND KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE

TO CYCLE ON



pH - Outputs Menu - Relay A 4.18

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds. The default ON time is 5 seconds.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0.

The Default OFF time is 0 seconds.

The OVERFEED TIMER is designed to help safeguard against a process or instrumentation error causing one of the control relays to remain energized for extended periods of time.

When enabled, the user must select the desired overfeed timeout time (1-999 min.)

If the overfeed timer times out:

- Alarm relay will energize.
- Control (A&B) will de-energize
- LED on front will flash

Must be reset via Utilities Menu or Power reset.


The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.


When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption.

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

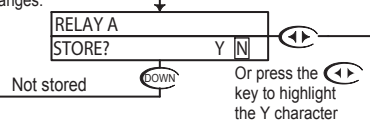


TO OUTPUTS MENU

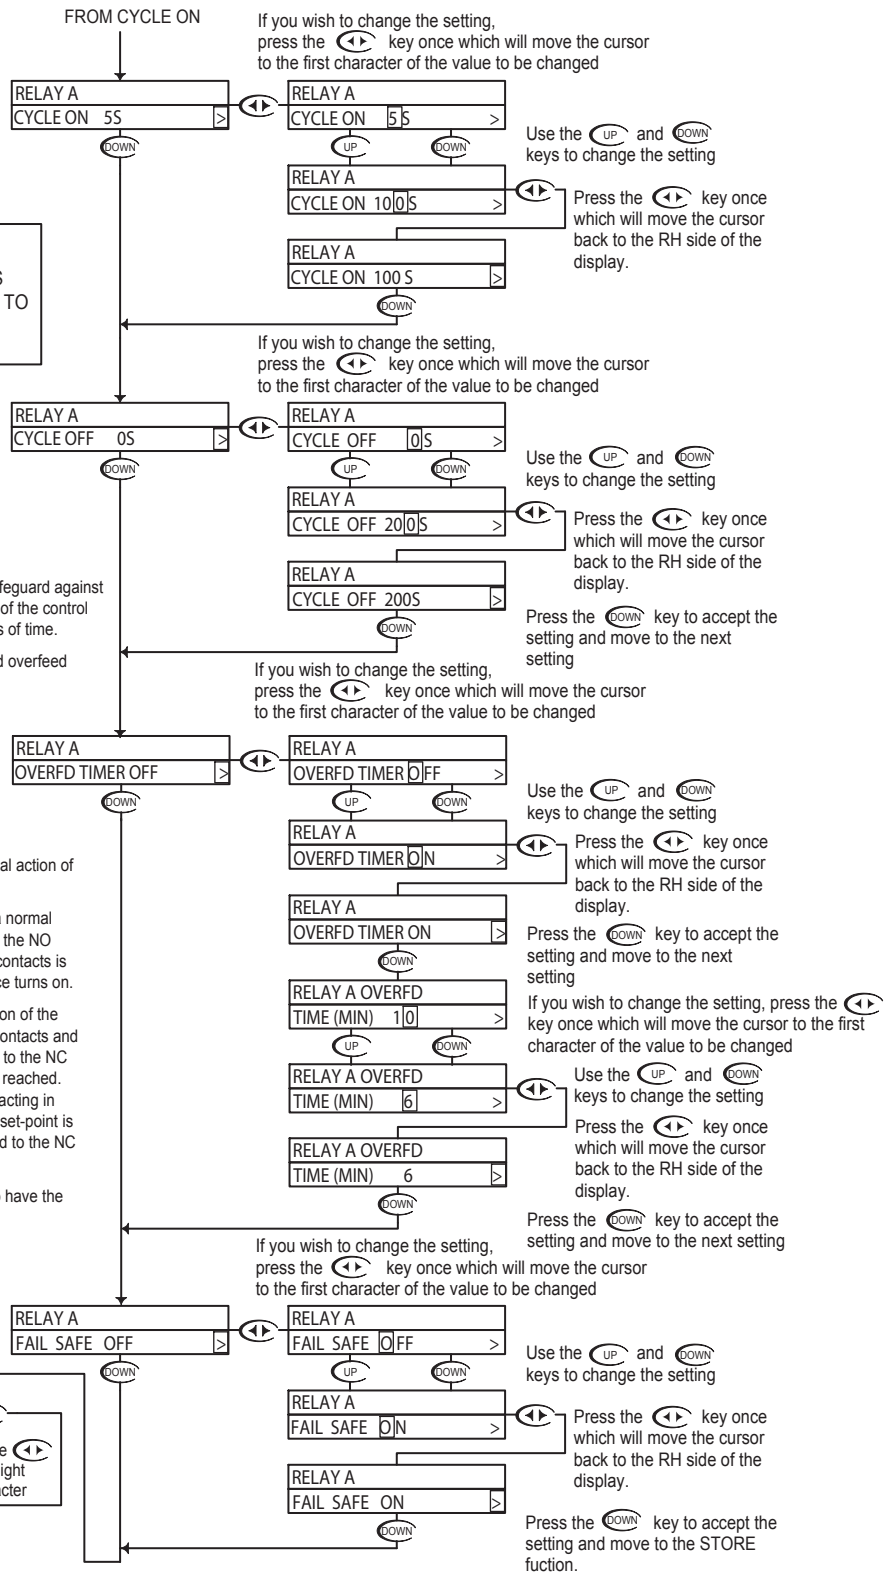



pH - Outputs Menu - Relay B 4.19

7.15pH 25.0C RUN MODE

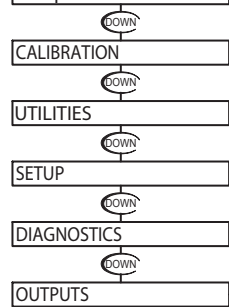

RELAY A

RELAY B

Relay B can be configured for the following operations

- Response to rising or falling process values
- Adjustable on and off set-points
- Cycle on and off times
- Failsafe operation

Each function will be explained below

The relay can be set to control either a RISING or FALLING process.

In a RISING process, the control relay will energize when the process rises above a set value. In this case, the ON set-point must be set higher than the OFF set-point.

In a FALLING process, the control relay will energize when the process falls below a set value. In this case, the ON set-point must be set lower than the OFF set-point.

The RELAY ON setting is the process value at which the relay will energize. It may be set anywhere between 0-100% of the range.

The RELAY OFF setting is the process value at which the relay will de-energize. The setting must be rationalized against the On setting. For example, in a falling process, the Off setting must be higher than the ON setting.

The controller will not allow you to select the RELAY OFF value on the wrong side of the RELAY ON value for the selected direction. If the user tries to set the RELAY OFF on the wrong side, the following errors will be displayed:

FALLING PROCESS
ON SPT < OFF SPT

Error when trying to set OFF point lower than ON point when set to falling.

RISING PROCESS
ON SPT > OFF SPT

Error when trying to set OFF point higher than ON point when set to rising.

RELAY B
DIRECTION RISE

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY B
DIRECTION RISE

UP DOWN

Use the and keys to change the setting

RELAY B
DIRECTION FALL

UP DOWN

RELAY B
DIRECTION RISE

Press the key once which will move the cursor back to the RH side of the display.

RELAY B
DIRECTION RISE

DOWN

Press the key to accept the setting and move to the next setting

RELAY B
RELAY ON 9.80

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY B
RELAY ON 9.80

UP DOWN

Use the and keys to change the setting

RELAY B
RELAY ON 10.00

UP DOWN

Press the key once which will move the cursor back to the RH side of the display.

RELAY B
RELAY ON 10.00

DOWN

Press the key to accept the setting and move to the next setting

RELAY B
RELAY OFF 8.40

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY B
RELAY OFF 8.40

UP DOWN

Use the and keys to change the setting

RELAY B
RELAY OFF 9.50

UP DOWN

Press the key once which will move the cursor back to the RH side of the display.

RELAY B
RELAY OFF 9.50

DOWN

TO CYCLE ON

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



pH - Outputs Menu - Relay B 4.19

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds. The default ON time is 5 seconds.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0.

The Default OFF time is 0 seconds.

The OVERFEED TIMER is designed to help safeguard against a process or instrumentation error causing one of the control relays to remain energized for extended periods of time.

When enabled, the user must select the desired overfeed timeout time (1-999 min.)

If the overfeed timer times out:

- Alarm relay will energize.
- Control (A&B) will de-energize
- LED on front will flash

Must be reset via Utilities Menu or Power reset.



The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption. For example, a process that needs a constant feed, would want a pump to turn on in the event of a controller power failure.



With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

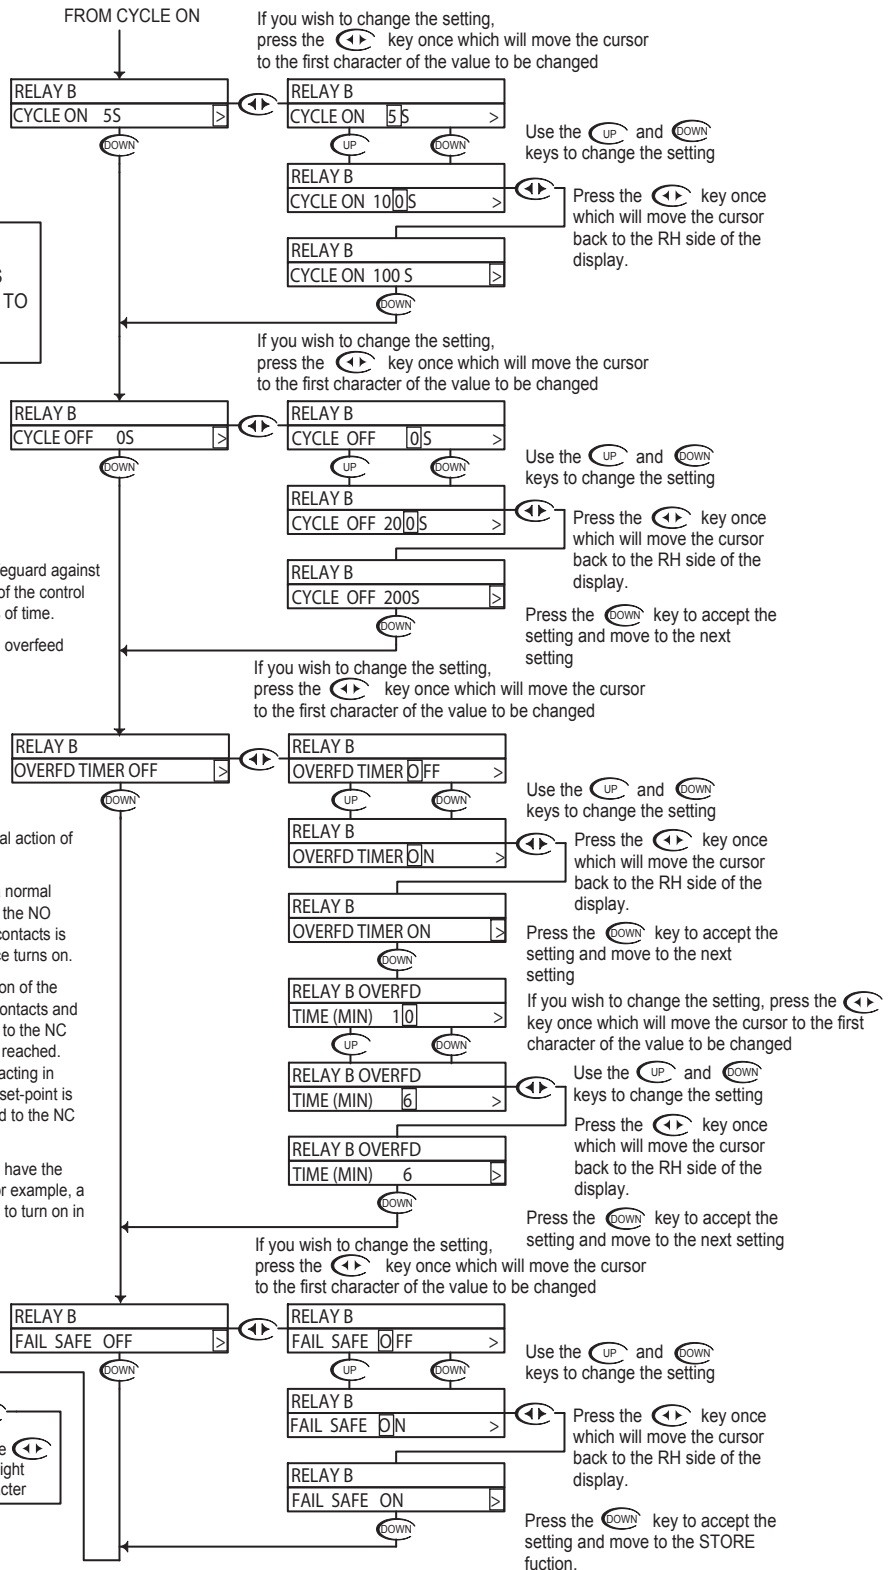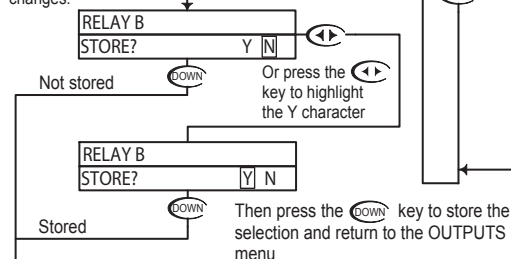



pH - Outputs Menu - Alarm Relay 4.20

7.15pH 25.0C RUN MODE

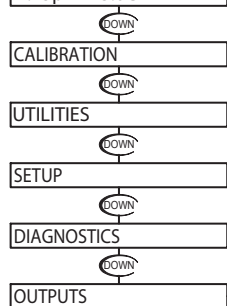


The ALARM RELAY will respond to both a rising and falling process. The ALARM RELAY will act as a low alarm (falling process) and a high alarm (rising process). Both relay bands will have independently adjustable on and off set-points. If a low alarm set-point is set at a value 3.00pH for example, the off set-point must be set higher. The controller will not let the user input a value below 3.00pH. The same rule holds true for the high alarm.

The Alarm Relay can be configured for the following operations

- LOW ON Set-point
- LOW OFF Set-point
- HIGH ON Set-point
- HIGH OFF Set-point
- Failsafe


The LOW ON set point is the low process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.




If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed



Use the and keys to change the setting




Press the key once which will move the cursor back to the RH side of the display.




Press the key to accept the setting and move to the next setting


The LOW OFF set point is the value that the process must reach in order to de-energize the alarm relay after it has dropped below and tripped the LOW ON set-point. This value must be higher than the LOW ON Set-point.




If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed



Use the and keys to change the setting




Press the key once which will move the cursor back to the RH side of the display.




Press the key to accept the setting and move to the next setting


The HIGH ON set-point is the high process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.




If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed



Use the and keys to change the setting



Press the key once which will move the cursor back to the RH side of the display.



TO HIGH OFF

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



pH - Outputs Menu - Alarm Relay 4.20

The HIGH OFF set-point is the value that the must reach in order to de-energize the alarm relay after it has increased over and tripped the HIGH ON set-point. This value must be lower than the HIGH ON Set-point.

FROM HIGH ON

ALARM RELAY
HIGH OFF 9.80

If you wish to change the setting, press the **←→** key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
HIGH OFF 9.80

Use the **UP** and **DOWN** keys to change the setting

ALARM RELAY
HIGH OFF 12.00

Press the **←→** key once which will move the cursor back to the RH side of the display.

ALARM RELAY
HIGH OFF 12.00

If you wish to change the setting, press the **←→** key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
FAILSAFE OFF

The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption.

ALARM RELAY
FAIL SAFE OFF

Use the **UP** and **DOWN** keys to change the setting

ALARM RELAY
FAIL SAFE ON

Press the **←→** key once which will move the cursor back to the RH side of the display.

ALARM RELAY
FAIL SAFE ON

Press the **DOWN** key to accept the setting and move to the next setting

If you wish to change the setting, press the **←→** key once which will move the cursor to the first character of the value to be changed

If the Low On set-point is set higher than the factory default Low Off set-point, when the user advances from the low on set-point to the Low Off set-point the shark will adjust the Low Off set-point to be equal to the Low On set-point. If the user then tries to decrease the Low Off set-point the Controller will display the Low Alarm setup error screen.

LOW ALARM
ON SPT < OFF SPT

This screen will be displayed for 10 seconds, then return back to the setup screen that was previously displayed. The same conditions apply to the High alarm set-points. Except the High Off set-point must be lower than the High On set-point. If the user tries to increase the High Off set-point higher than the High On set-point the High Alarm setup error screen will be displayed.

HIGH ALARM
ON SPT > OFF SPT

If the user sets the low on set-point and the low off set-point equal to 0, it will disable the Low Alarm relay. Similarly, setting the High On set-point and the HIGH OFF set-point to 0 will disable the High Alarm.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

Or press the **←→** key to highlight the Y character.

ALARM RELAY
STORE? Y N

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

Not stored
TO OUTPUTS MENU

ALARM RELAY
STORE? Y N

Then press the **DOWN** key to store the selection and return to the OUTPUTS menu



pH - Outputs Menu - 4-20mA CH1 Output 4.21

7.15pH 25.0C RUN MODE

CALIBRATION

UTILITIES

SETUP

DIAGNOSTICS

OUTPUTS

RELAY A

RELAY B

ALARM RELAY

4-20mA CH1

The Controller has 2 4-20mA outputs, electrically isolated from each other and ground. Either output can source current into a maximum of 800 ohms. See Section 3.12 for wiring diagram. Channel 1 (the primary output) is located on the flip out door, terminal plug P6. Channel 1 is dedicated to track the process and has fully independent and fully adjustable 4 & 20 mA output adjustments. This will enable the operator to span the output over the desired range.

The example below shows the 4-20 mA set to 4mA = 7.00pH and 20mA = 14pH. The output would then span 4 to 20 mA for a pH swing of 7.0 to 14.0. Note that the span can be reversed, in that 4 mA can be set to a high pH value, and 20 mA can be set to a low pH value, effectively reversing the control direction.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

The TUNE function allows the user to precisely adjust the 4-20 mA output to compensate for any errors in the output circuitry. Normally, fine tuning the 4-20mA output is not necessary.

To make the adjustment, place an accurate current meter in series with the 4-20 mA output, with the appropriate loads connected. When the TUNE menu is selected, the controller puts 20 mA out the terminals. Use the **UP** or **DOWN** keys to adjust the 20mA output to get exactly 20.

The TUNE value can be adjusted over the range from 0 to 1000, these are unitless numbers used for tuning purposes only.

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

4-20mA CH1 PROC
STORE? Y N

Not stored

Stored

Or press the key to highlight the Y character

4-20mA CH1 PROC
STORE? Y N

Then press the **DOWN** key to store the selection and return to the OUTPUTS menu

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

4-20mA CH1 PROC
4mA OUT 0.00

4-20mA CH1 PROC
4mA OUT 0.00

Use the **UP** and **DOWN** keys to change the setting

4-20mA CH1 PROC
4mA OUT 7.00

Press the **LEFT** key once which will move the cursor back to the RH side of the display.

4-20mA CH1 PROC
4mA OUT 7.00

Press the **DOWN** key to accept the setting and move to the next setting

4-20mA CH1 PROC
20mA OUT 14.00

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

4-20mA CH1 PROC
20mA OUT 14.00

Use the **UP** and **DOWN** keys to change the setting

4-20mA CH1 PROC
20mA OUT 14.00

Press the **LEFT** key once which will move the cursor back to the RH side of the display.

4-20mA CH1 PROC
20mA OUT 14.00

Press the **DOWN** key to accept the setting and move to the next setting

4-20mA CH1 PROC
20mA TUNE 512

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

4-20mA CH1 PROC
20mA TUNE 512

Use the **UP** and **DOWN** keys to change the setting

4-20mA CH1 PROC
20mA TUNE 512





Press the **LEFT** key once which will move the cursor back to the RH side of the display.

4-20mA CH1 PROC
20mA TUNE 512


Press the **DOWN** key to accept the setting and move to the next setting




pH - Outputs Menu - 4-20mA CH2 Output 4.22

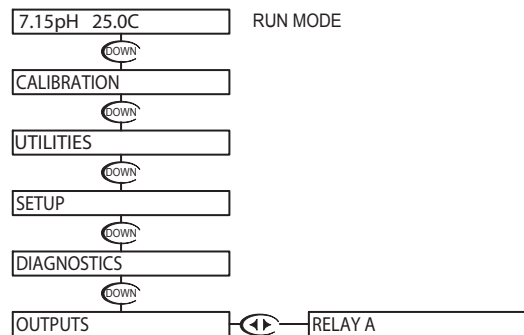


If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed



Use the and keys to change the setting








Press the key once which will move the cursor back to the RH side of the display.



Press the key to accept the setting and move to the next setting

The 4mA, 20mA and TUNE functions are set up the same way as 4 - 20 mA CH 1 output.

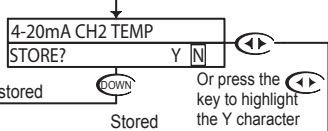

Then press the key to store the selection and return to the OUTPUTS menu

The TUNE function allows the user to precisely adjust the 4-20mA output to compensate for any errors in the output circuitry. Normally, fine tuning the 4-20mA output is not necessary.

To make the adjustment, place an accurate current meter in series with the 4-20 mA output, with the appropriate loads connected. When the TUNE menu is selected, the controller puts 20mA out to the terminals. Use the or keys to adjust the 20mA output to get exactly 20.

The TUNE value can be adjusted over the range from 0 to 1000, these are unitless numbers used for tuning purposes only.

With "N" selected, pressing the key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

The Controller has 2 4-20mA outputs, electrically isolated from each other and ground. Either output can source current into a maximum of 800 ohms.

Channel 2 can be selected to track the process or temperature.

Channel 2 has fully independent and fully adjustable 4 & 20 mA output adjustments. This will enable the operator to span the output over the desired range.

Note that if the T COMP OVERRIDE is ON and Channel 2 output is set to track temperature, the output will not change, but hold at a value representing the temperature set in the T COMP OVERRIDE.

The example below shows the 4-20 mA set to 4mA = 0°C and 20mA = 100°C


The output would then span 4 to 20 mA for a temperature swing of 0°C to 100°C.


Note that the span can be reversed, in that 4 mA can be set to a high process value, and 20 mA can be set to a low process value, effectively reversing the control direction.

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




pH - LED Display Menu - pH Auto Calibrate 4.23

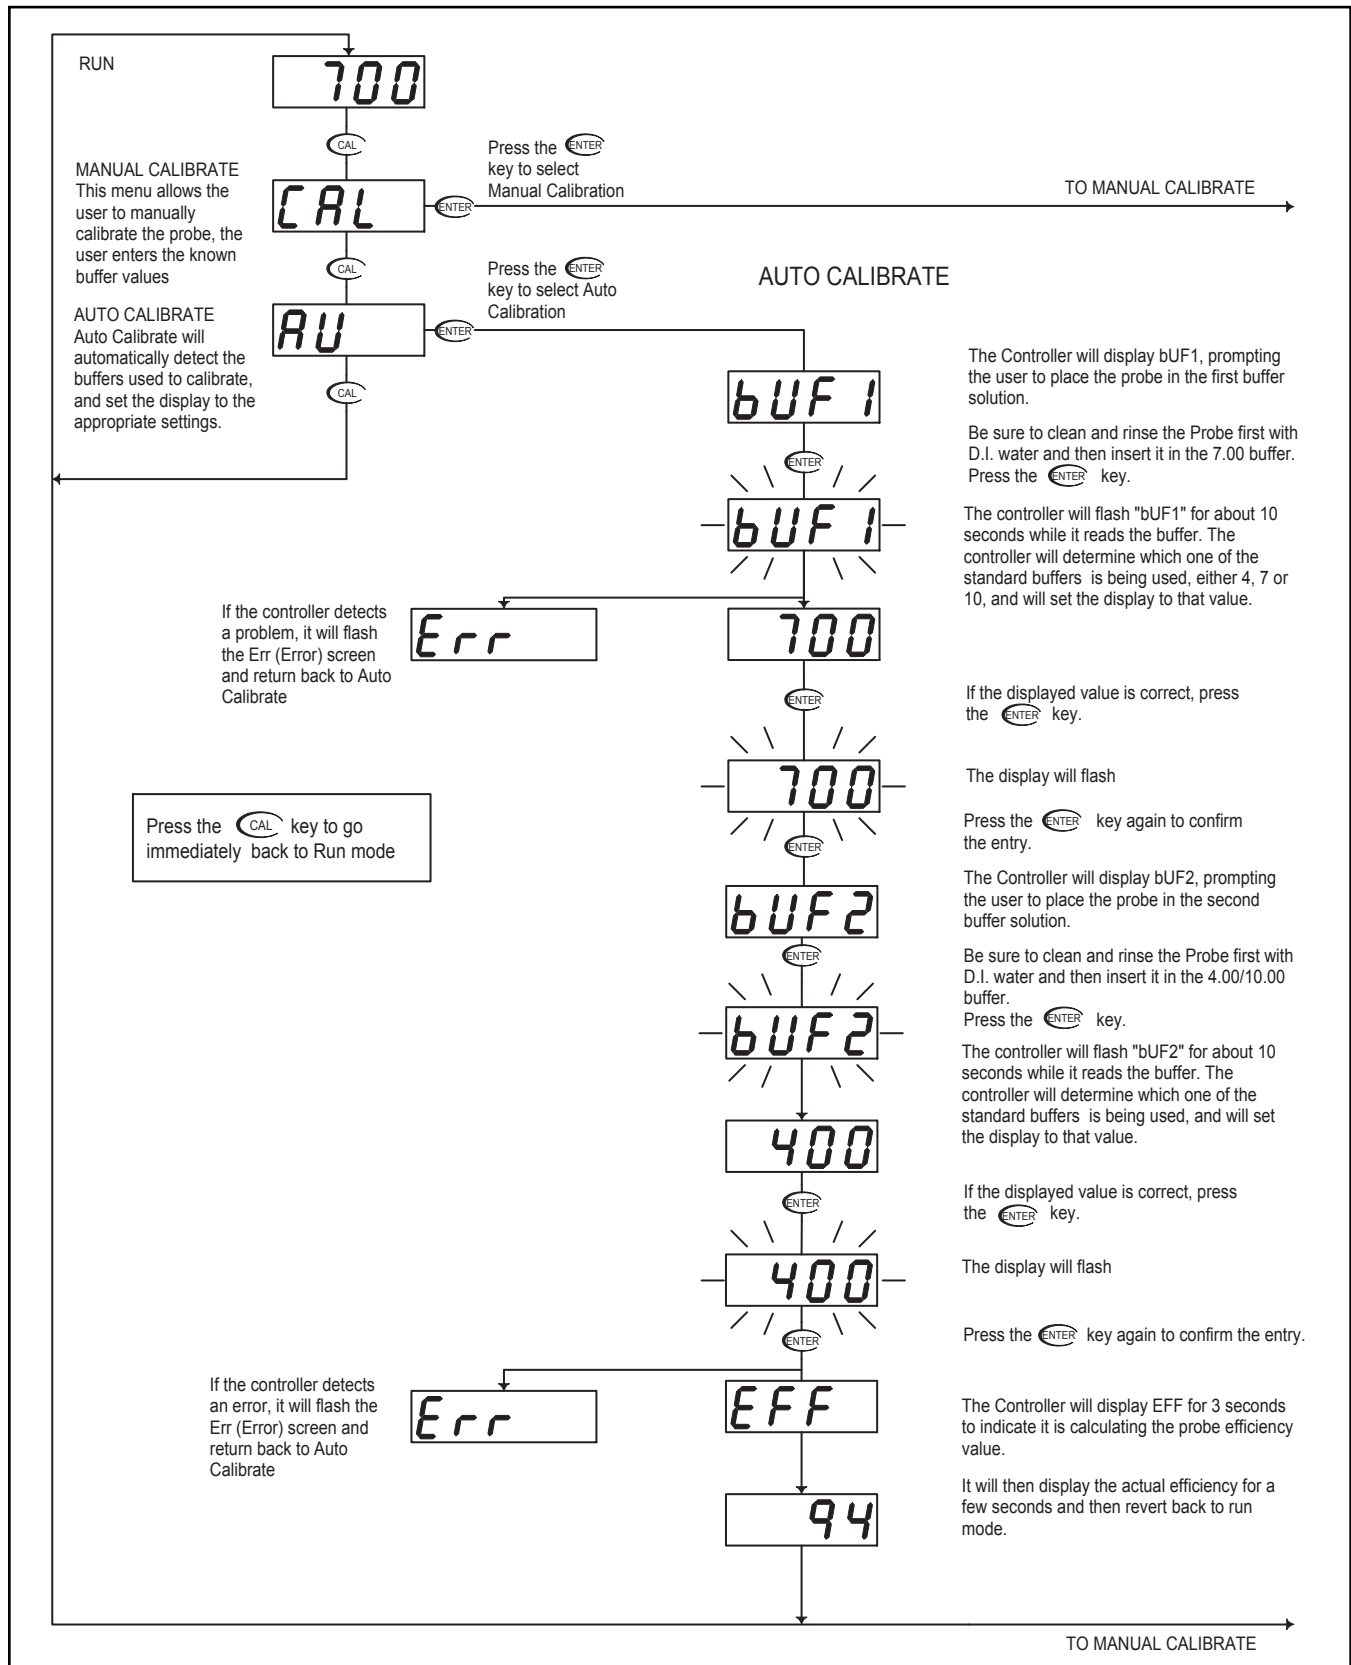

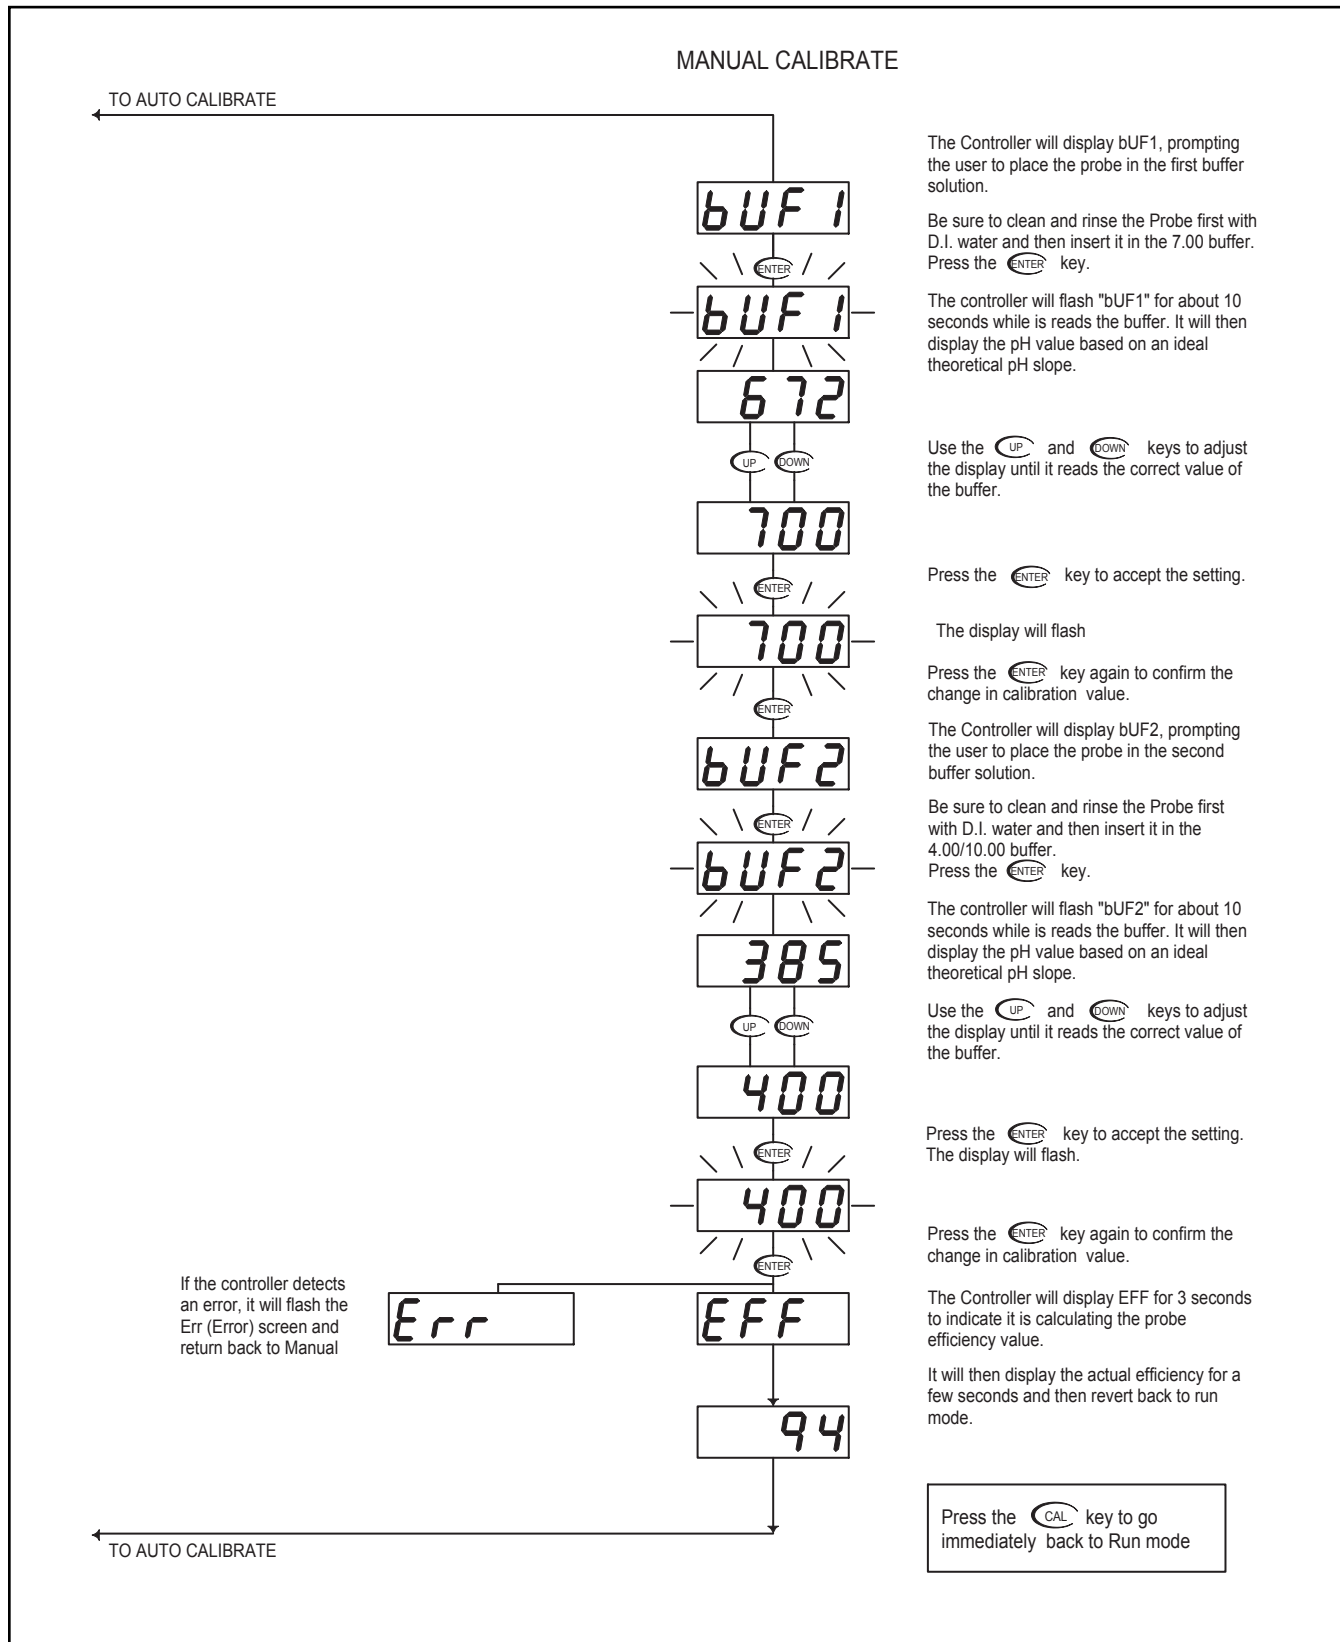




Section 5 - Using the SHARK in ORP Mode

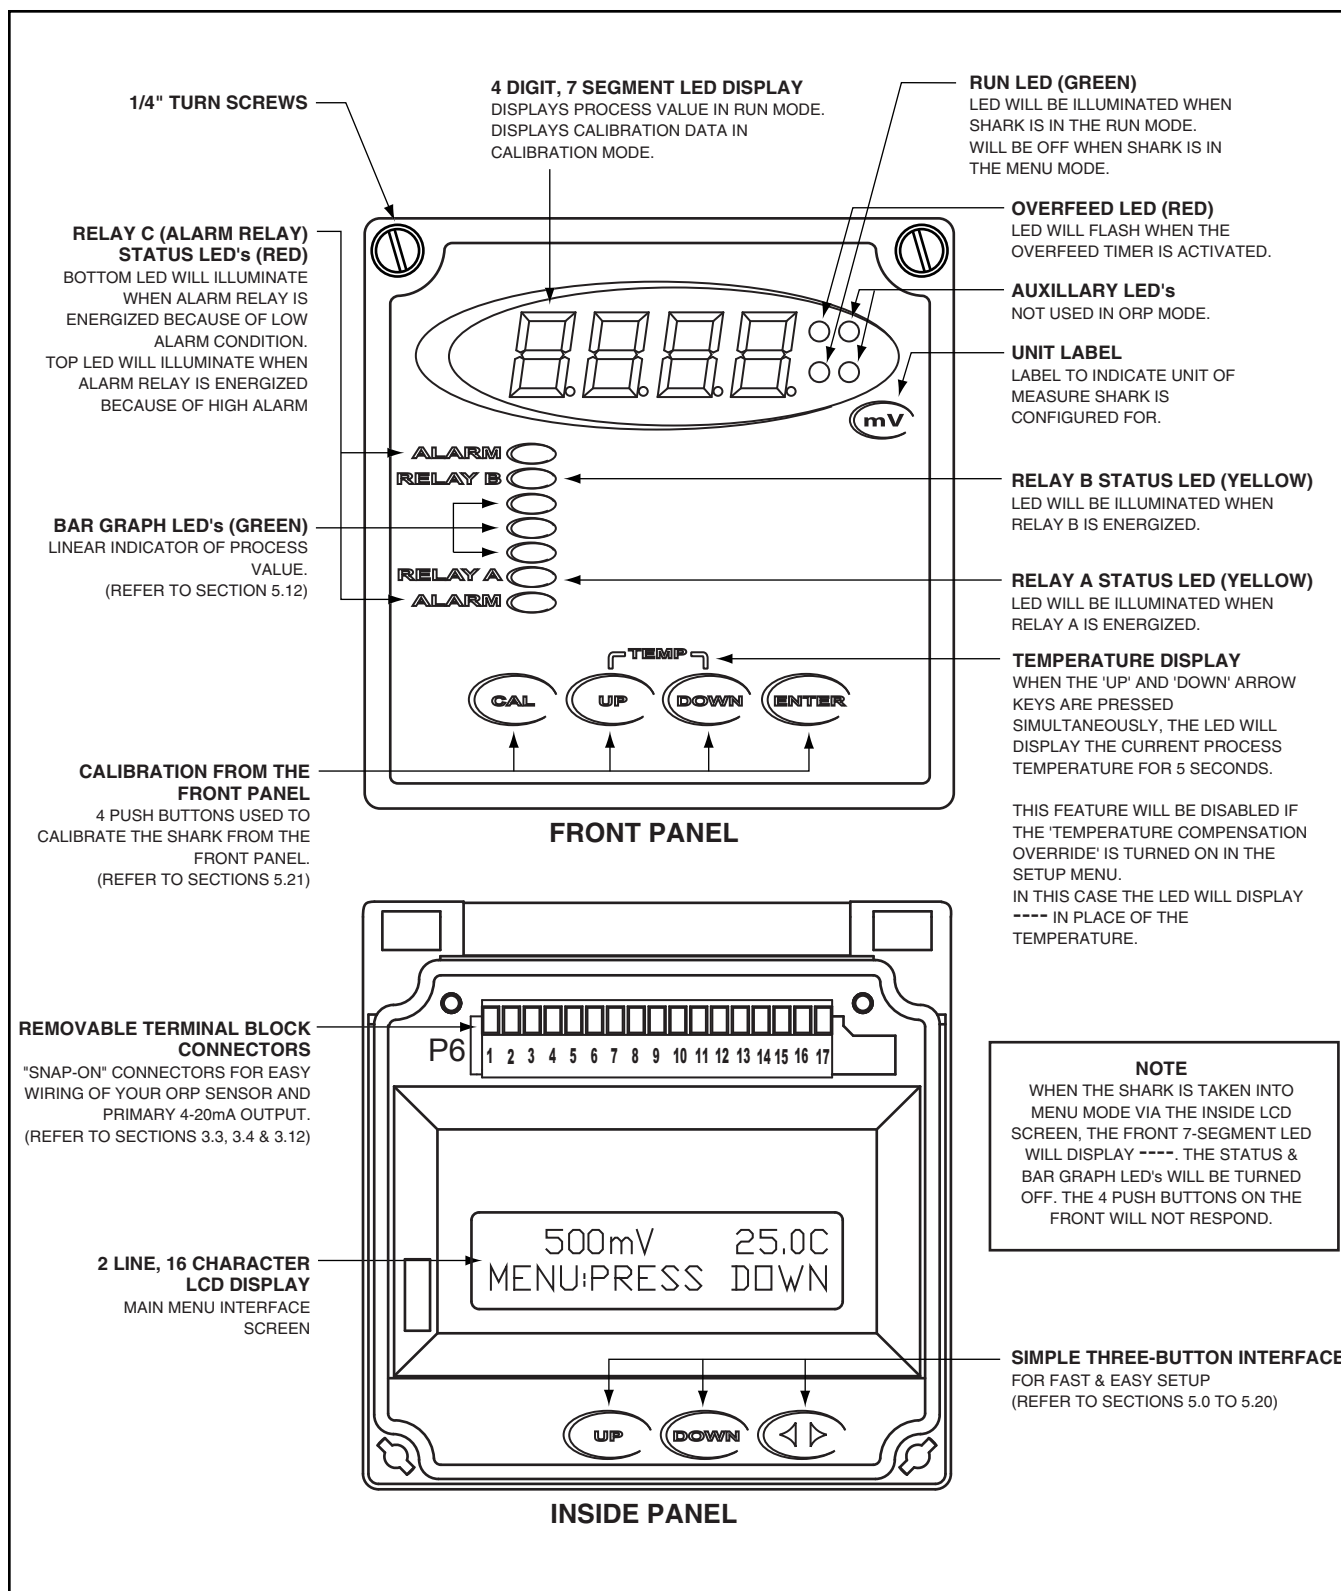




ORP - Menu Overview 5.0

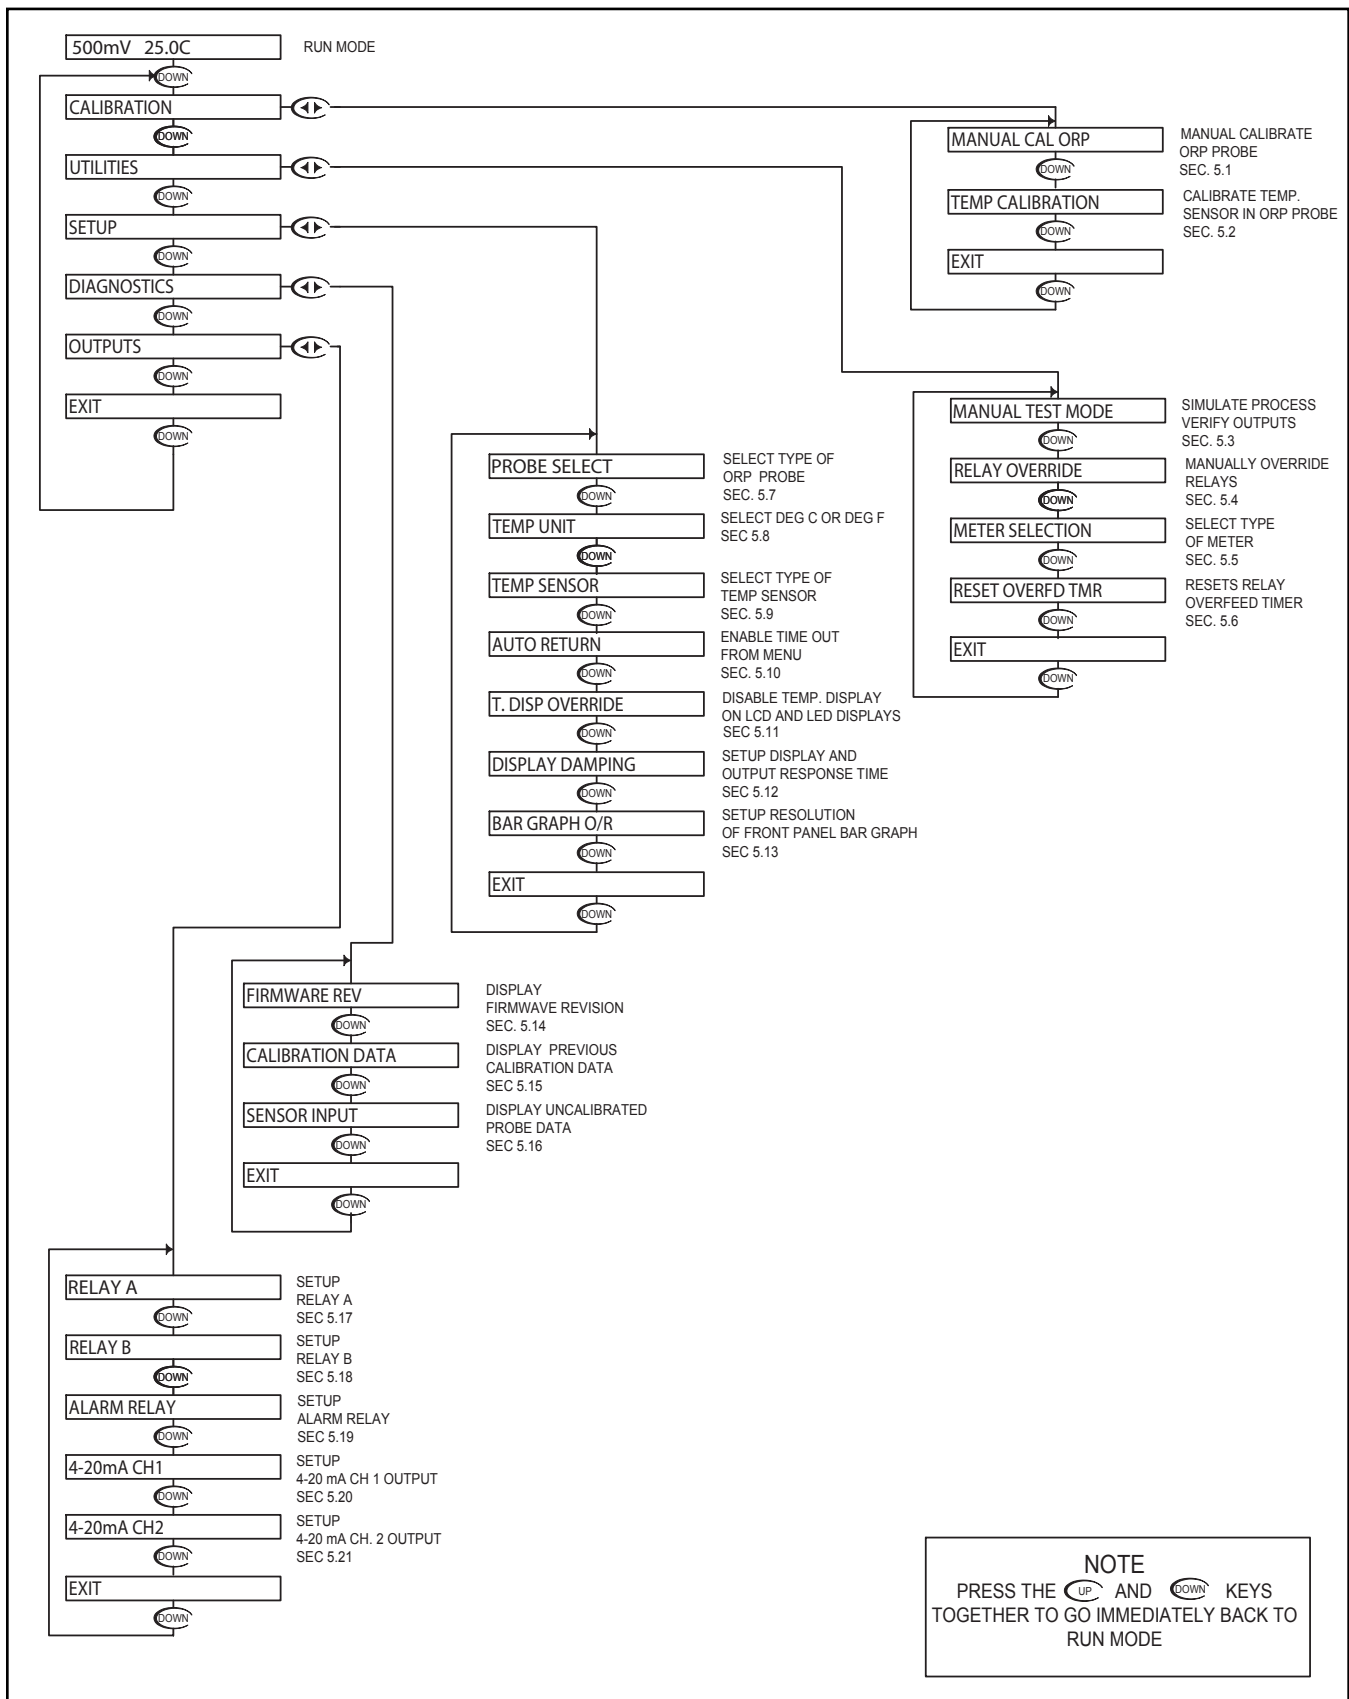

NOTE
PRESS THE **UP** AND **DOWN** KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE




ORP - Calibration Menu - Manual Calibrate 5.1

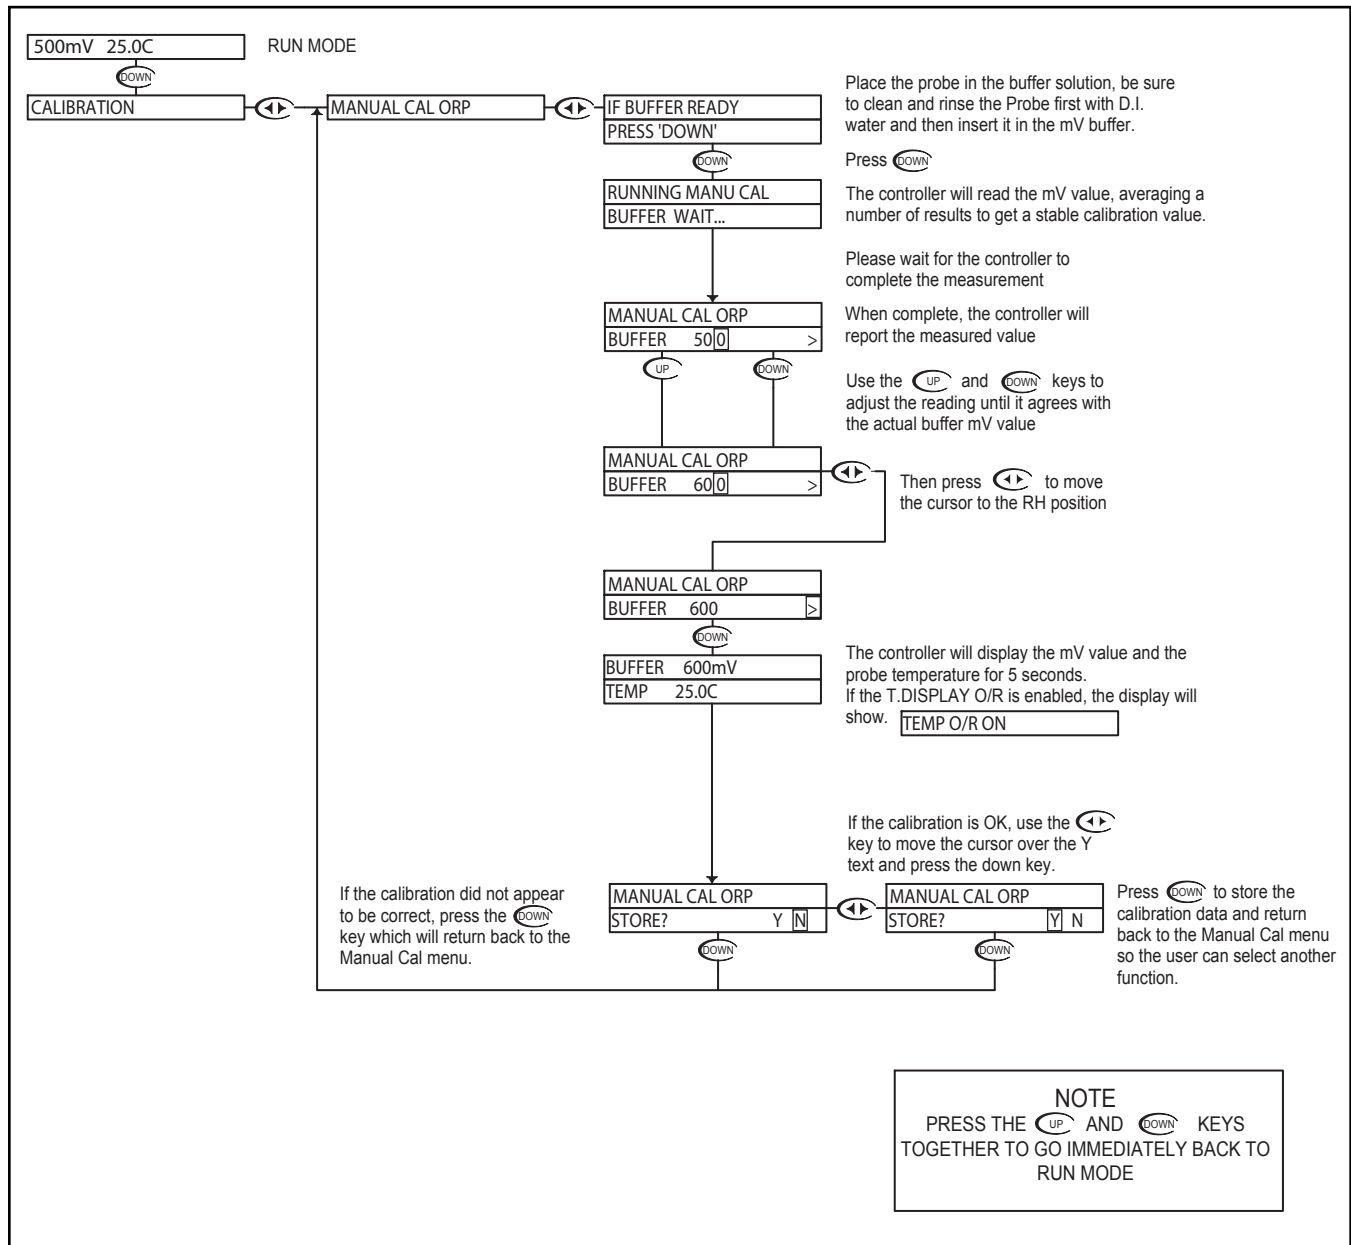




ORP - Calibration Menu - Temp. Calibration 5.2

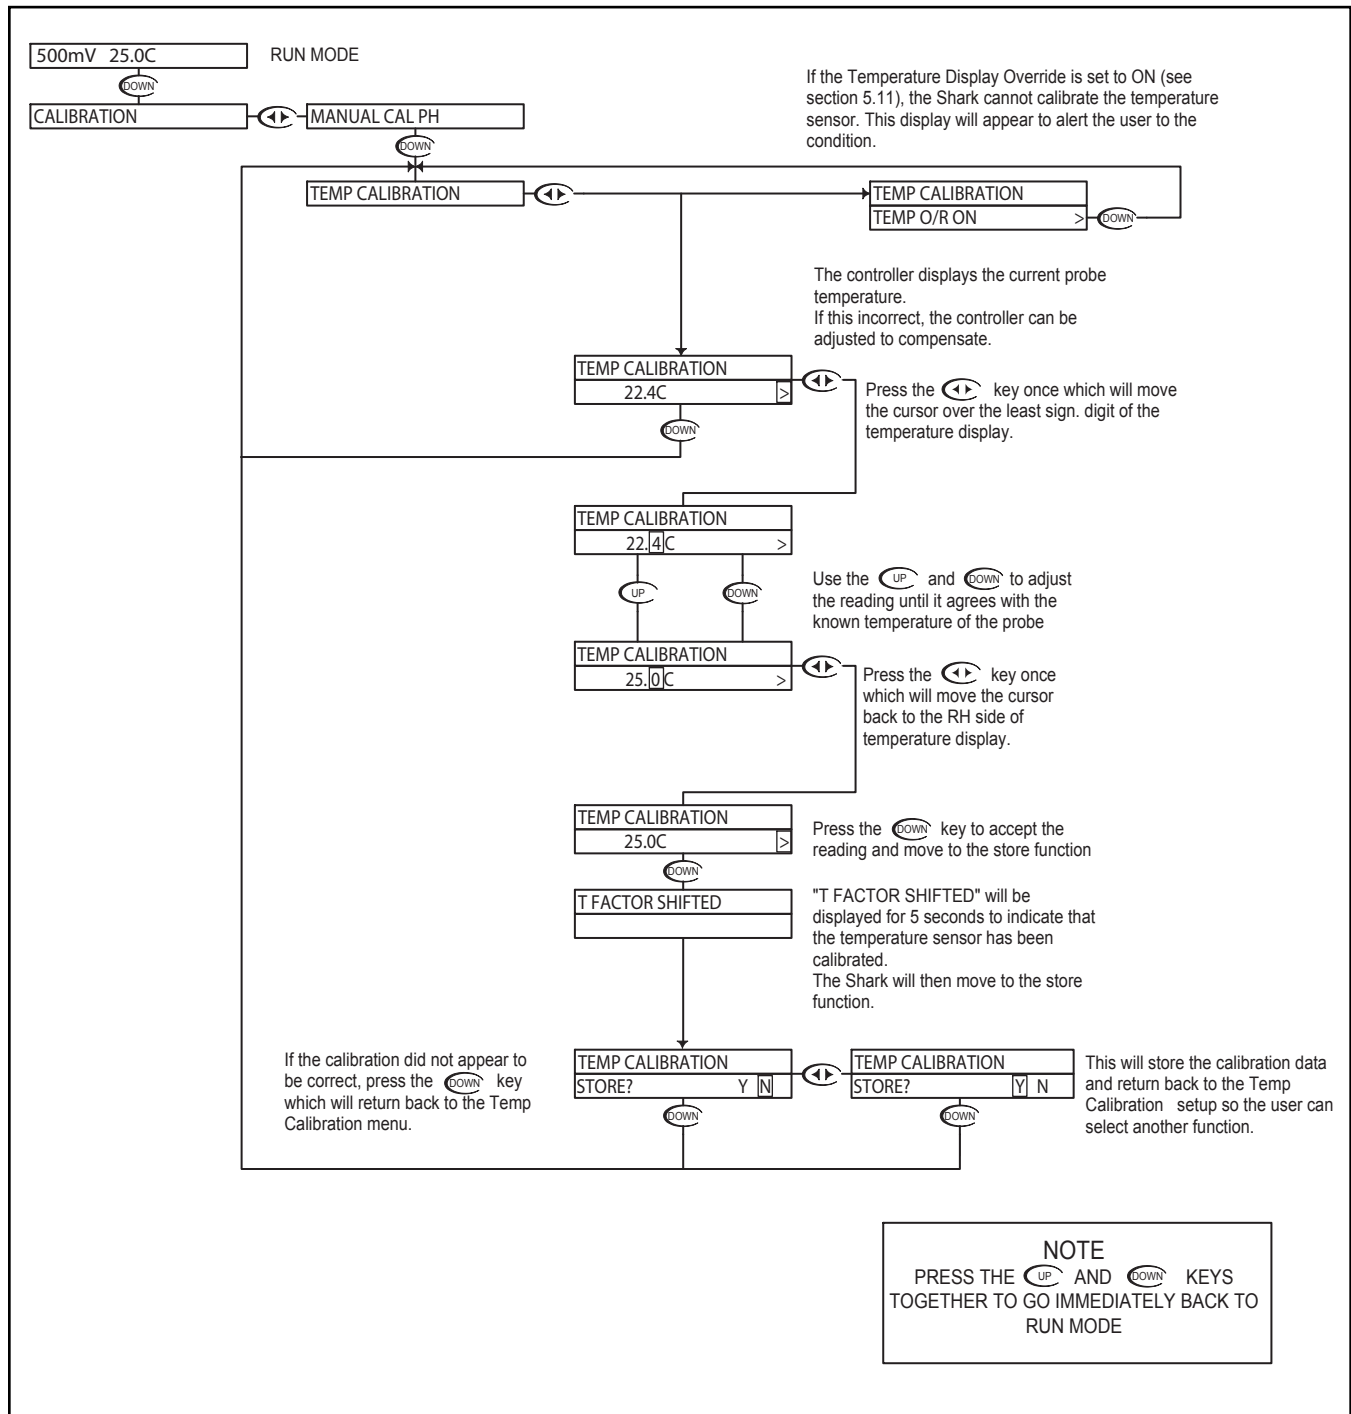


ORP - Utilities Menu - Manual Test Mode 5.3

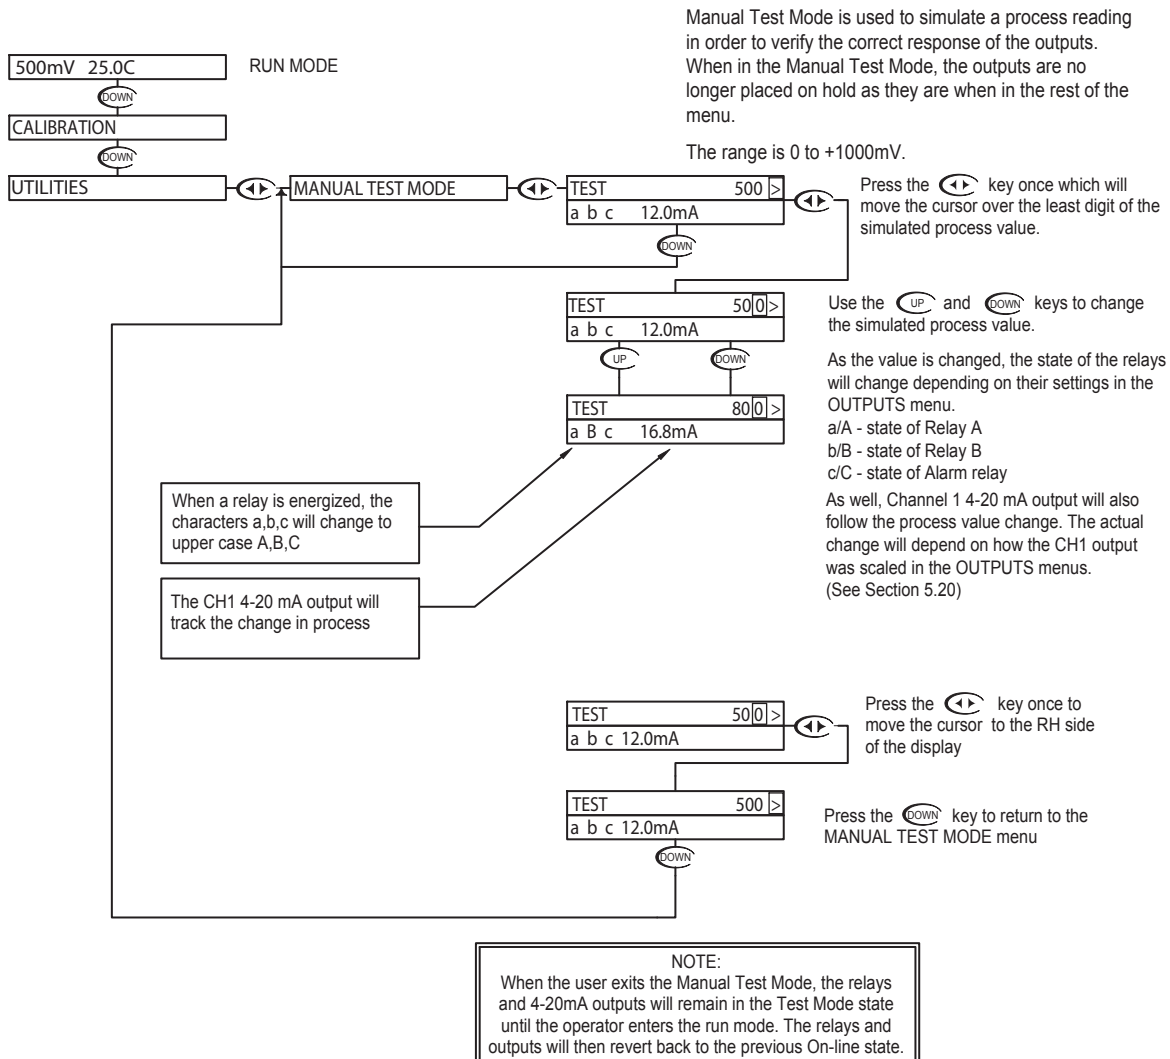


NOTE
PRESS THE  AND  KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE

ORP - Utilities Menu - Relay Override 5.4

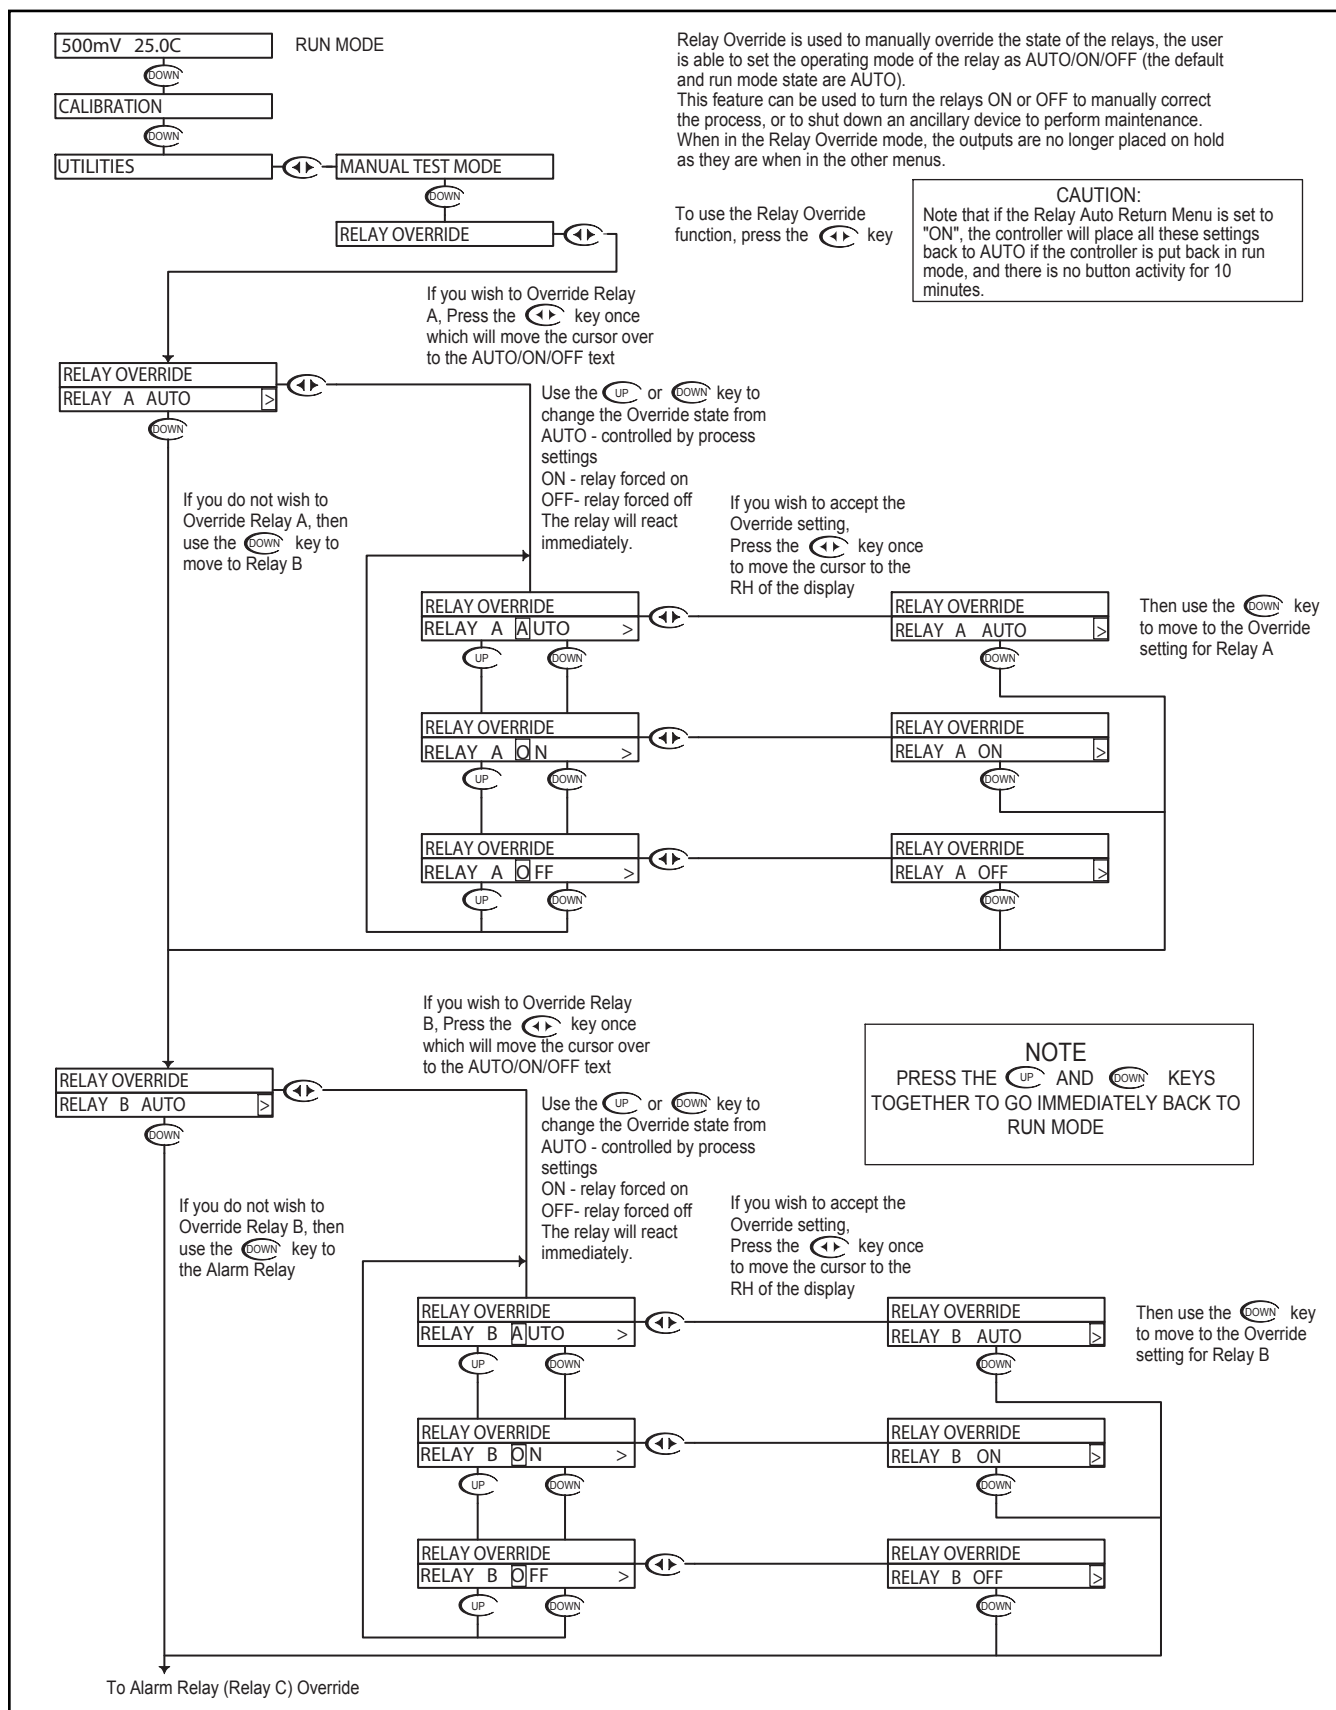




ORP - Utilities Menu - Relay Override 5.4

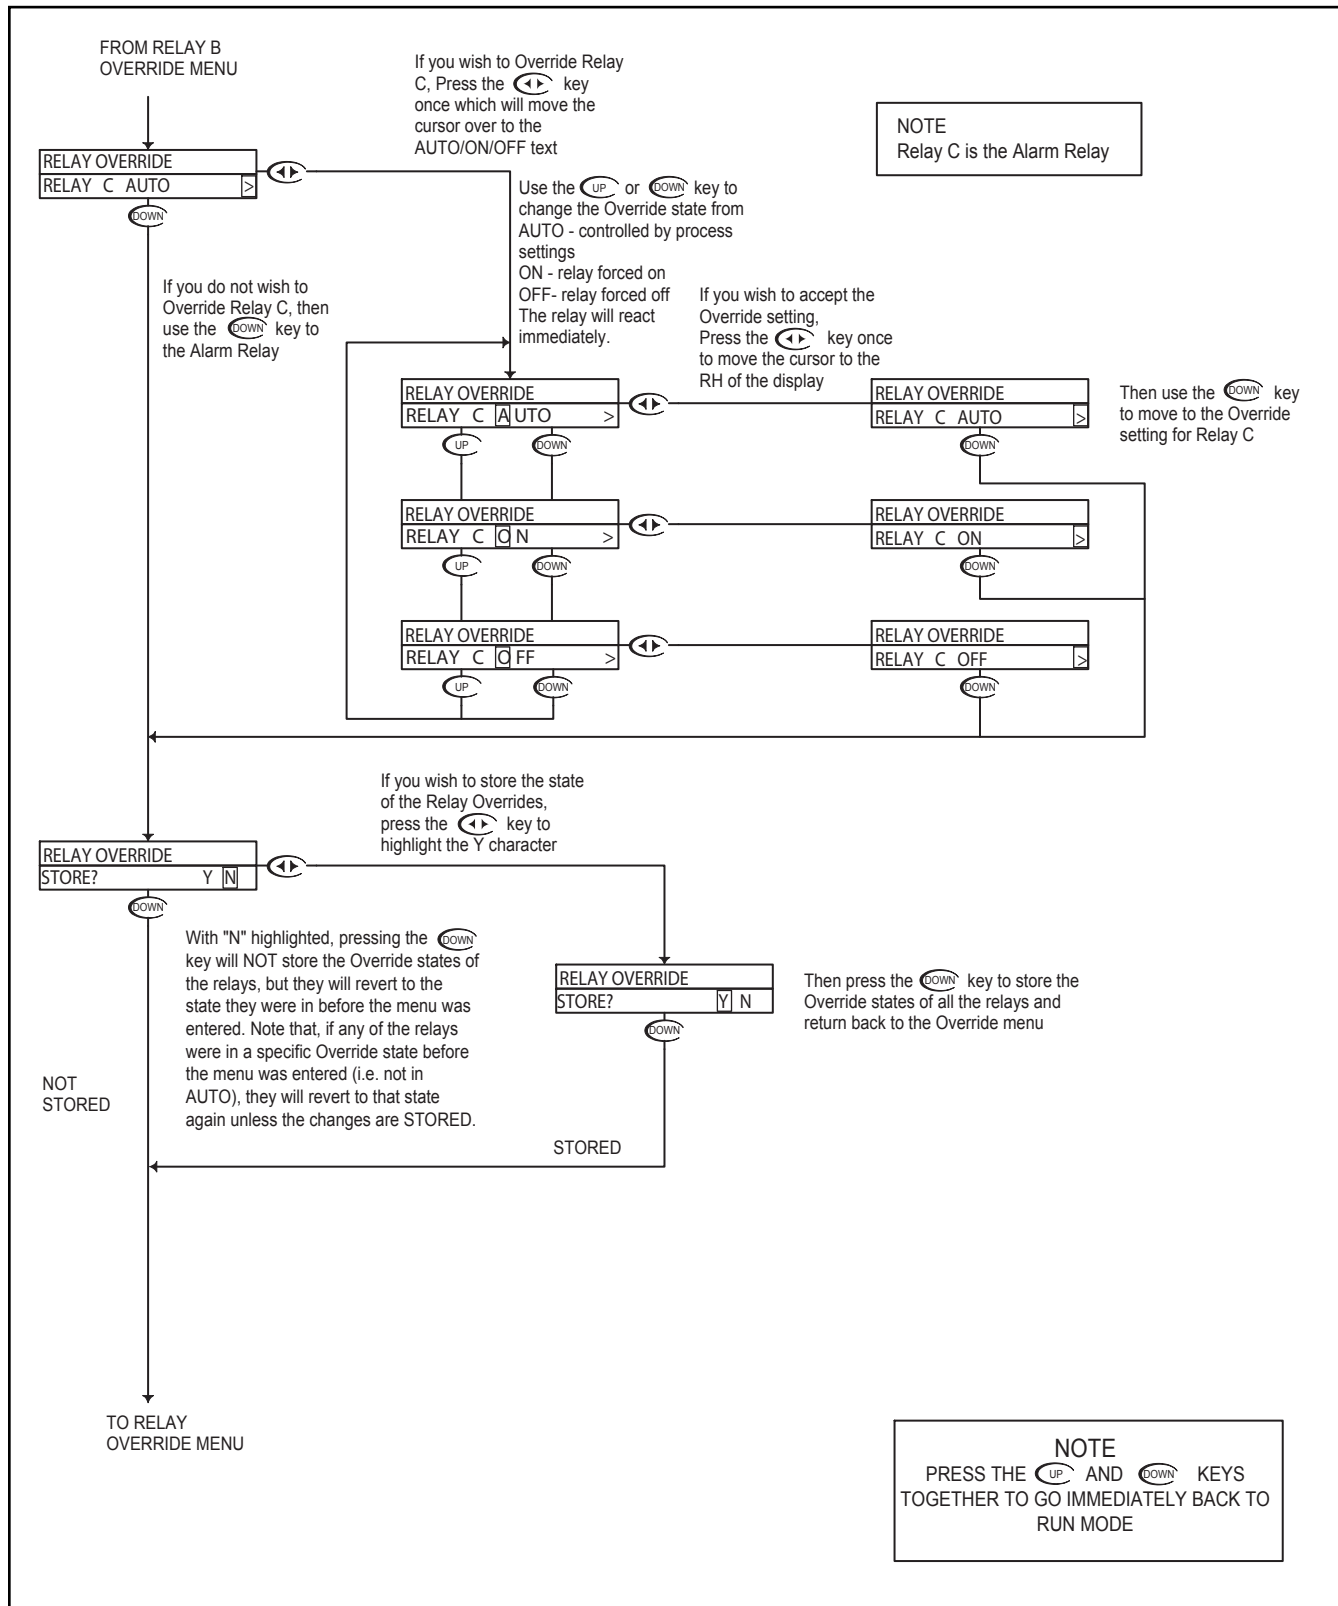



ORP - Utilities Menu - Meter Selection 5.5

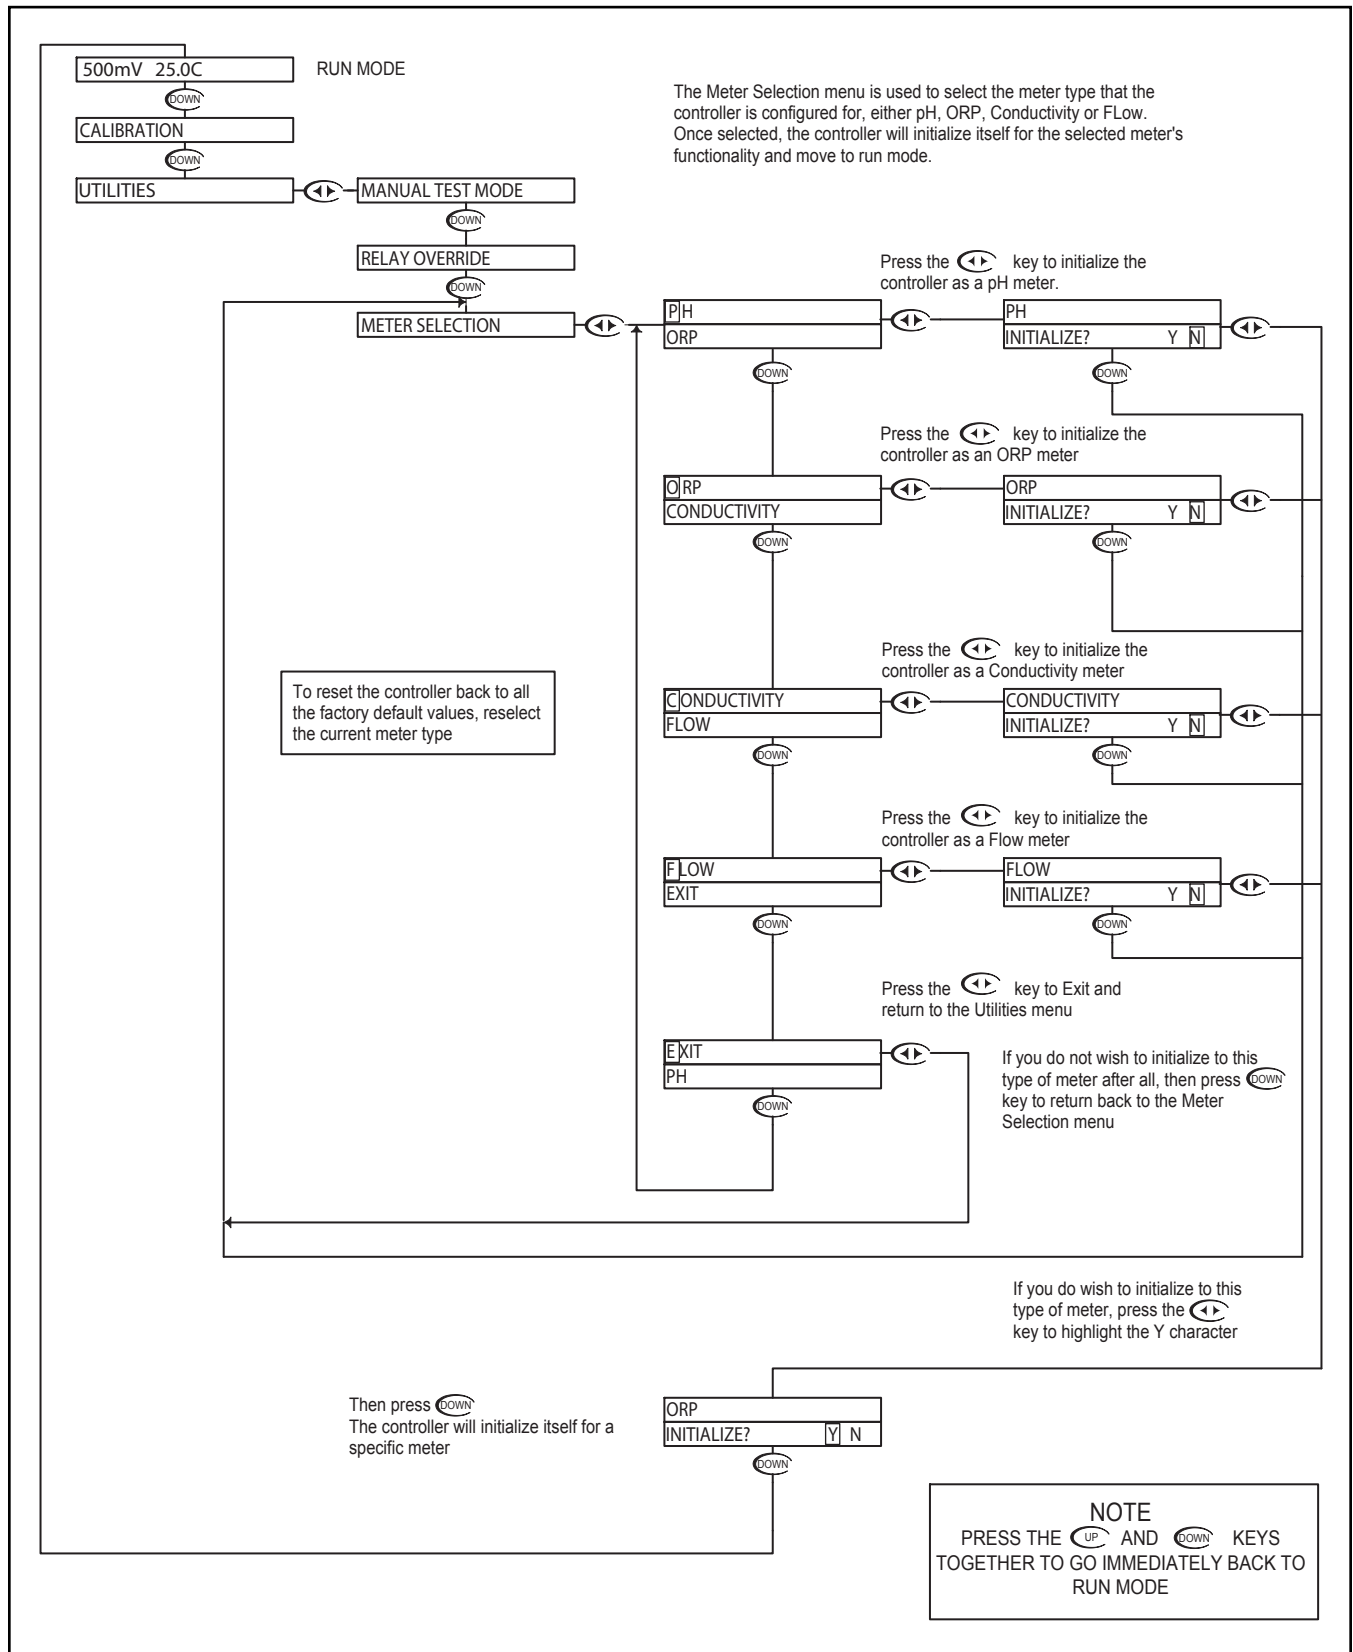



ORP - Utilities Menu - Overfeed Timer Reset 5.6

500mV 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

LEFT/RIGHT

MANUAL TEST MODE

DOWN

RELAY OVERRIDE

DOWN

METER SELECTION

DOWN

RESET OVERFD TMR

LEFT/RIGHT

RESET OVERFD TMR

Press the LEFT/RIGHT key to choose between Y or N.

Y

N

RESET OVERFD TMR

Y

N

If you wish to reset the overfeed timer, then press the DOWN key to proceed and return back to the Utilities menu.

DOWN

If you do not wish to reset the overfeed timer after all, press the LEFT/RIGHT key to highlight the N character and press the DOWN key to return back to the Utilities menu.


DOWN

NOTE

PRESS THE UP AND DOWN KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




ORP - Setup Menu - Probe Select 5.7

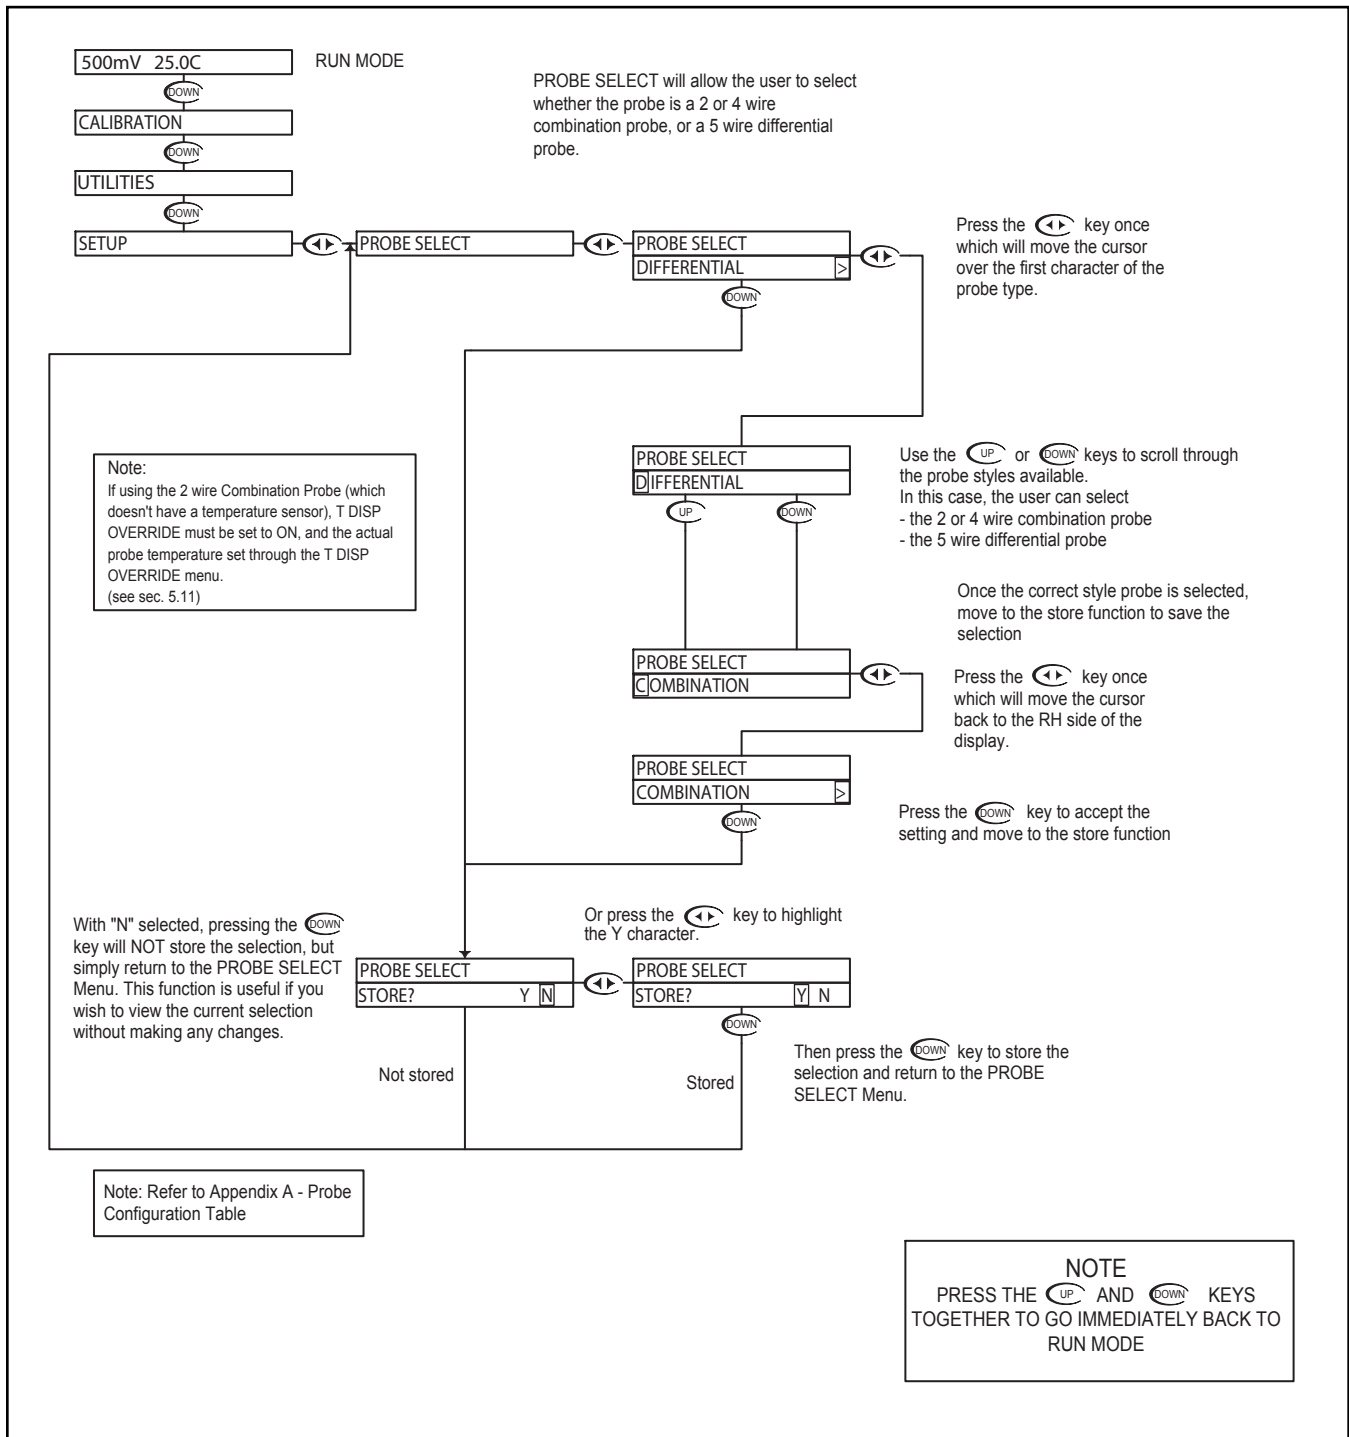



ORP - Setup Menu - Temp. Unit 5.8

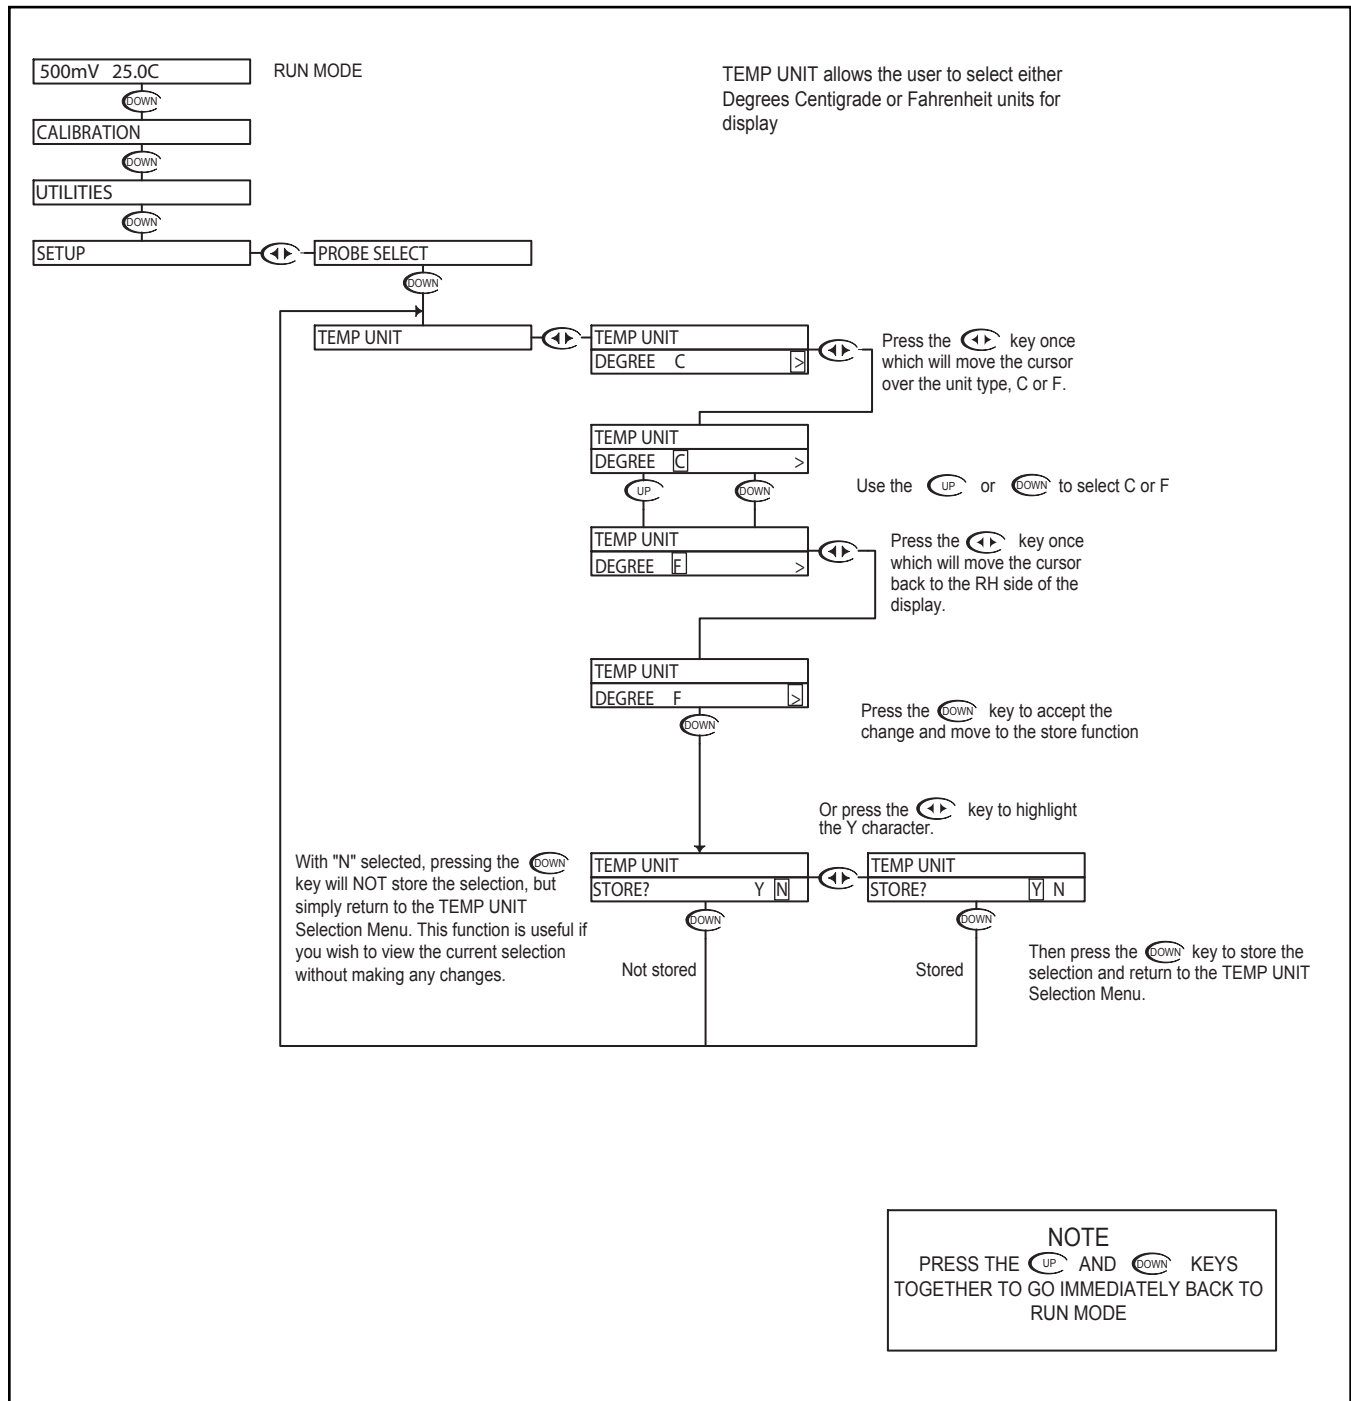



ORP - Setup Menu - Temp. Sensor 5.9

500mV 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

RUN MODE

LEFT

PROBE SELECT

DOWN

TEMP UNIT

TEMP SENSOR

TEMP SENSOR

300 NTC

RIGHT

Press the **RIGHT** key once which will move the cursor over to the sensor type.

Use the **UP** or **DOWN** to select the sensor type

TEMP SENSOR

300 Ω NTC

UP

DOWN

Once the correct Sensor has been selected press the **RIGHT** key once which will move the cursor back to the RH side of the display.

TEMP SENSOR

1000 Ω RTD

UP

DOWN

TEMP SENSOR

3000 Ω NTC

UP

DOWN

TEMP SENSOR

300 NTC

DOWN

Press the **DOWN** key to accept the change and move to the store function

TEMP SENSOR

STORE? Y N

DOWN

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the TEMP SENSOR Selection Menu. This function is useful if you wish to view the current selection without making any changes.

Not stored

Or press the **LEFT** key to highlight the Y character.

TEMP SENSOR

STORE? Y N


DOWN

Then press the **DOWN** key to store the selection and return to the TEMP SENSOR Selection Menu.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




ORP - Setup Menu - Auto Return 5.10

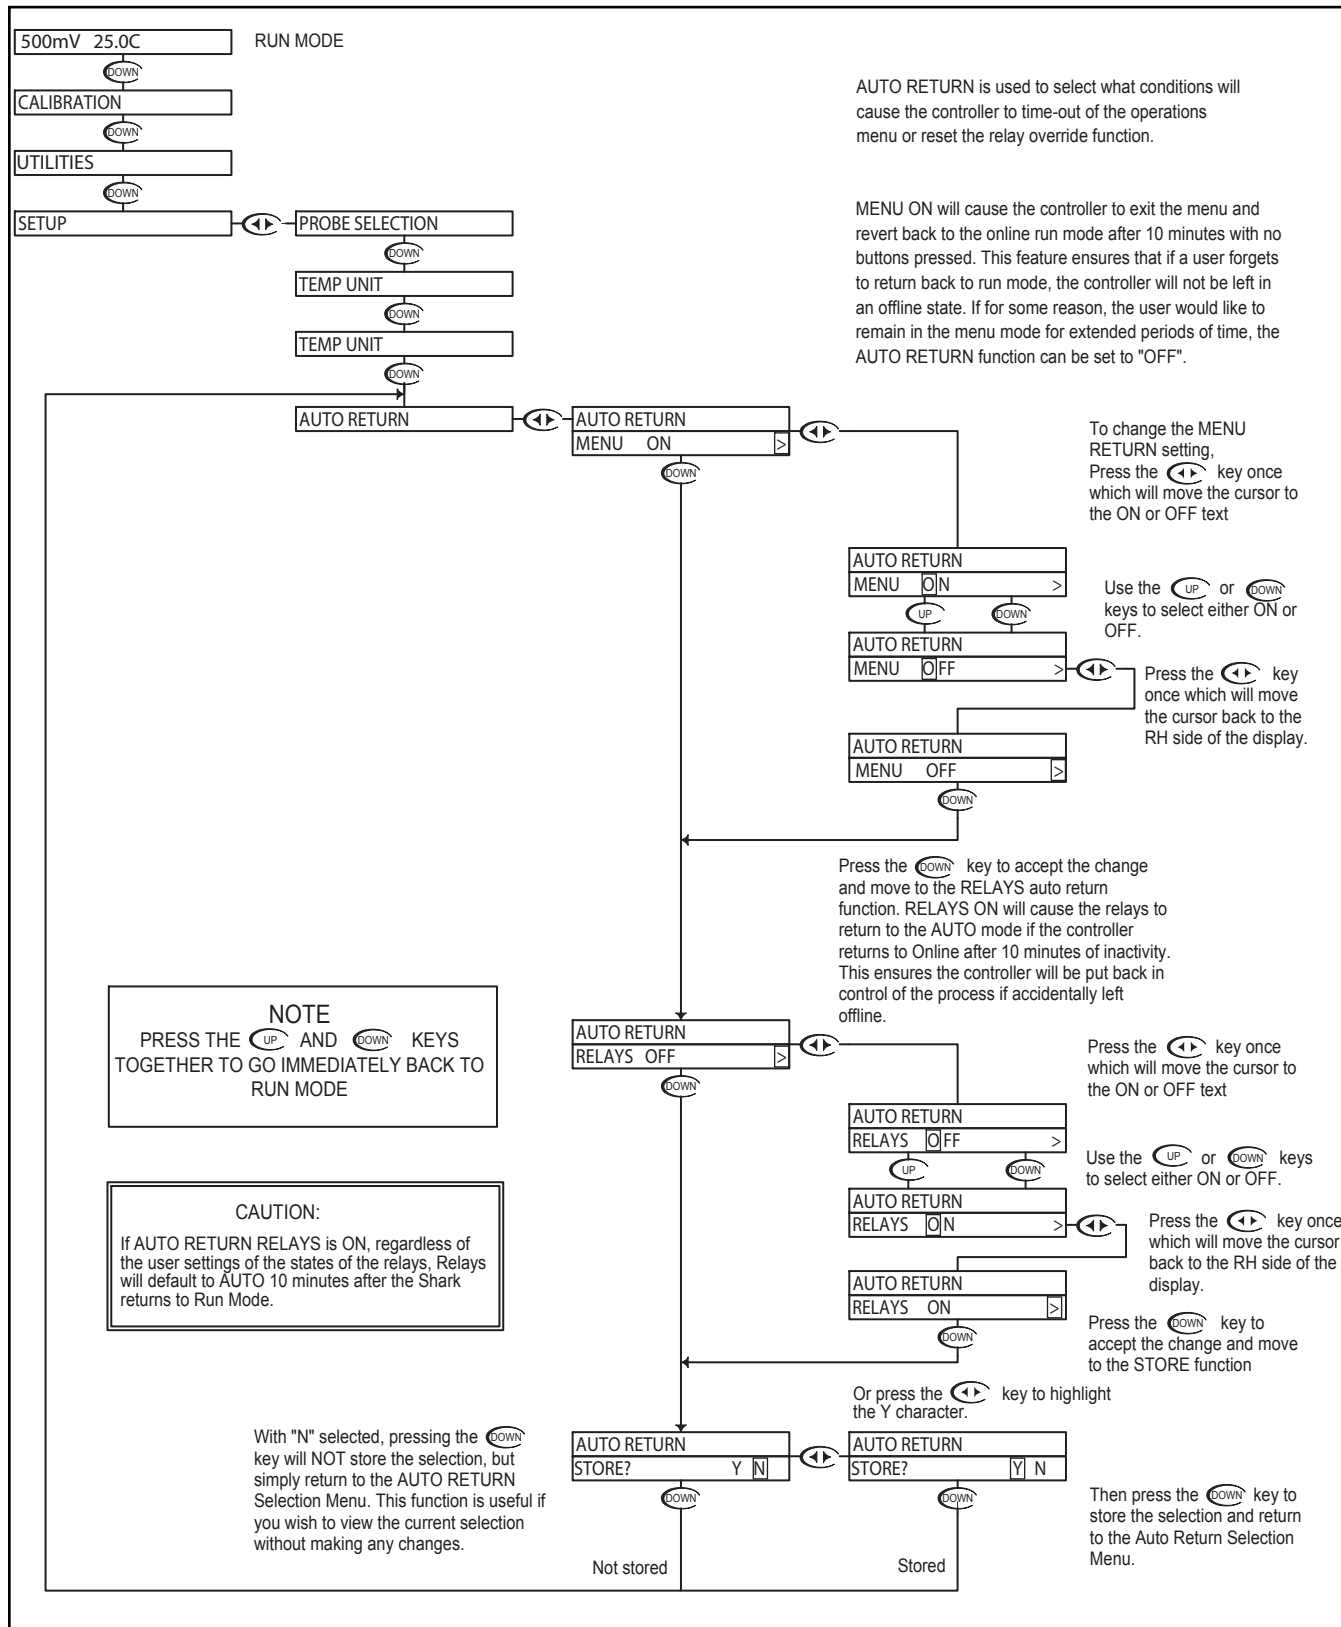




ORP - Setup Menu - Temp. Display Override 5.11

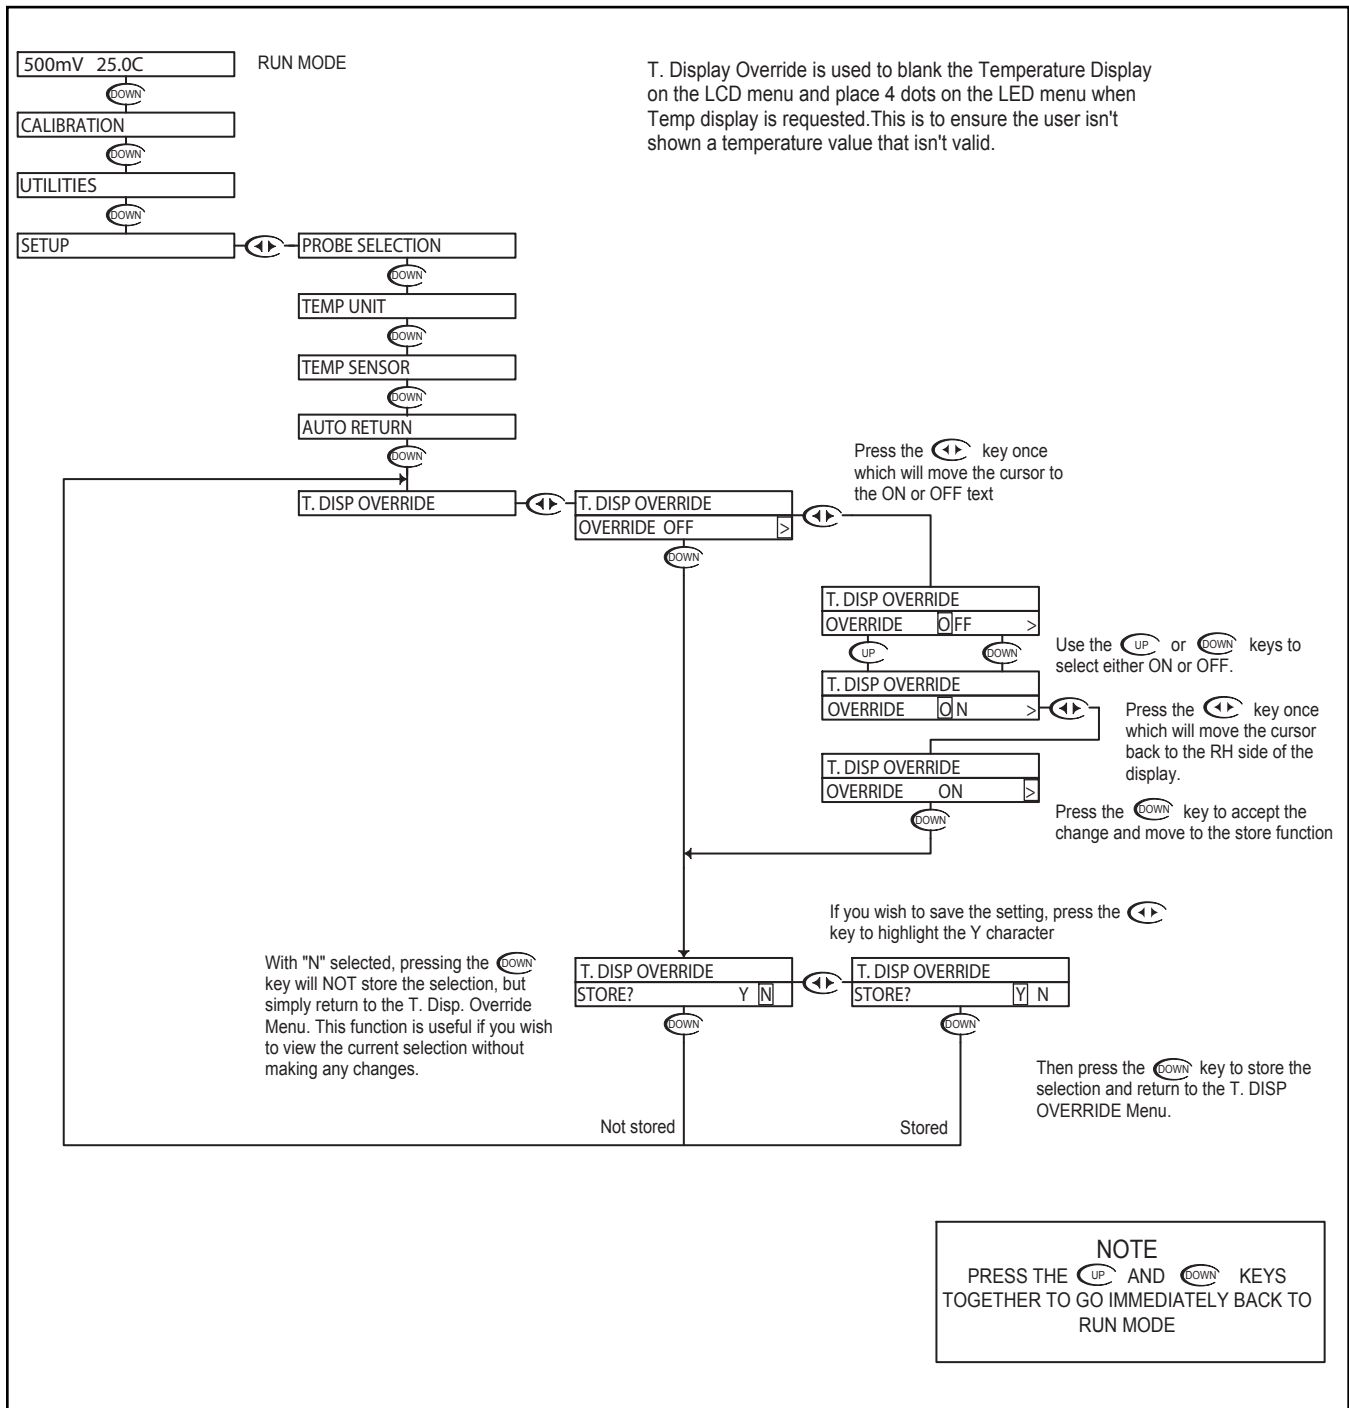





ORP - Setup Menu - Display Damping 5.12

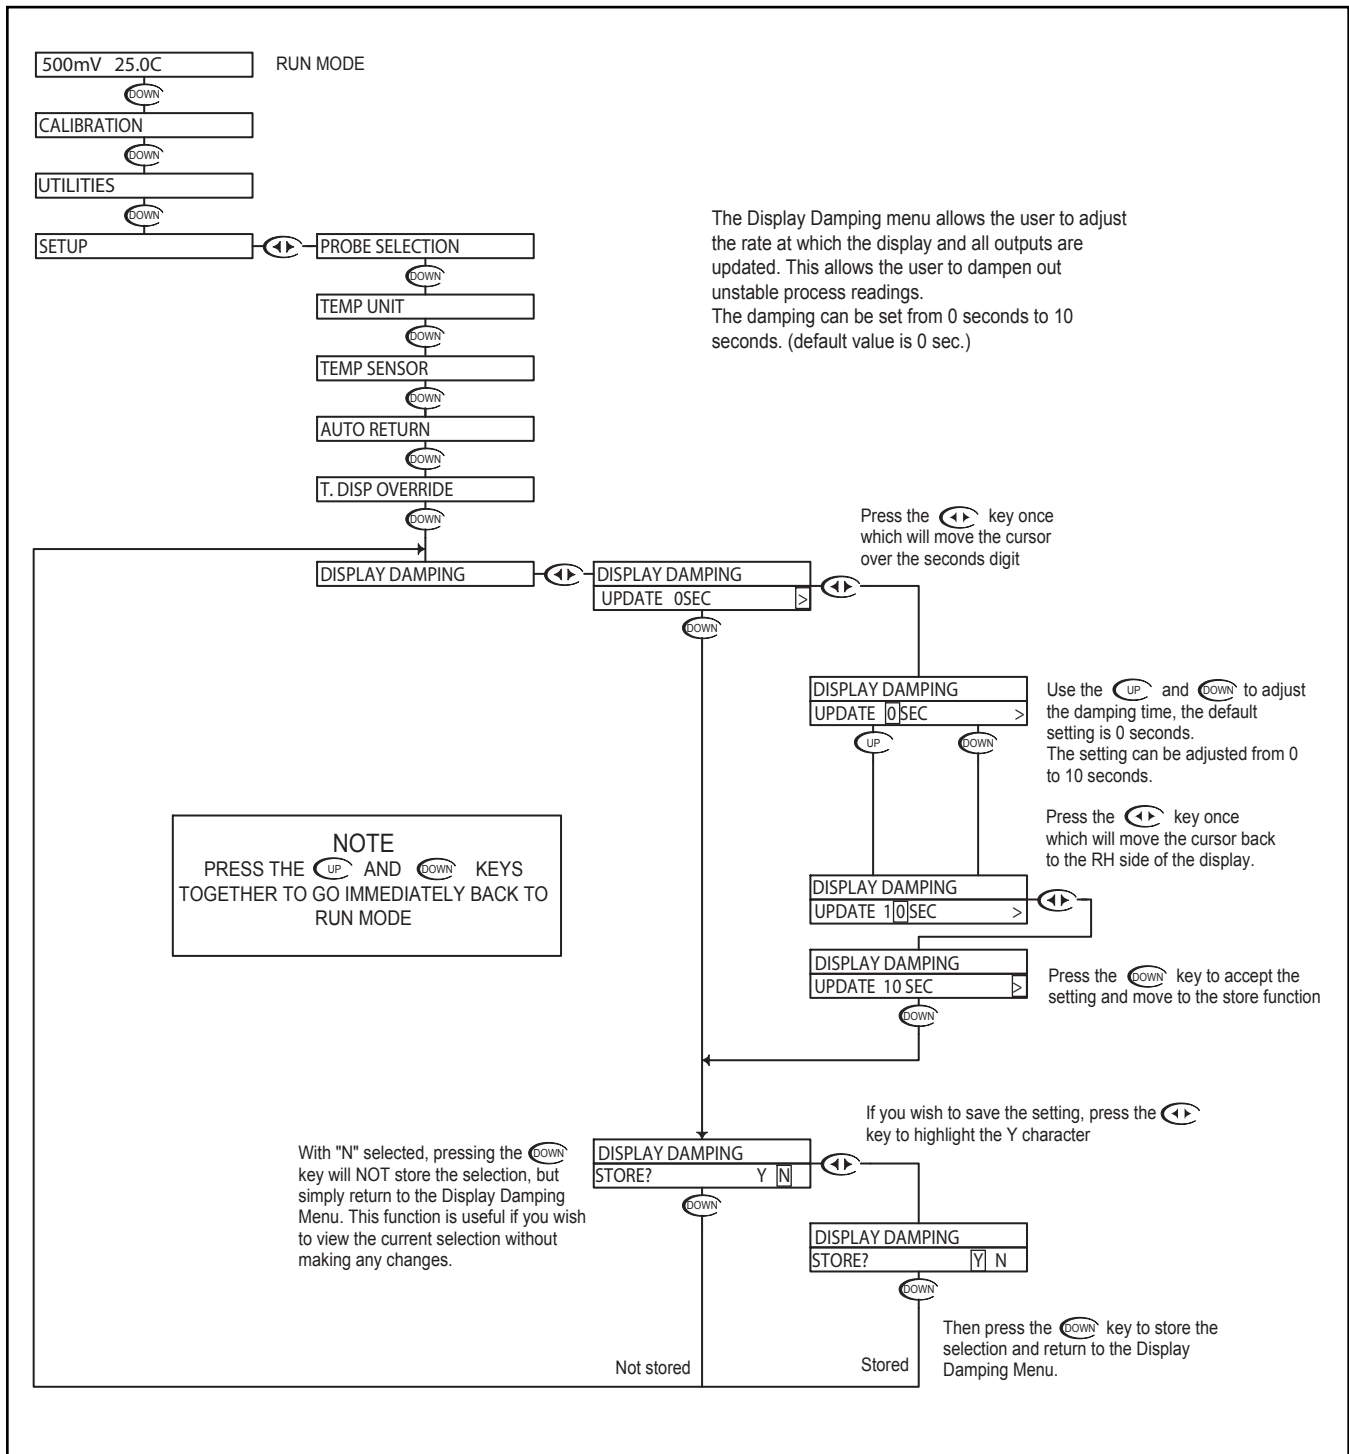



ORP - Setup Menu - Bar Graph O/R 5.13

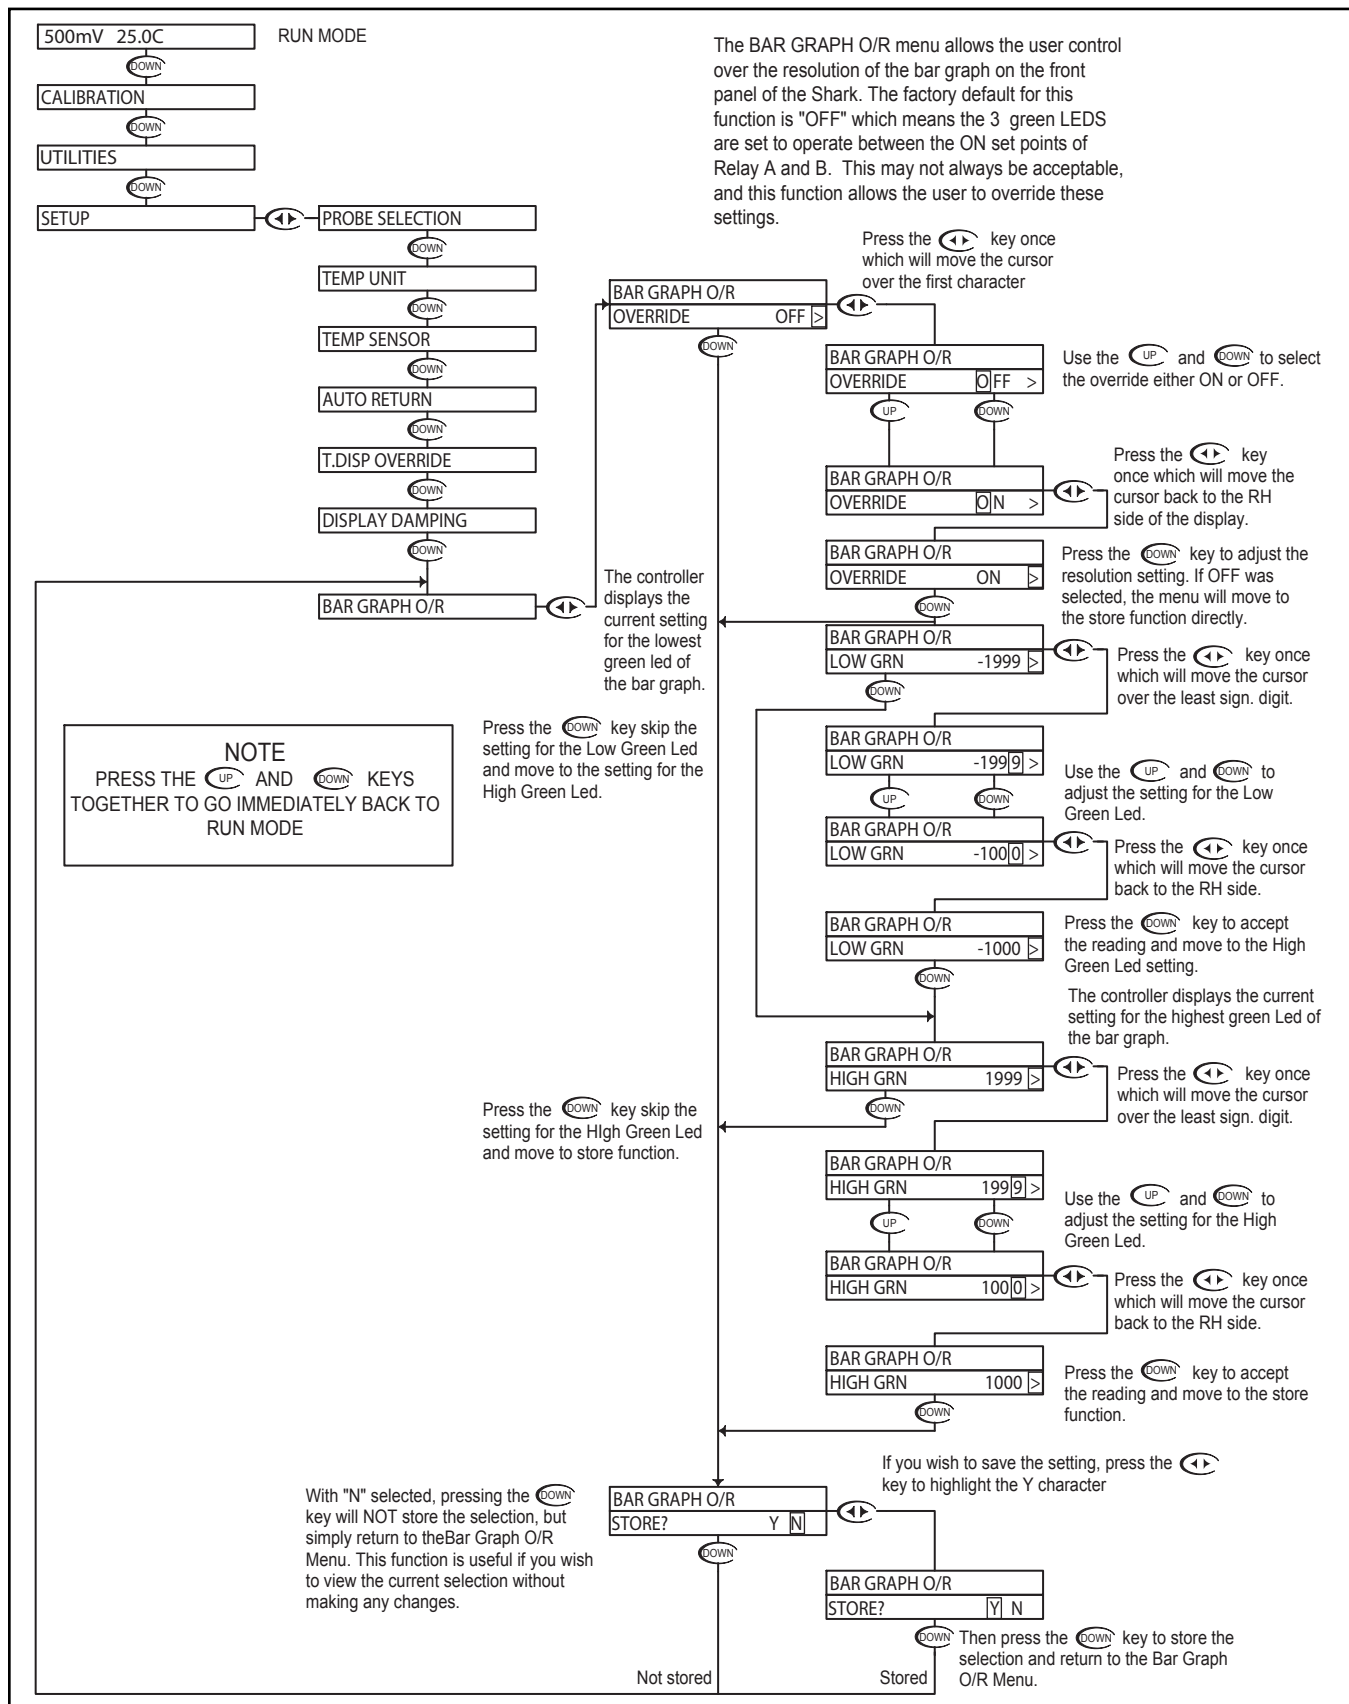

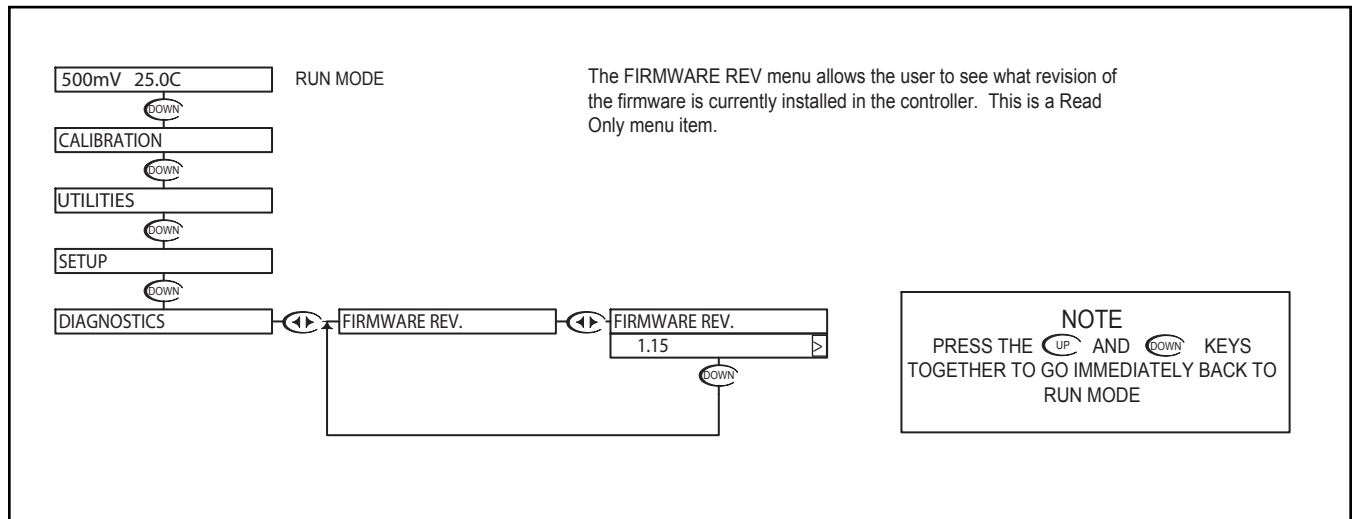



ORP - Diagnostics Menu - Calibration Data 5.15

500mV 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

FIRMWARE REV.

DOWN

CALIBRATION DATA

The Calibration Data menu is a series of read only screens which allow the user to view the data collected during the last calibration.

Press to view the first Calibration Data screen.

CALIBRATION DATA
MODE 1PT

DOWN

Calibration Mode
1 point calibration

Press to view the next Calibration Data screen.

CALIBRATION DATA
BUFFER 600mV

DOWN

1st POINT 600mV

CALIBRATION DATA
CAL TEMP 19.4C

DOWN

Probe Temperature at which
calibration was performed = 19.4 C

If the Temperature Display
Override is ON (Section 5.11),
the display will show

CALIBRATION DATA
TEMP O/R ON

NOTE

PRESS THE AND KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



ORP - Diagnostics Menu - Sensor Input 5.16

500mV 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

FIRMWARE REV.

DOWN

CALIBRATION DATA

DOWN

SENSOR INPUT

Press to view the Sensor Input data.

PROBE 500mV
TEMP 331Ω

DOWN

The Sensor Input Menu allows the user to view real time, uncompensated process data from the probe.
This is a Read only menu item.

The top line shows the mV input from the probe
The bottom line shows the actual value of the temperature sensor in ohms.


If the Probe is not equipped with a Temperature Sensing Device, and Temperature Display Override is ON (Section 5.11), the display will show

PROBE 500mV
TEMP O/R ON

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



ORP - Outputs Menu - Relay A 5.17

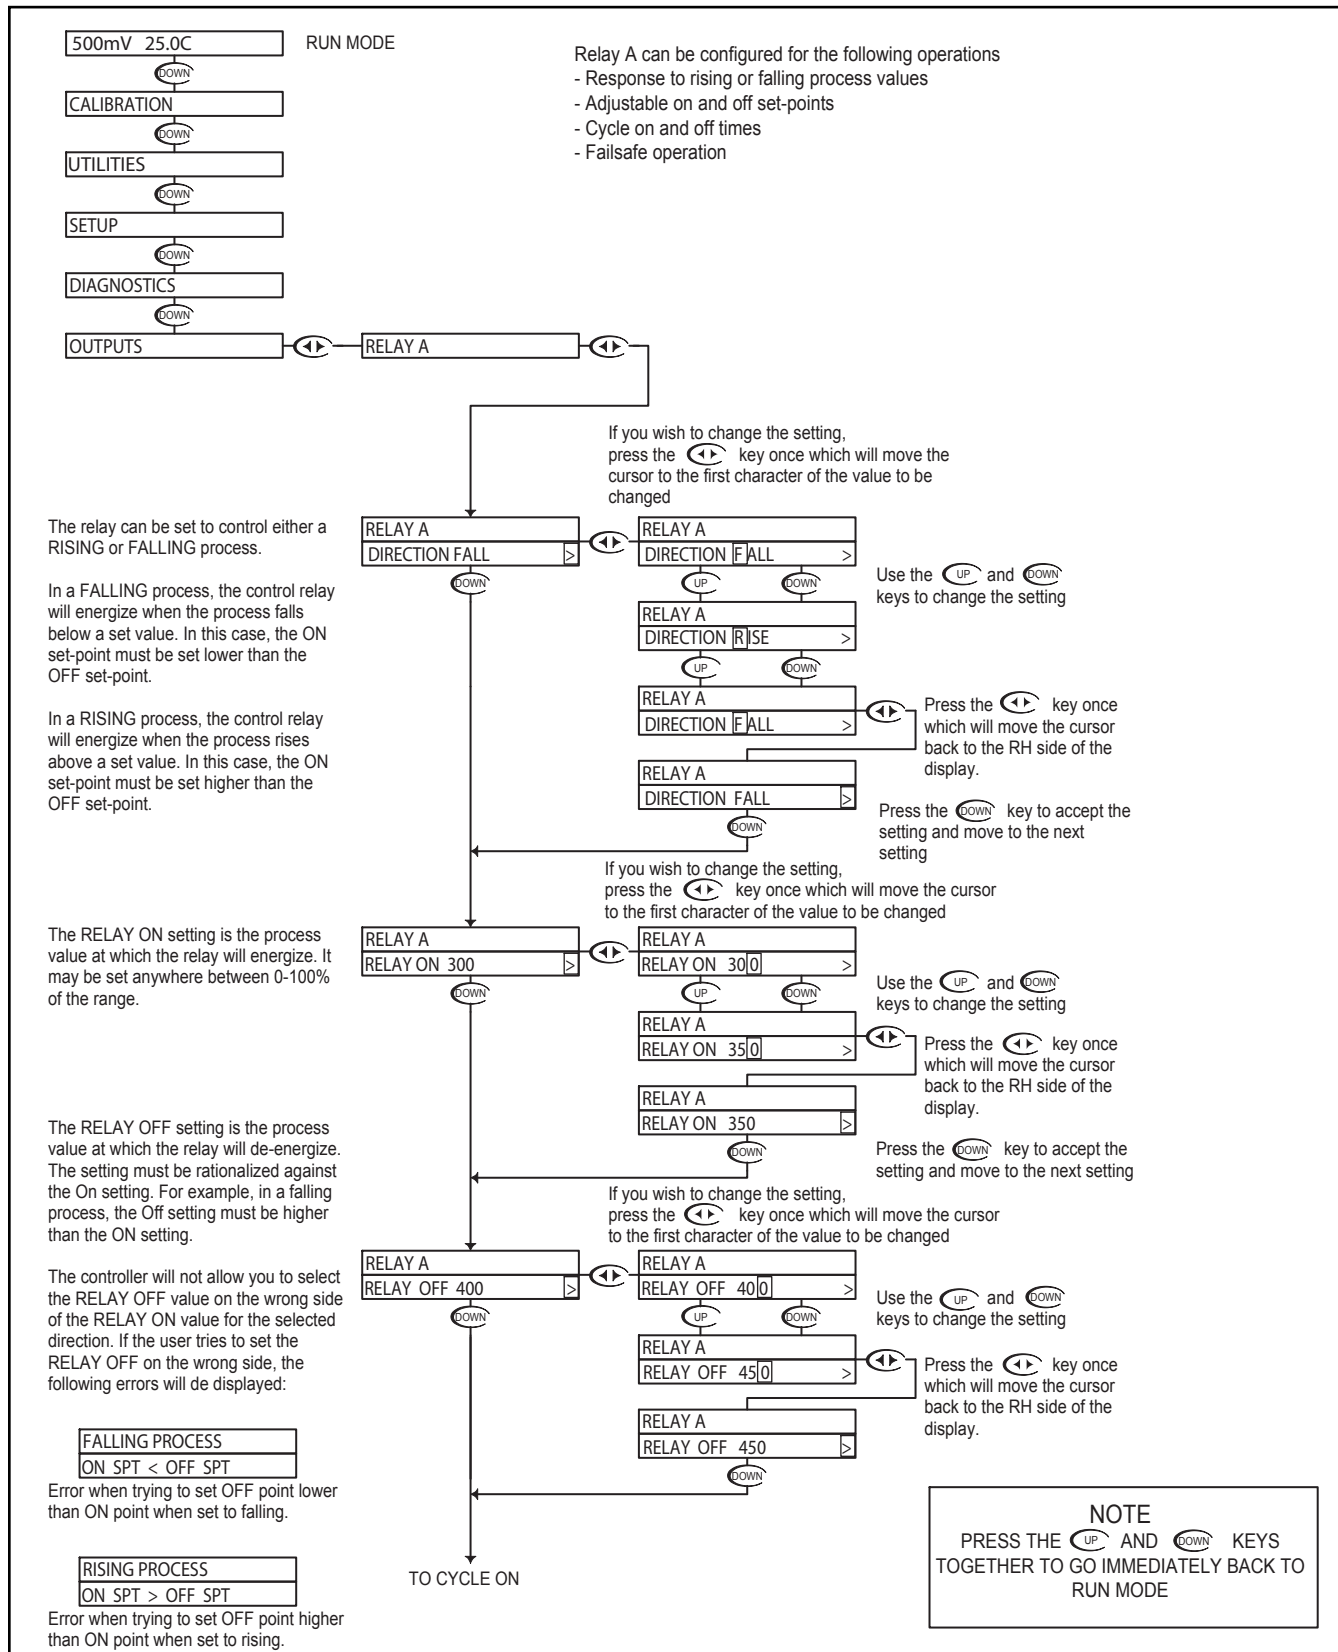



ORP - Outputs Menu - Relay A 5.17

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds.
The default ON time is 5 seconds.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0.

The Default OFF time is 0 seconds.

The OVERFEED TIMER is designed to help safeguard against a process or instrumentation error causing one of the control relays to remain energized for extended periods of time.

When enabled, the user must select the desired overfeed timeout time (1-999 min.)

If the overfeed timer times out:

- Alarm relay will energize.
- Control (A&B) will de-energize
- LED on front will flash

Must be reset via Utilities Menu or Power reset.



The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.


The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption.

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

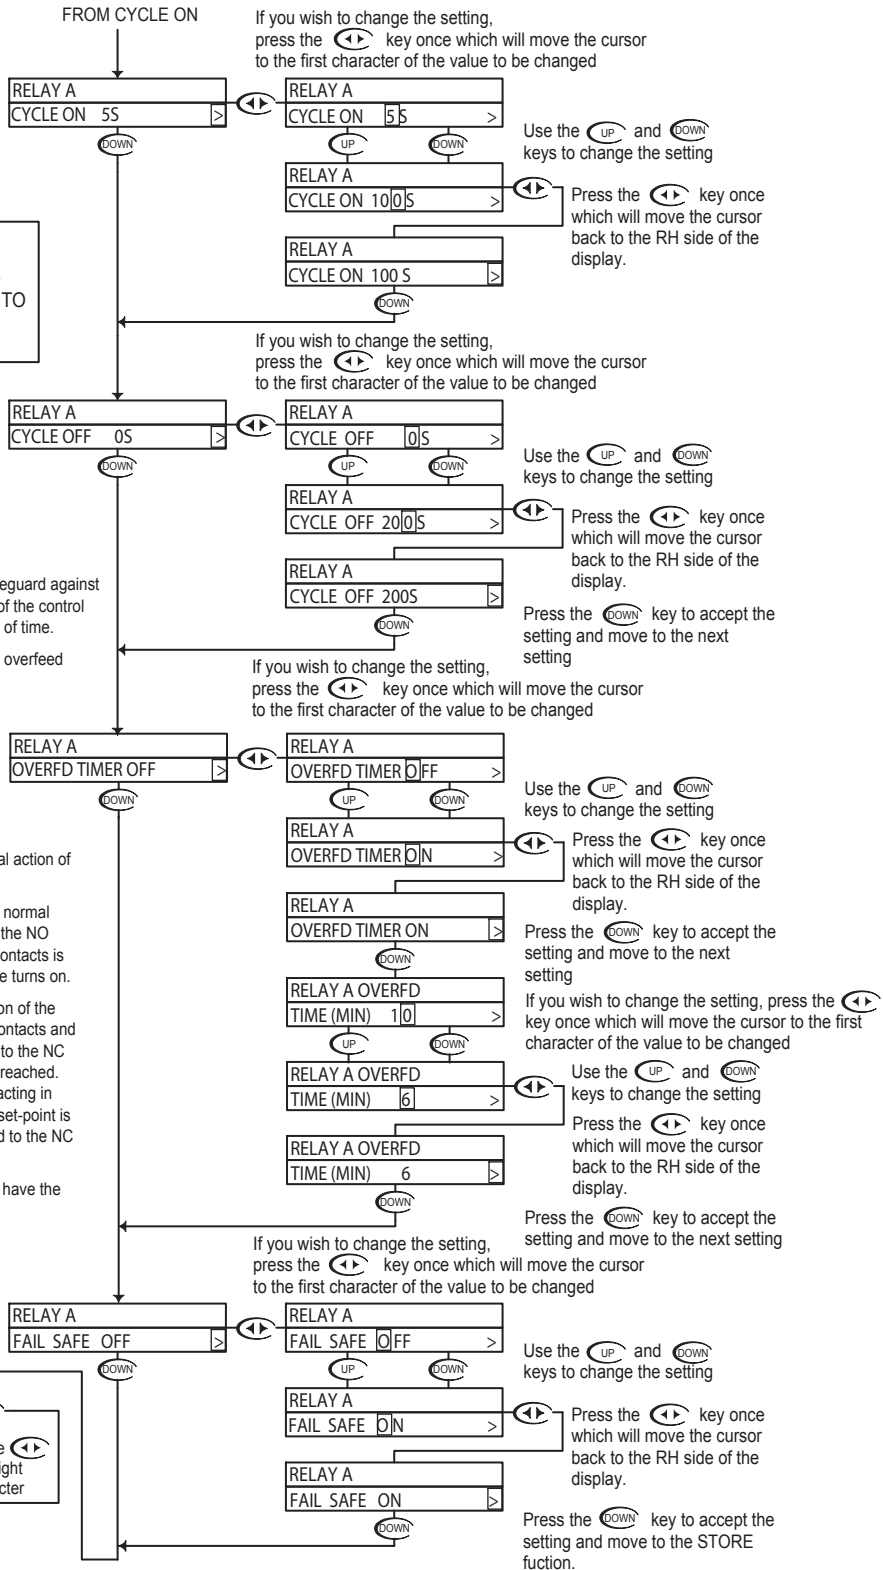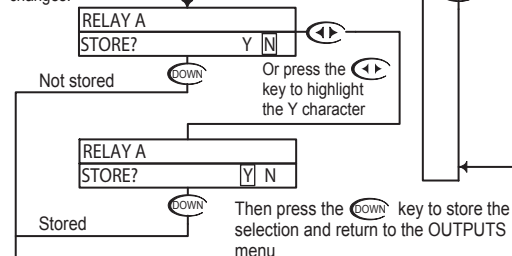



ORP - Outputs Menu - Relay B 5.18

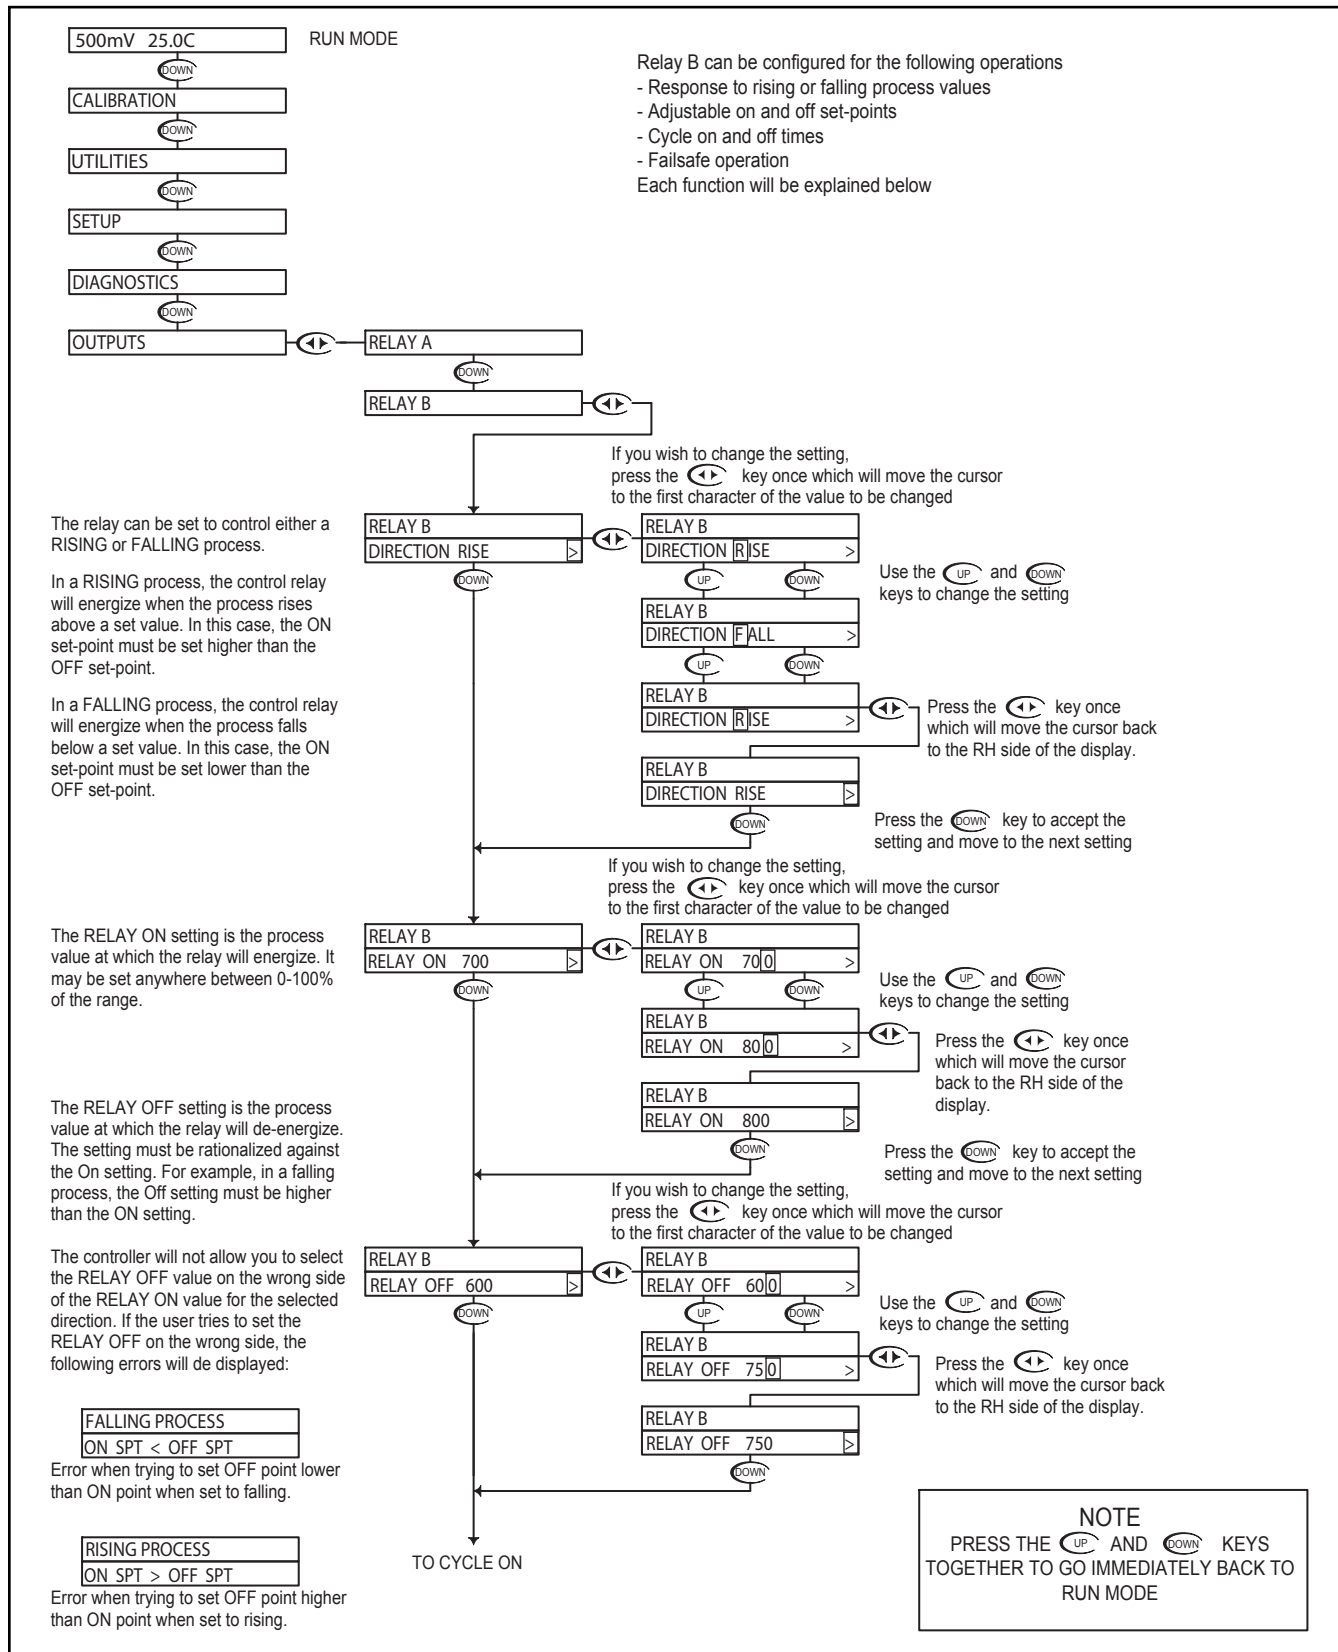



ORP - Outputs Menu - Relay B 5.18

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds. The default ON time is 5 seconds.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0.

The Default OFF time is 0 seconds.

The OVERFEED TIMER is designed to help safeguard against a process or instrumentation error causing one of the control relays to remain energized for extended periods of time.

When enabled, the user must select the desired overfeed timeout time (1-999 min.)

If the overfeed timer times out:

- Alarm relay will energize.
- Control (A&B) will de-energize
- LED on front will flash

Must be reset via Utilities Menu or Power reset.



The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption. For example, a process that needs a constant feed, would want a pump to turn on in the event of a controller power failure.

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

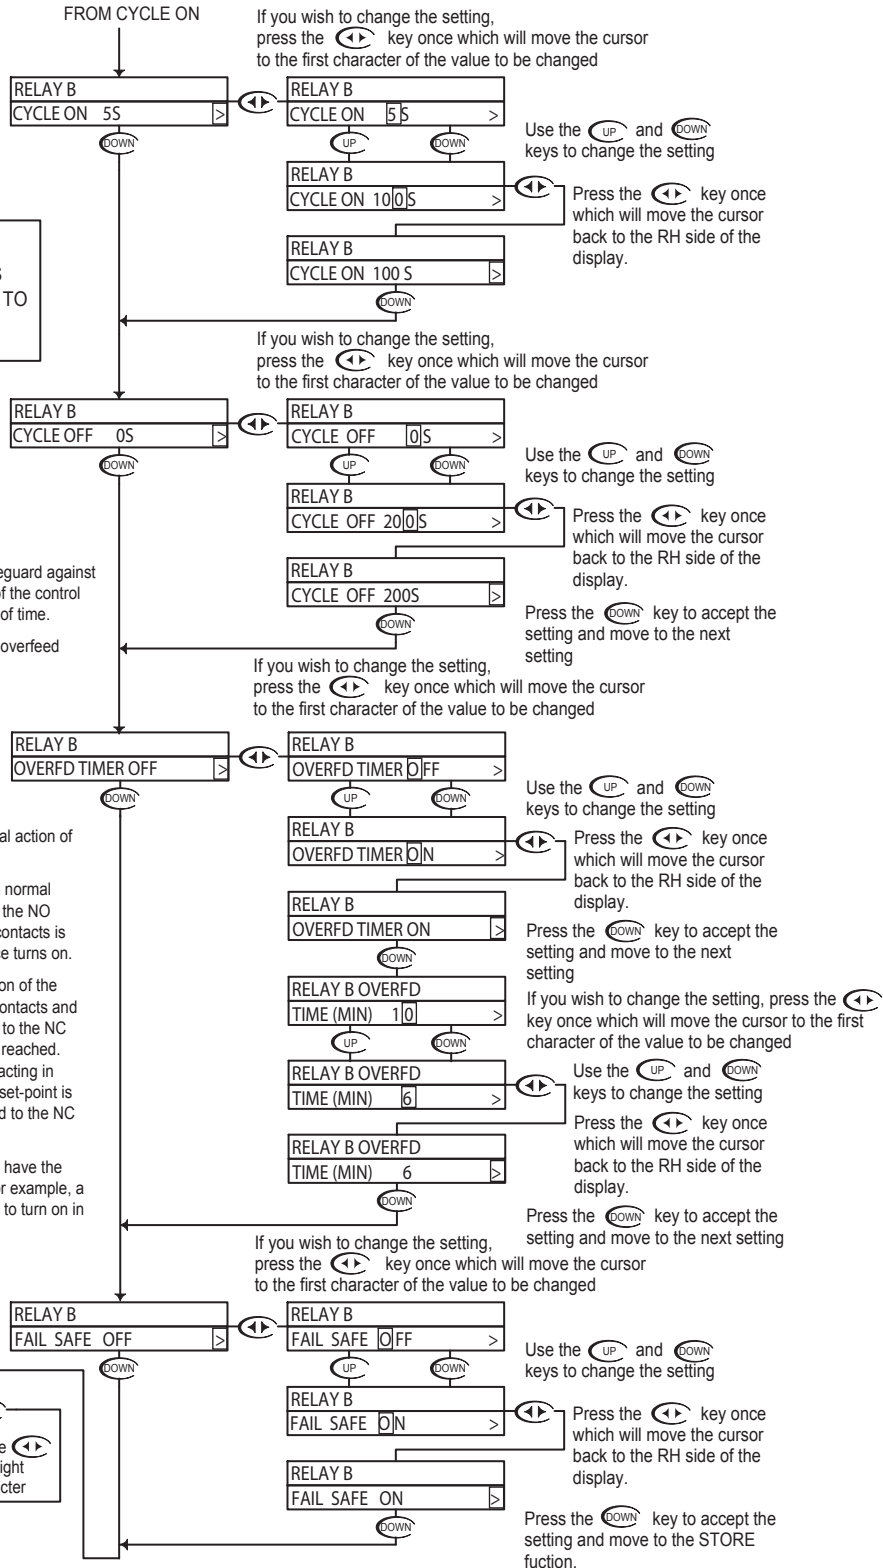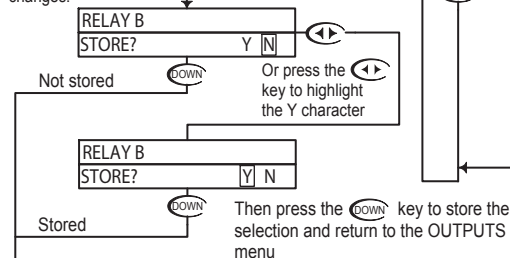



ORP - Outputs Menu - Alarm Relay 5.19

500mV 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

DOWN

OUTPUTS

RELAY A

DOWN

RELAY B

DOWN

ALARM RELAY

DOWN

The LOW ON set point is the low process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.

ALARM RELAY
LOW ON 250

DOWN

If you wish to change the setting, press the **←→** key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
LOW ON 250

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

ALARM RELAY
LOW ON 275

Press the **←→** key once which will move the cursor back to the RH side of the display.

ALARM RELAY
LOW ON 275

DOWN

Press the **DOWN** key to accept the setting and move to the next setting

The LOW OFF set point is the value that the process must reach in order to de-energize the alarm relay after it has dropped below and tripped the LOW ON set-point. This value must be higher than the LOW ON Set-point.

ALARM RELAY
LOW OFF 300

DOWN

If you wish to change the setting, press the **←→** key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
LOW OFF 300

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

ALARM RELAY
LOW OFF 325

Press the **←→** key once which will move the cursor back to the RH side of the display.

ALARM RELAY
LOW OFF 325

DOWN

Press the **DOWN** key to accept the setting and move to the next setting

The HIGH ON set-point is the high process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.

ALARM RELAY
HIGH ON 750

DOWN

If you wish to change the setting, press the **←→** key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
HIGH ON 750

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

ALARM RELAY
HIGH ON 900

Press the **←→** key once which will move the cursor back to the RH side of the display.

ALARM RELAY
HIGH ON 900

DOWN

TO HIGH OFF

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE


The ALARM RELAY will respond to both a rising and falling process. The ALARM RELAY will act as a low alarm (falling process) and a high alarm (rising process). Both relay bands will have independently adjustable on and off set-points. If a low alarm set-point is set at a value 800mV for example, the off set-point must be set higher. The controller will not let the user input a value below 800mV. The same rule holds true for the high alarm.

The Alarm Relay can be configured for the following operations


- LOW ON Set-point
- LOW OFF Set-point
- HIGH ON Set-point
- HIGH OFF Set-point
- Failsafe



ORP - Outputs Menu - Alarm Relay 5.19

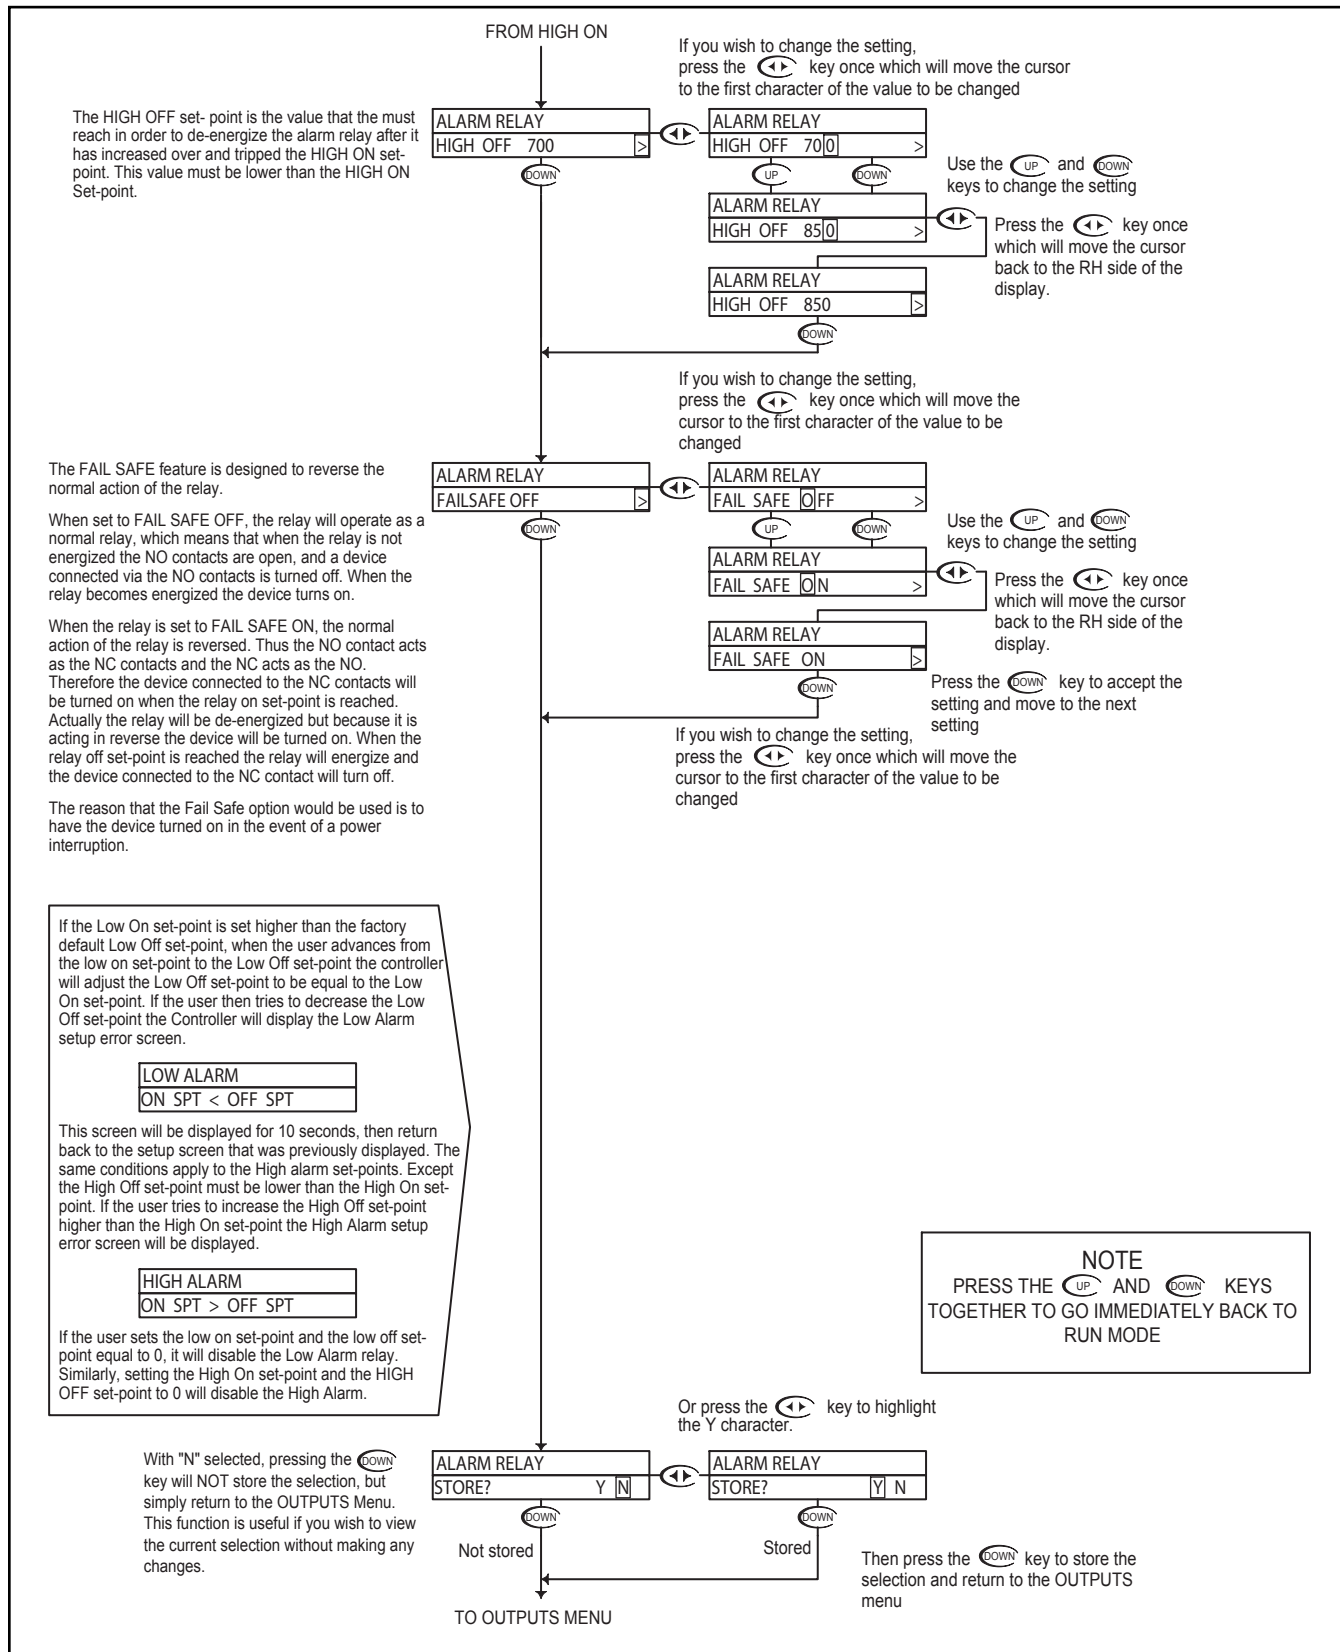


ORP - Outputs Menu - 4-20mA CH1 Output 5.20

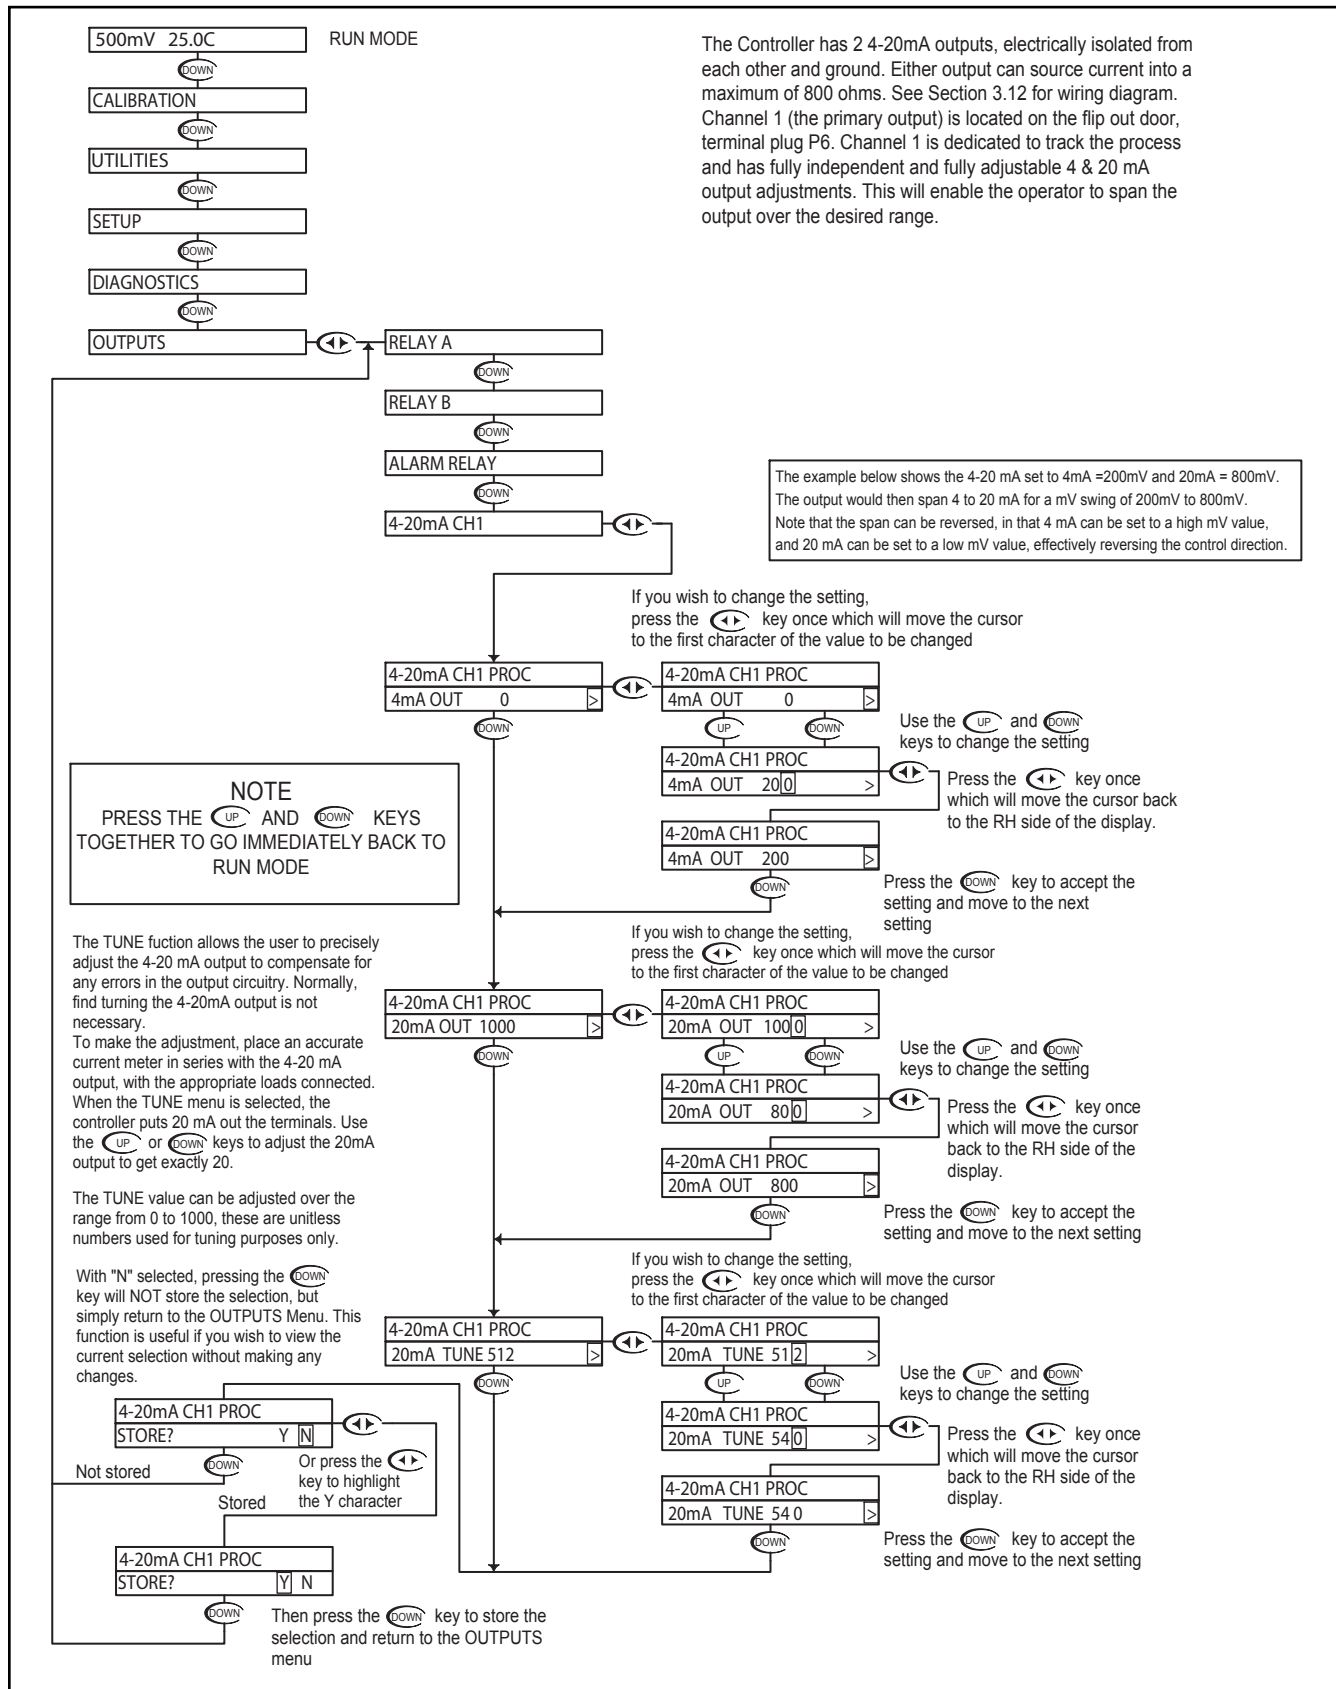



ORP - Outputs Menu - 4-20mA CH2 Output 5.21

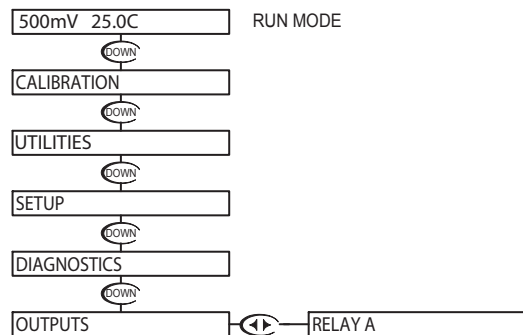

The Controller has 2 4-20mA outputs, electrically isolated from each other and ground. Either output can source current into a maximum of 800 ohms.

Channel 2 can be selected to track the process or temperature.


Channel 2 has fully independent and fully adjustable 4 & 20 mA output adjustments. This will enable the operator to span the output over the desired range.

Note that if the T DISP OVERRIDE is ON and Channel 2 output is set to track temperature, the output will not change, but hold at a value representing the temperature set in the T DISP OVERRIDE.


The example below shows the 4-20 mA set to 4mA = 0°C and 20mA = 100°C

The output would then span 4 to 20 mA for a temperature swing of 0°C to 100°C.


Note that the span can be reversed, in that 4 mA can be set to a high process value, and 20 mA can be set to a low process value, effectively reversing the control direction.

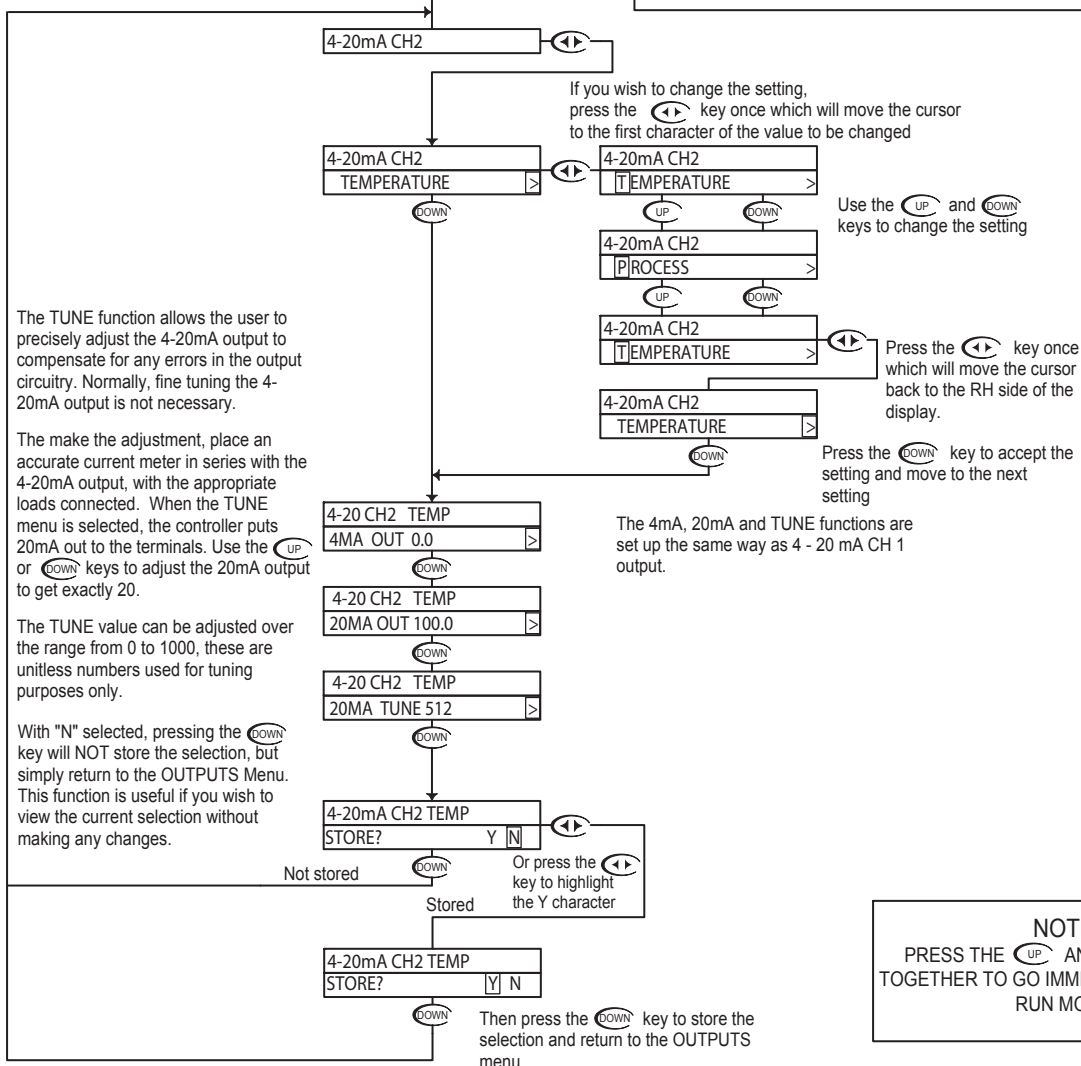

NOTE
PRESS THE UP AND DOWN KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

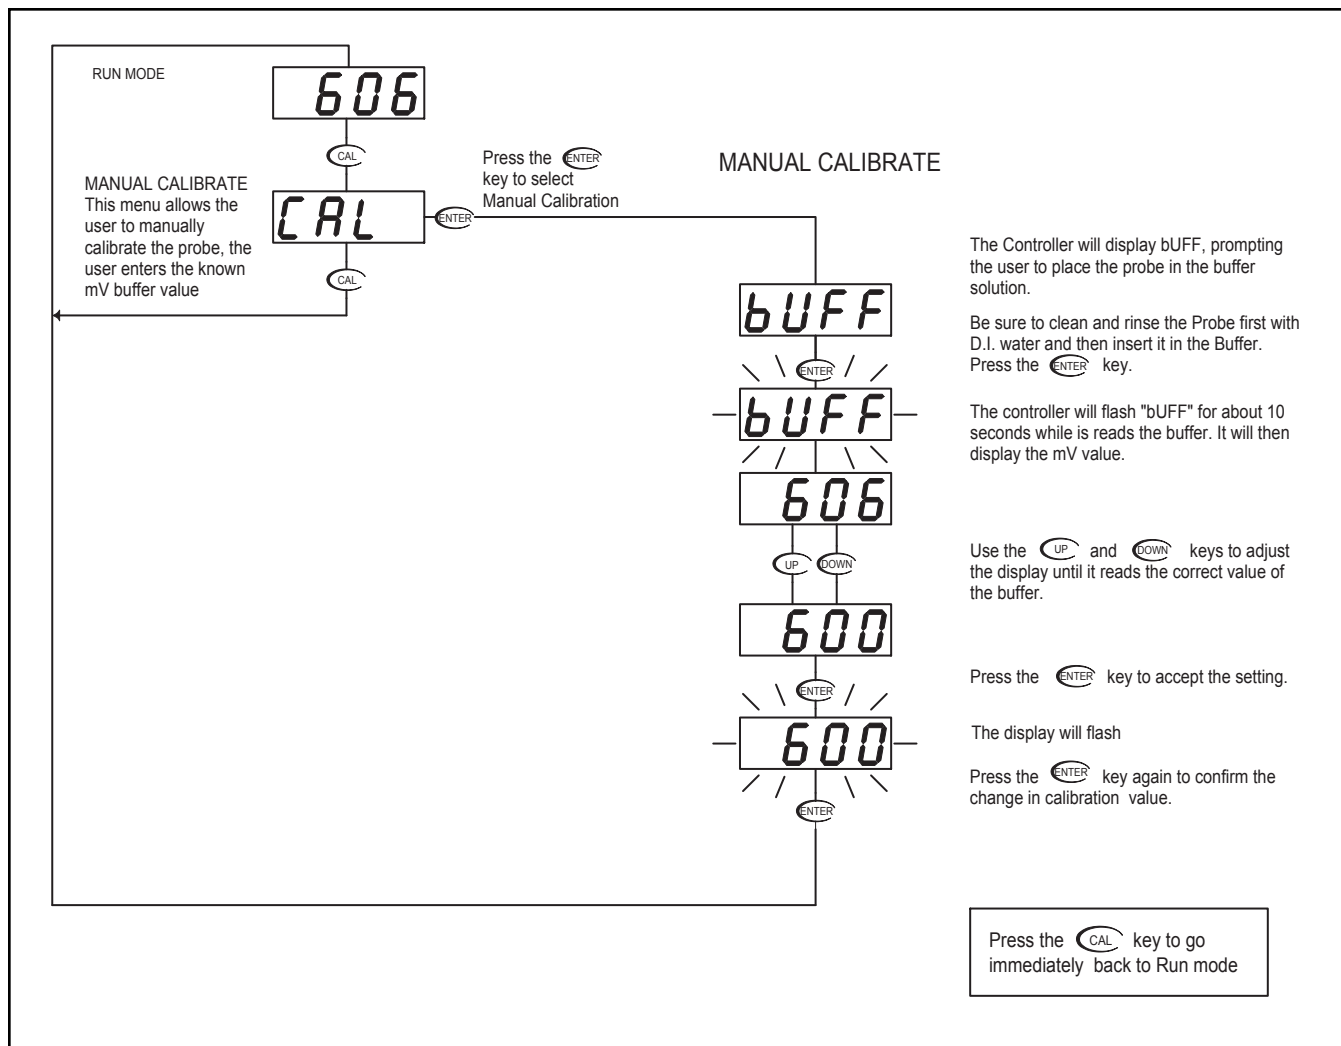


Section 6 - Using the SHARK in Conductivity Mode

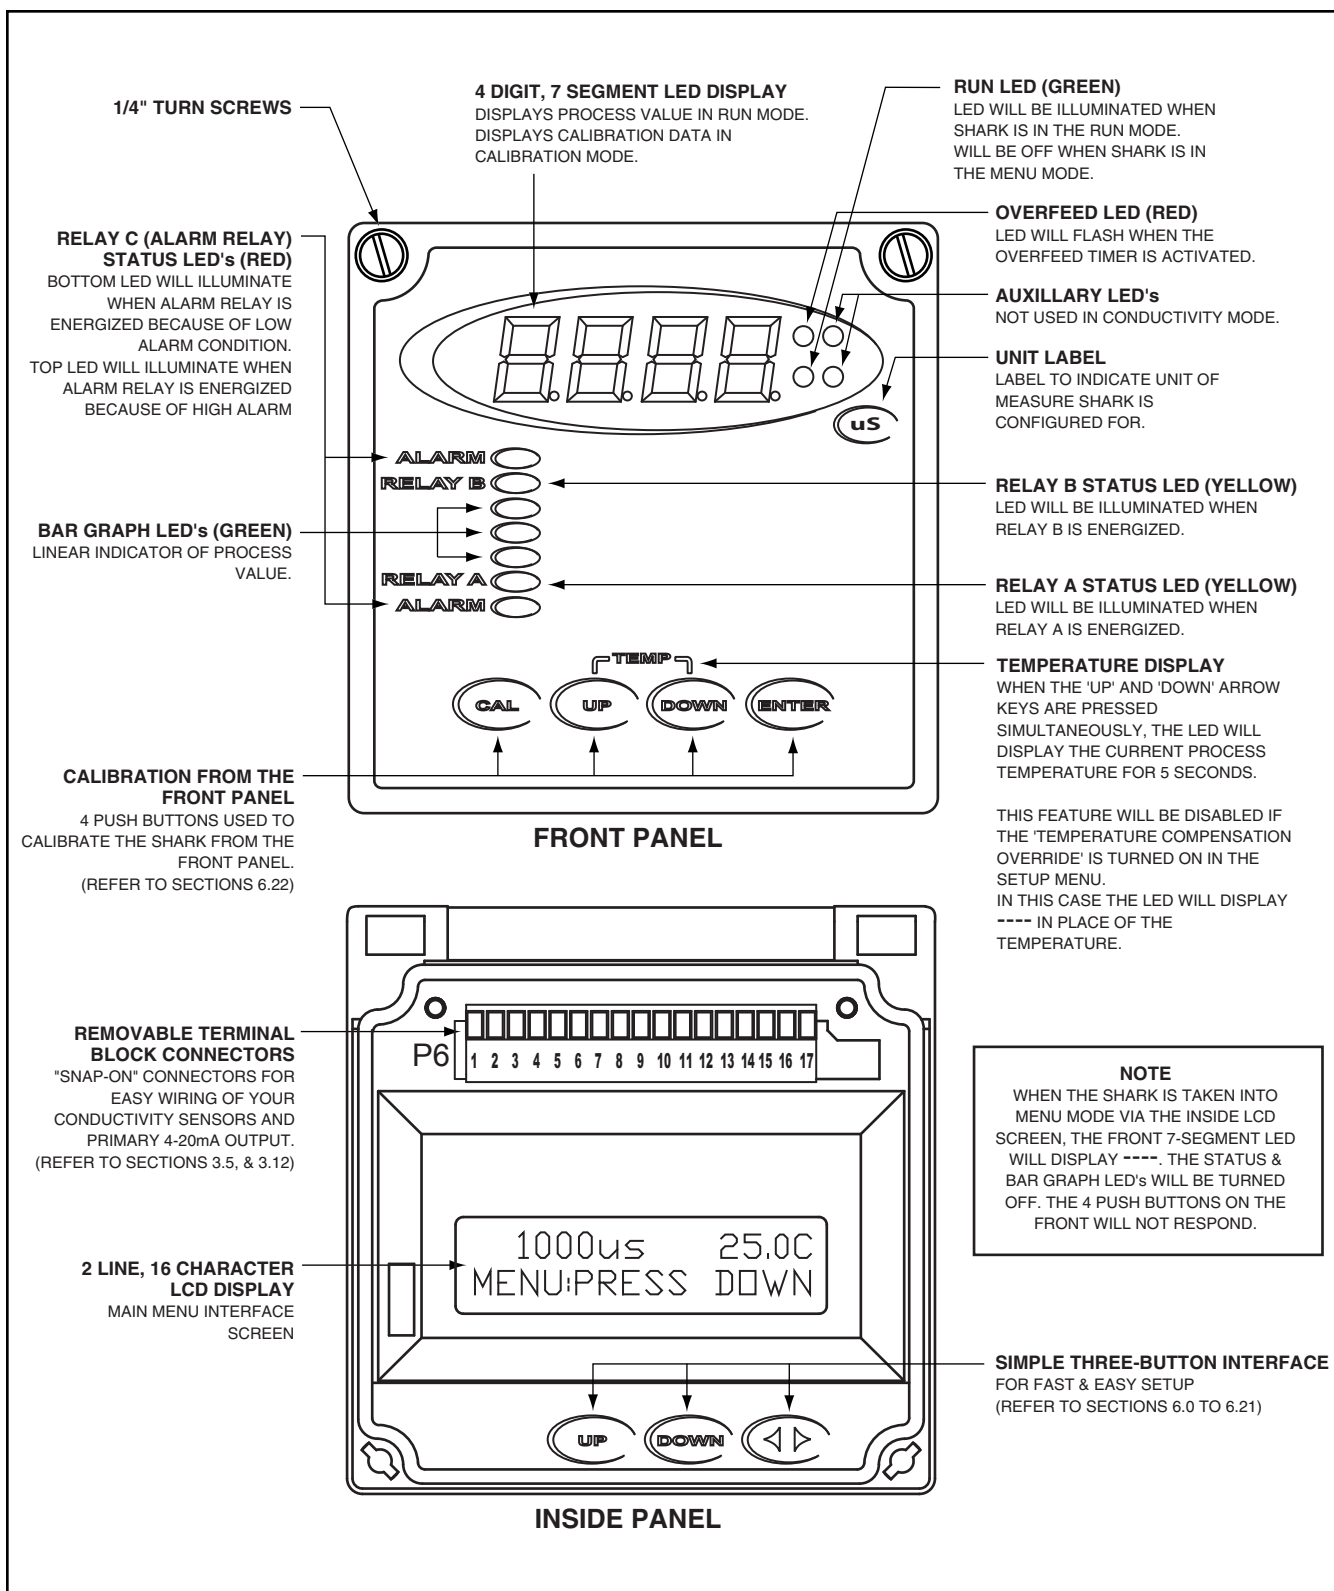



Conductivity - Menu Overview 6.0

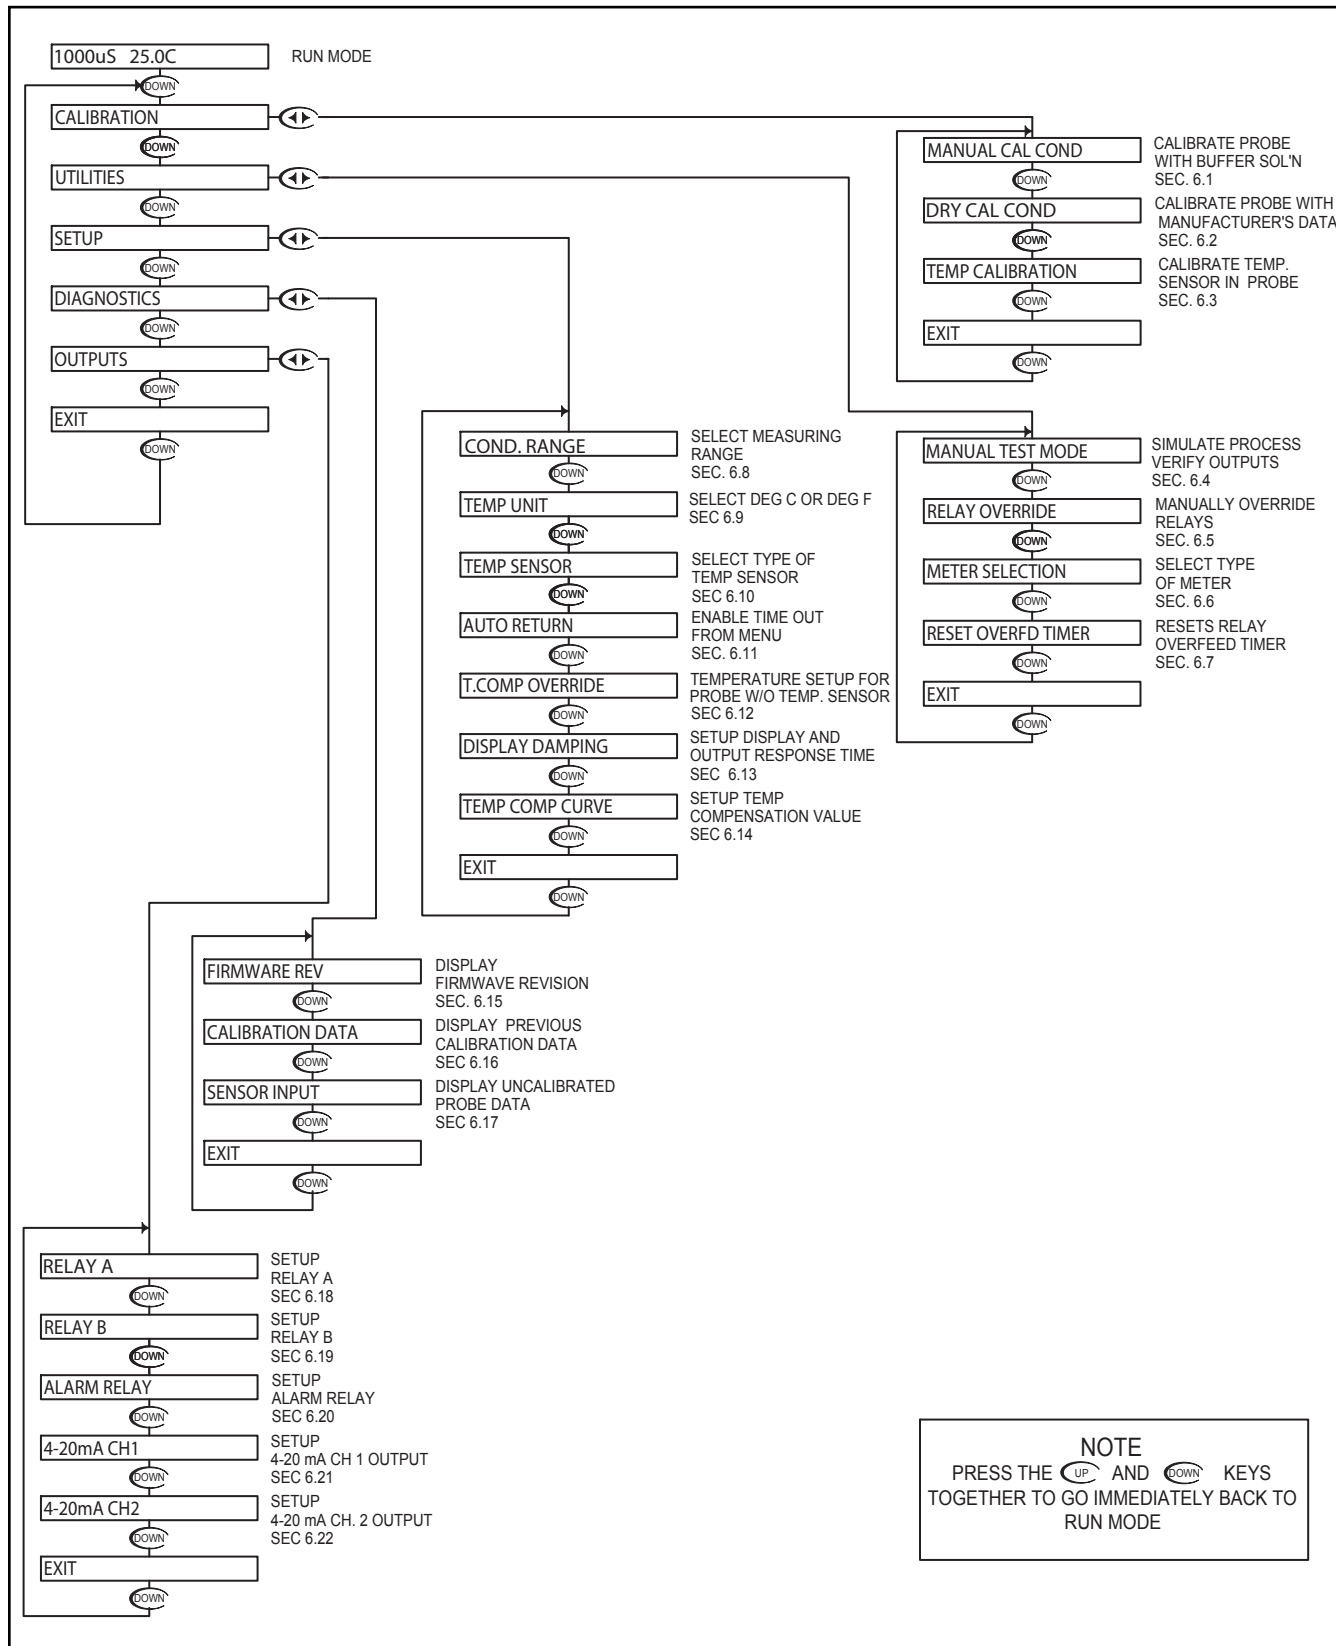



Conductivity - Calibration Menu - Manual Calibrate 6.1

Manual Calibration is used to "wet calibrate the cell". This can be done with the cell installed in the process, or with the cell suspended in a known buffer solution.

When calibrated "In Process", the actual conductivity is determined with a grab sample or a hand held meter, and the value entered in the display.

When calibrated with buffers, the cell is placed in a known buffer solution, and the value of the buffer entered on the display.

In both cases, make sure the cell has time to stabilize both in temperature and conductivity before entering any data.

1000uS 25.0C RUN MODE

CALIBRATION

MANUAL CAL COND

MANUAL CAL COND

967 uS

MANUAL CAL COND

967 uS

MANUAL CAL COND

1000 uS

MANUAL CAL COND

1000 uS

If the calibration is OK, use the key to move the cursor over the Y text and press the down key.

MANUAL CAL COND

STORE? Y N

MANUAL CAL COND

STORE? Y N

If the calibration did not appear to be correct, press the key which will return back to the Manual Cal Cond menu.

Place the cell in the buffer solution

The controller will read the Conductivity value, averaging a number of results to get a stable calibration value.

Press the key once which will move the cursor over the least sign. digit of the display.

Use the and keys to adjust the reading until it agrees with the actual buffer conductivity value


Then press to move the cursor to the RH position

Press to store the calibration data and return back to the Manual Cal Cond menu so the user can select another function.

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Conductivity - Calibration Menu - Dry Cal Cond 6.2

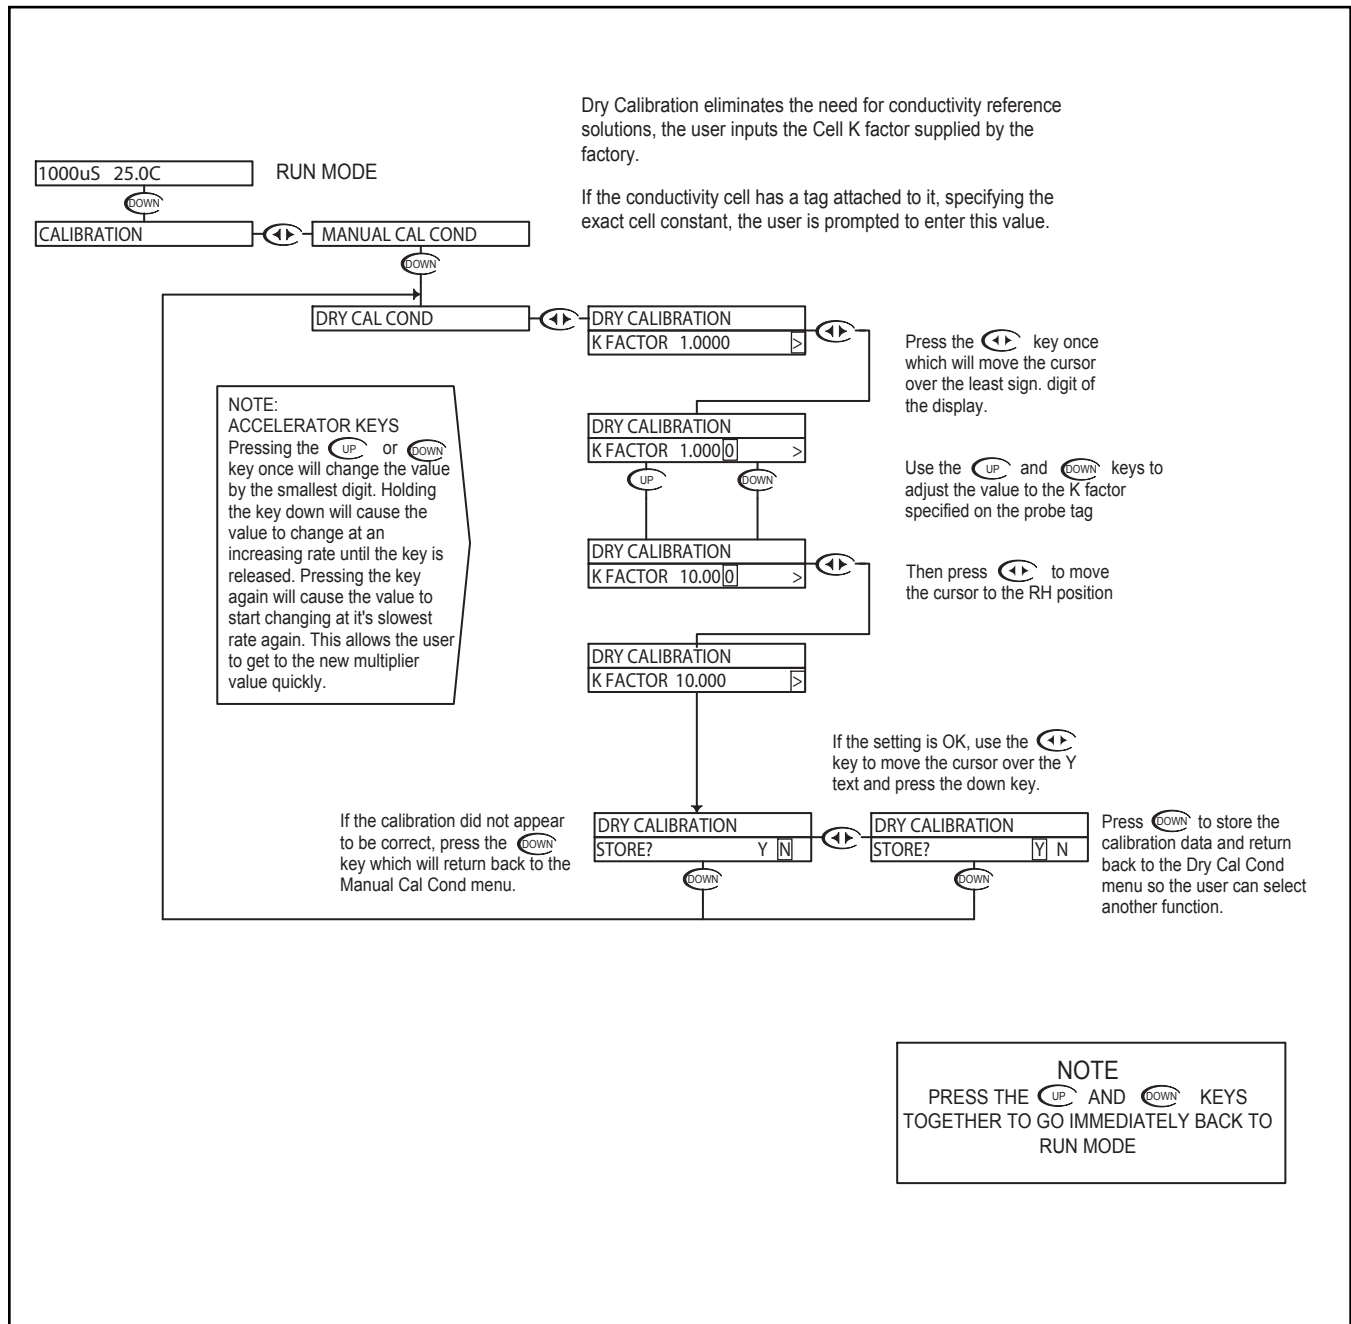



Conductivity - Calibration Menu - Temp. Calibration 6.3


Temperature Calibration

In most cases, the factor temperature calibration is accurate enough to ensure correct temperature readings. However, in some circumstances, the user may wish to ensure the temperature sensor is calibrated accurately, especially when operating at the extreme end of the conductivity cell temperature operating range, or where the temperature compensation is critical to correct process readings.

This menu allows to user to calibrate the temperature anywhere within it's range.

Be aware, that the conductivity reading is affected by the temperature reading (due to the temperature compensation) so accurate temperature calibration is vital to obtaining accurate conductivity readings. If the user is unsure of the calibration test fixture, then it would be best to leave the temperature calibration at it's factory setting.


Be sure to allow the temperature of the cell to stabilize before attempting to calibrate the temperature sensor, this may take a significant amount of time as the sensor is buried behind a protective layer of epoxy which will cause some delay.

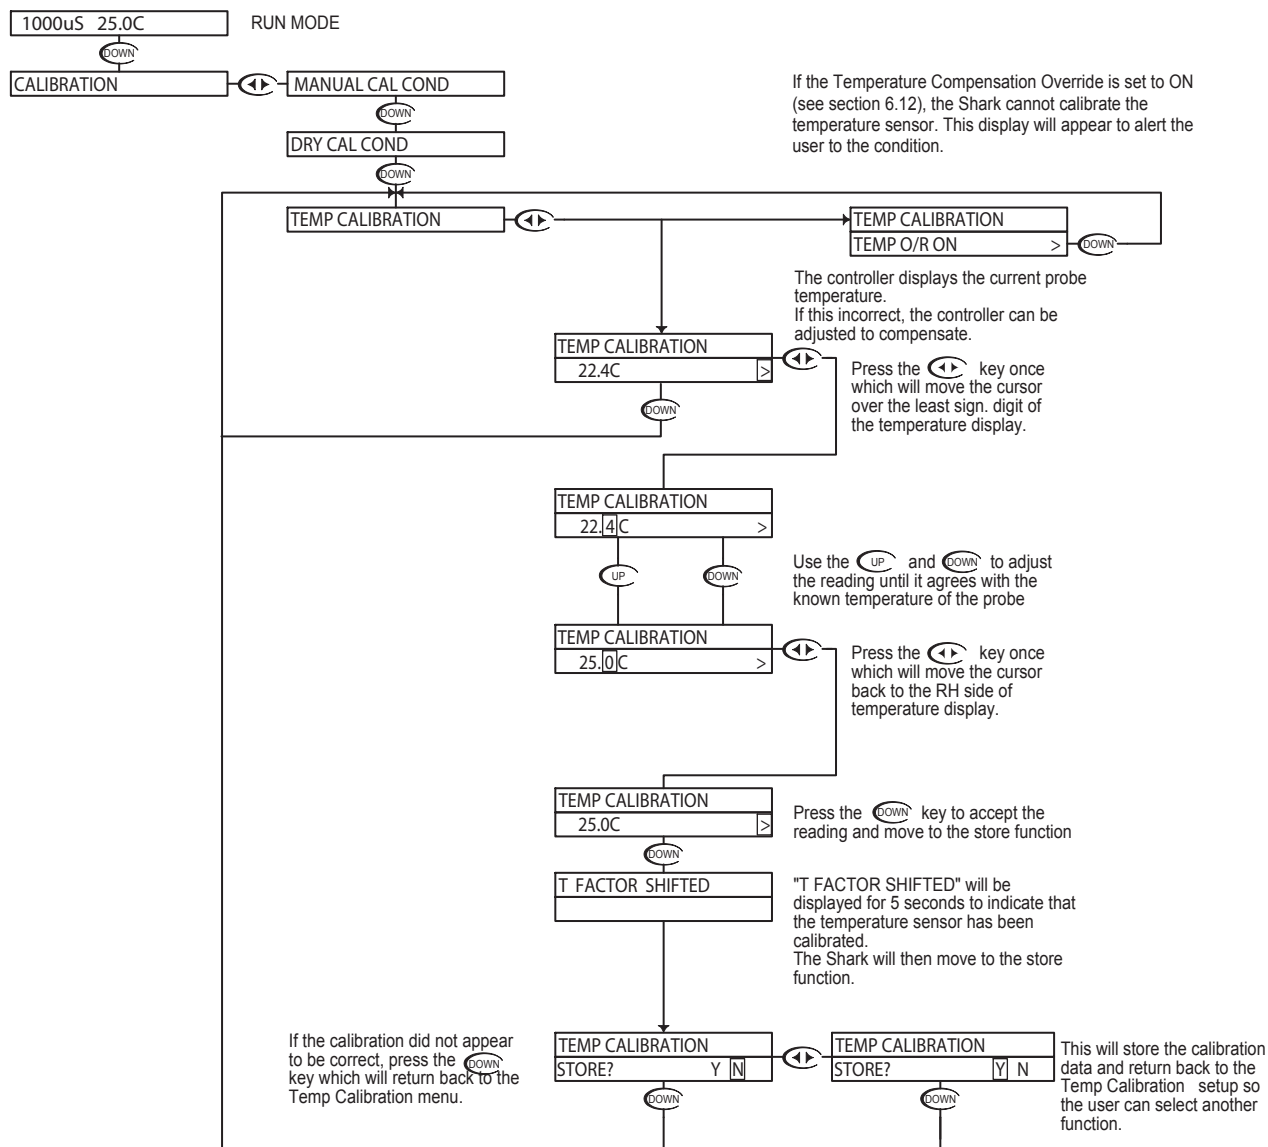

NOTE
PRESS THE AND KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE




Conductivity - Utilities Menu - Manual Test Mode 6.4

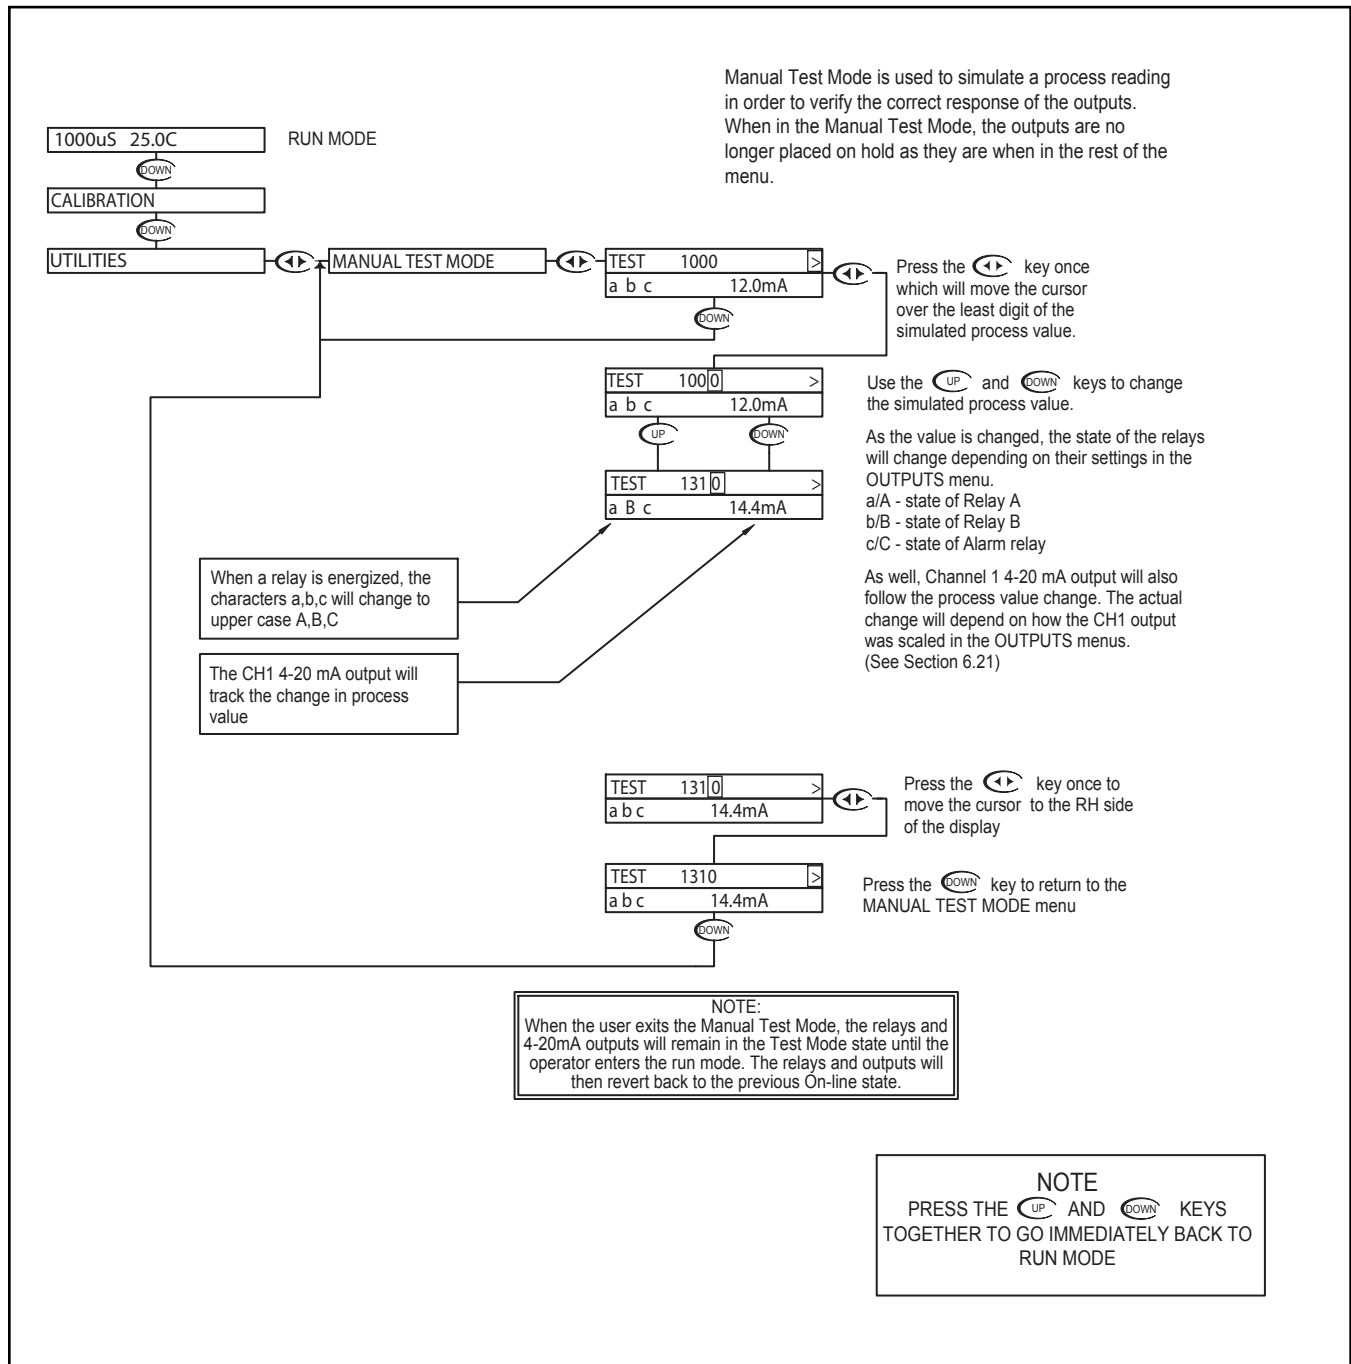




Conductivity - Utilities Menu - Relay Override 6.5

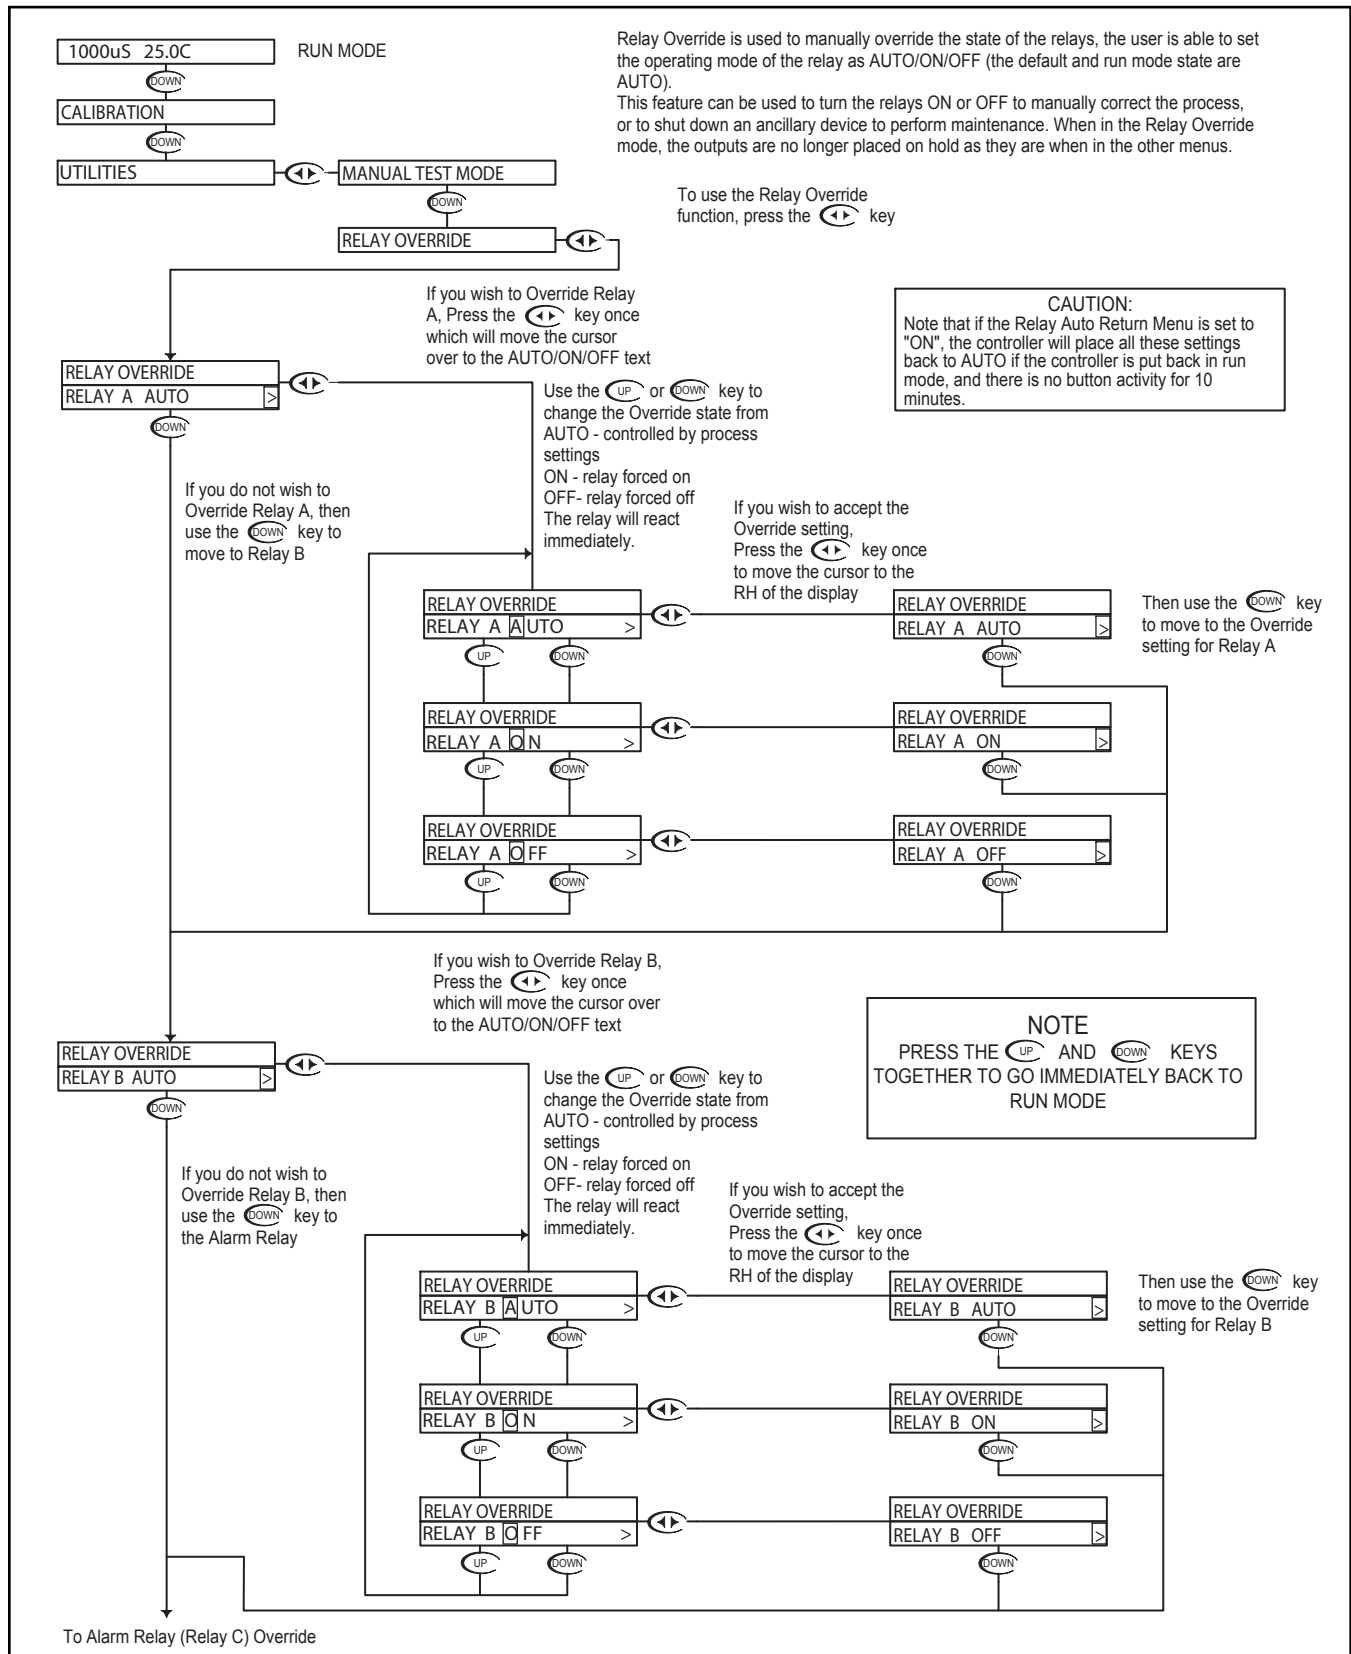




Conductivity - Utilities Menu - Relay Override 6.5

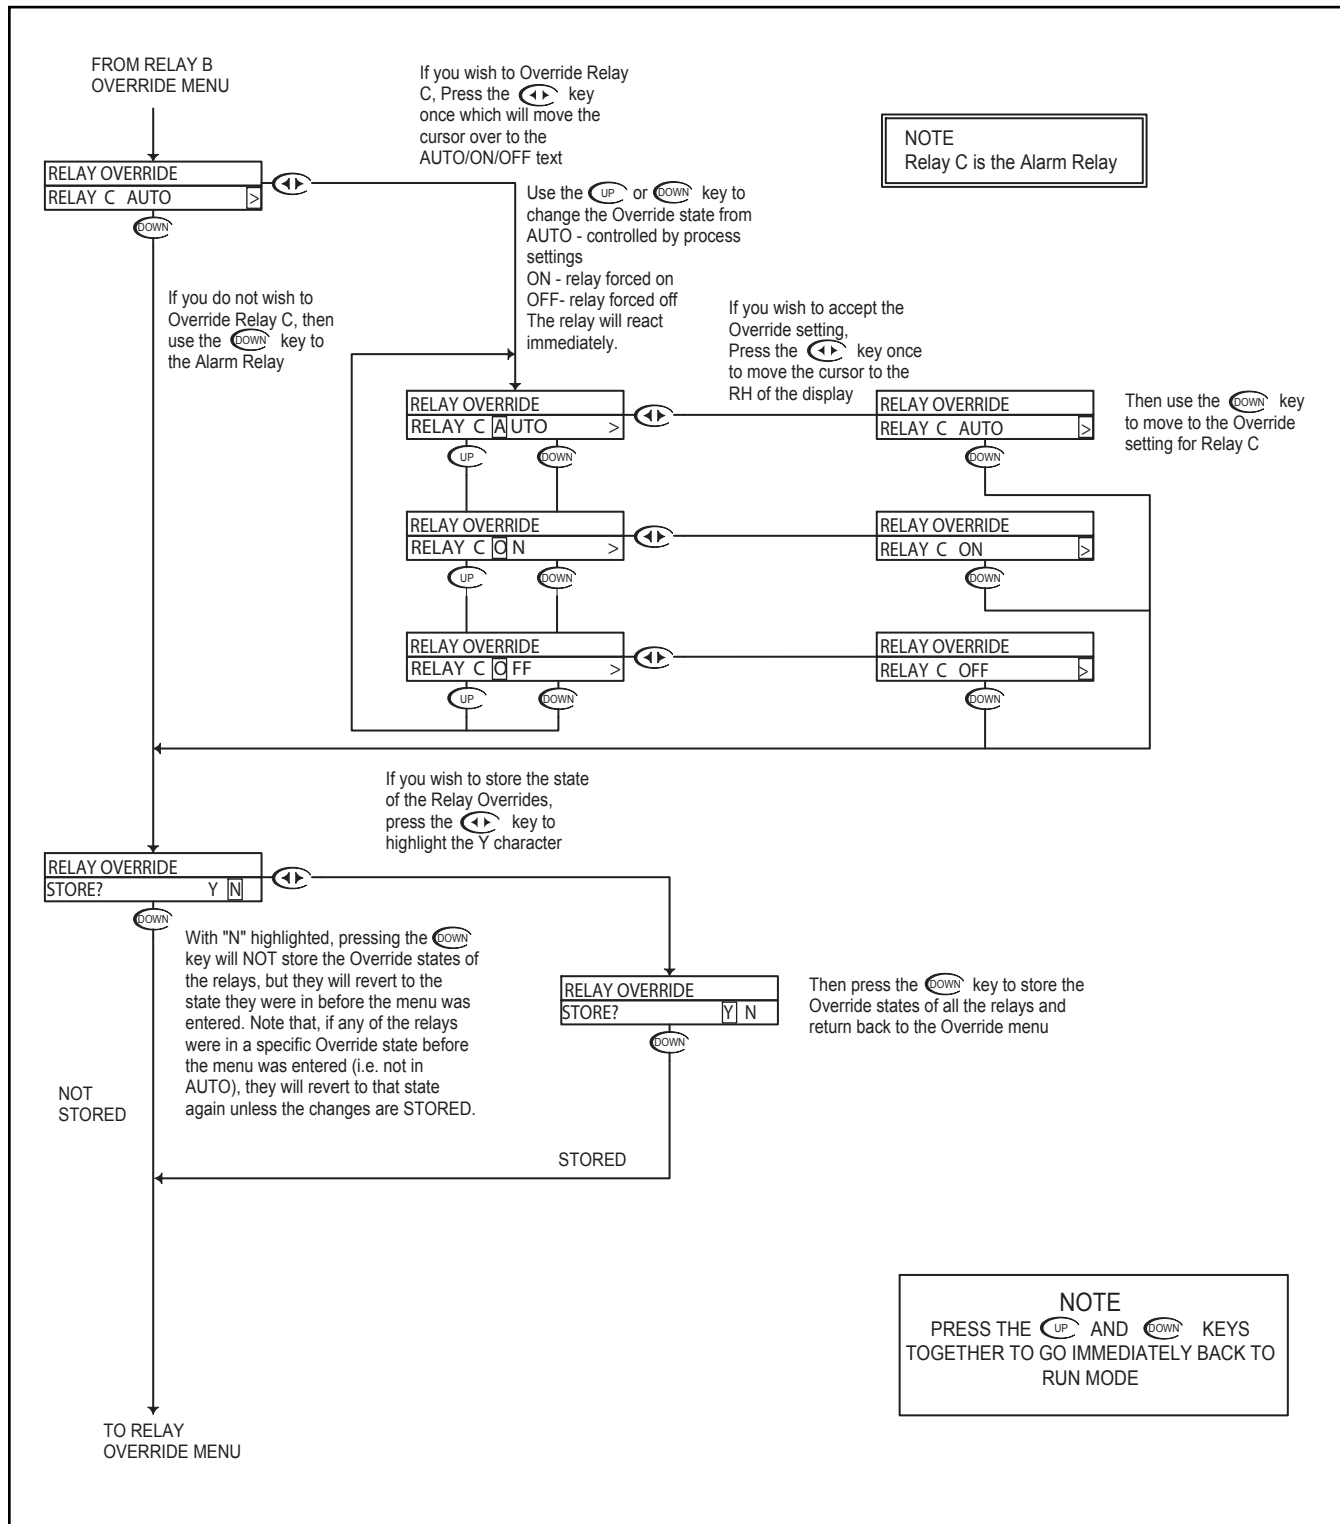



Conductivity - Utilities Menu - Meter Selection 6.6

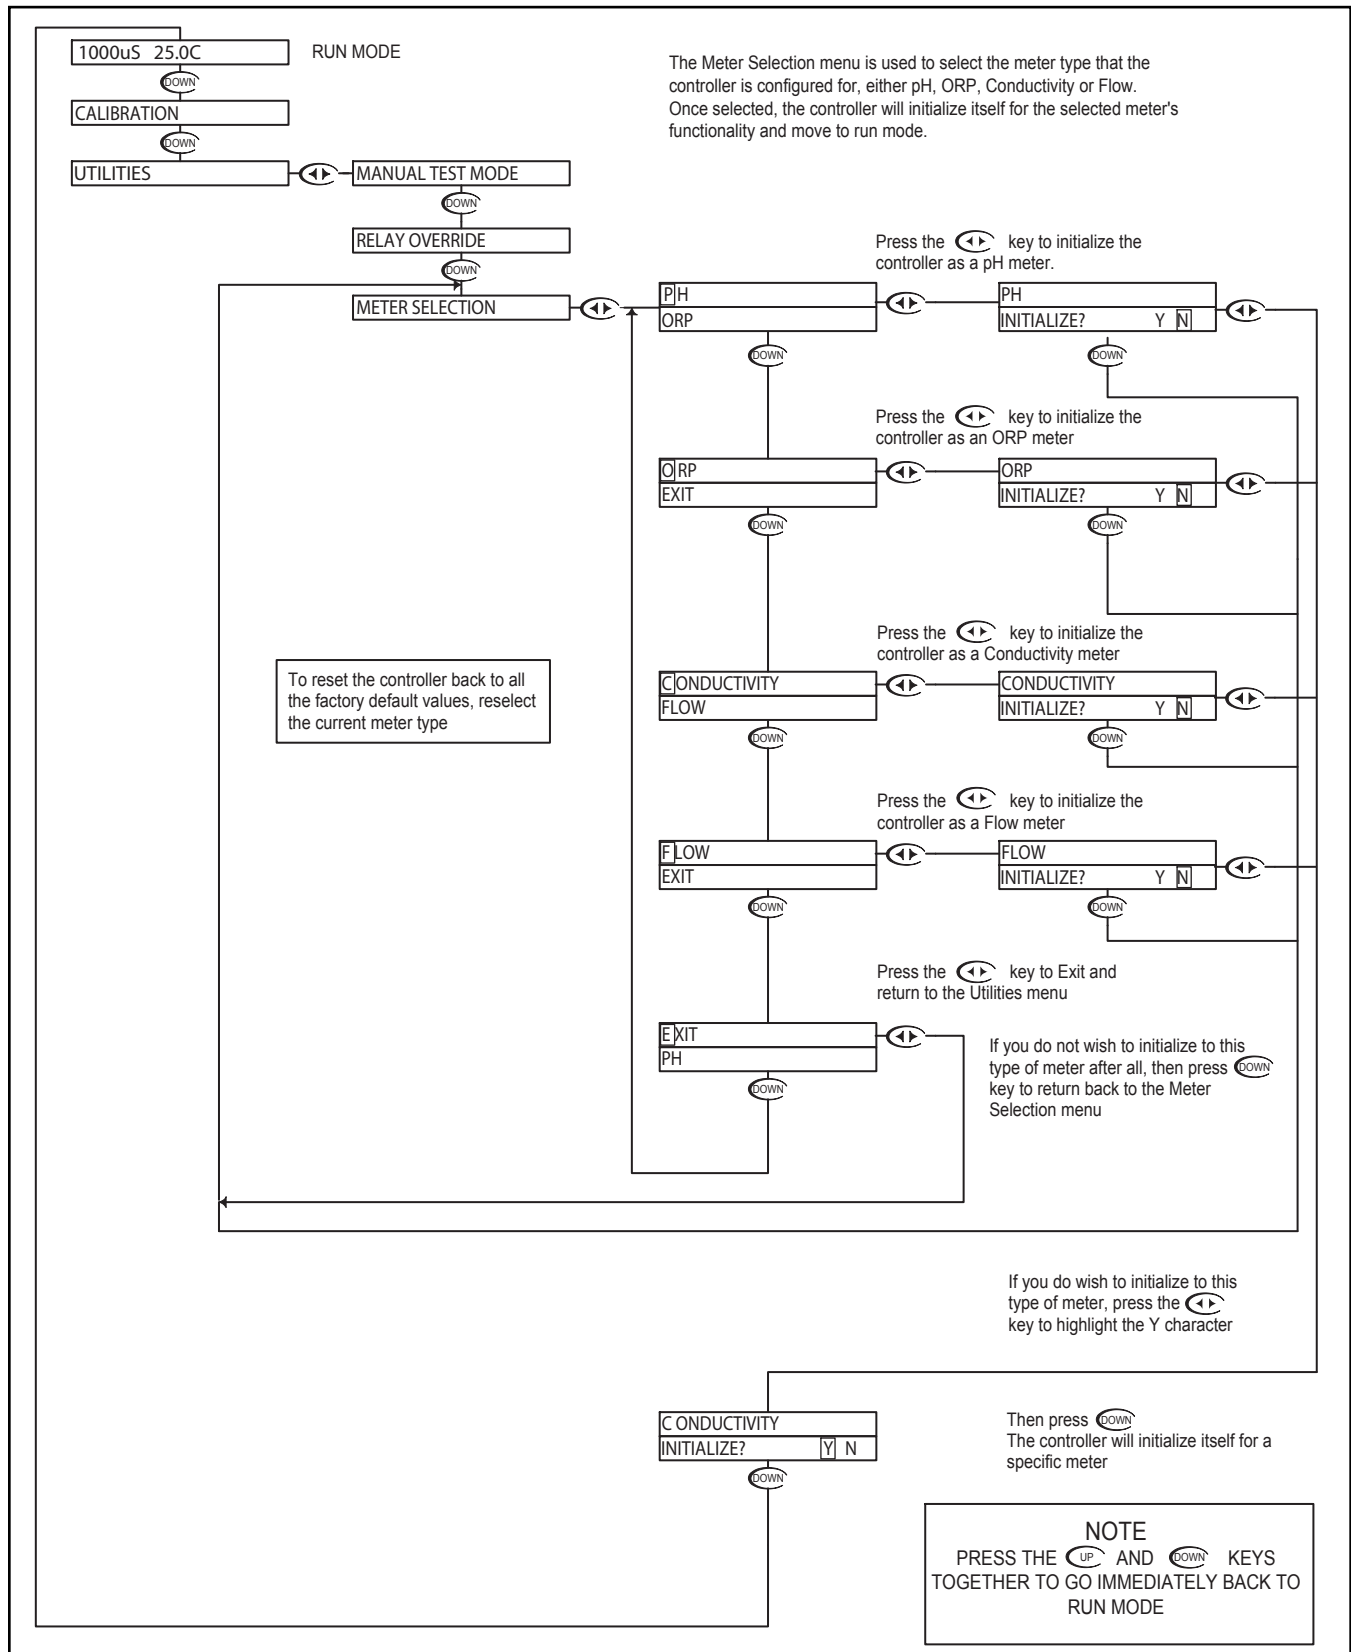



Conductivity - Utilities Menu - Overfeed Timer Reset 6.7

1000uS 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

LEFT/RIGHT

MANUAL TEST MODE

DOWN

RELAY OVERRIDE

DOWN

METER SELECTION

DOWN

RESET OVERFD TMR

LEFT/RIGHT

RESET OVERFD TMR

Y

N

Press the LEFT/RIGHT key to choose between Y or N.

LEFT/RIGHT

Y

N

If you wish to reset the overfeed timer, then press the DOWN key to proceed and return back to the Utilities menu.

DOWN

DOWN


If you do not wish to reset the overfeed timer after all, press the LEFT/RIGHT key to highlight the N character and press the DOWN key to return back to the Utilities menu.

NOTE

PRESS THE UP AND DOWN KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




Conductivity - Setup Menu - Conductivity Range 6.8

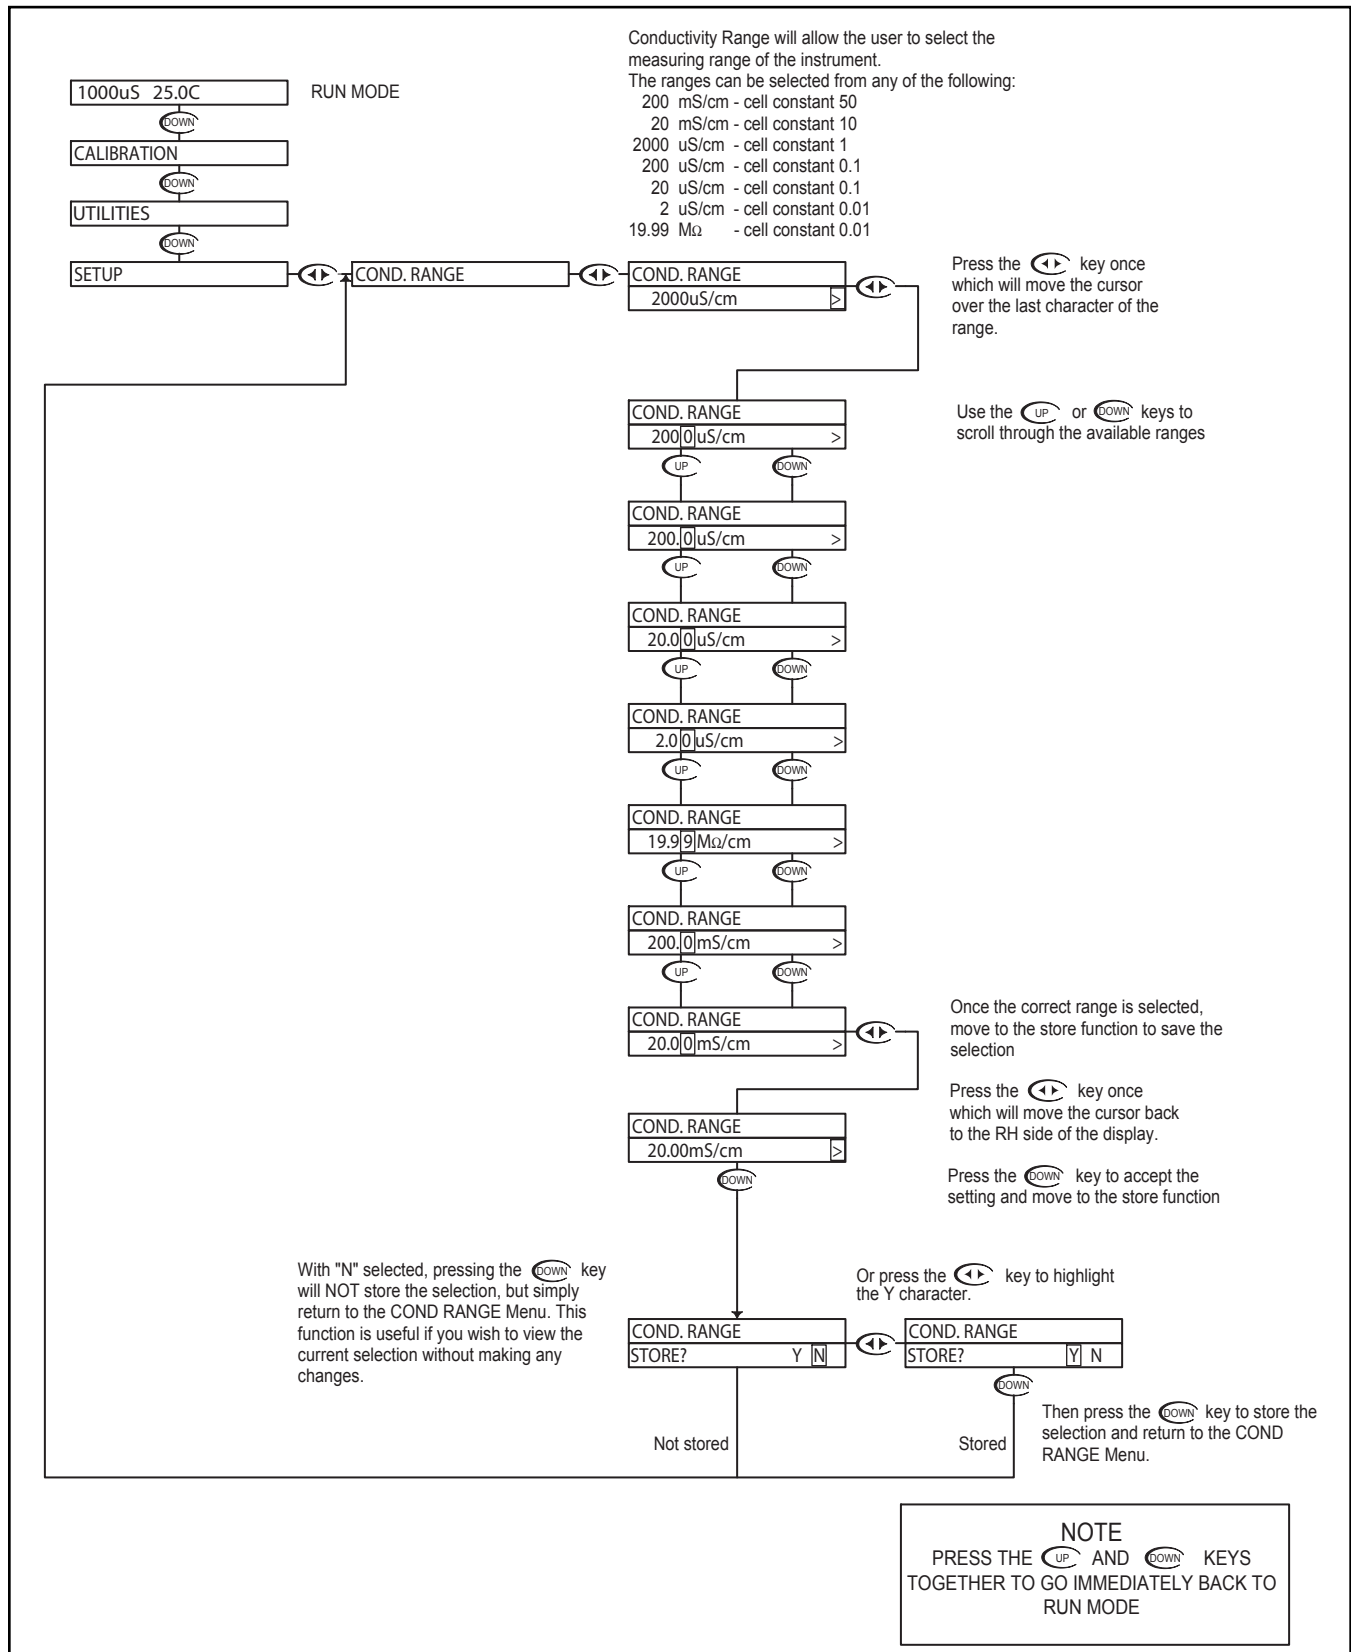



Conductivity - Setup Menu - Temp. Unit 6.9

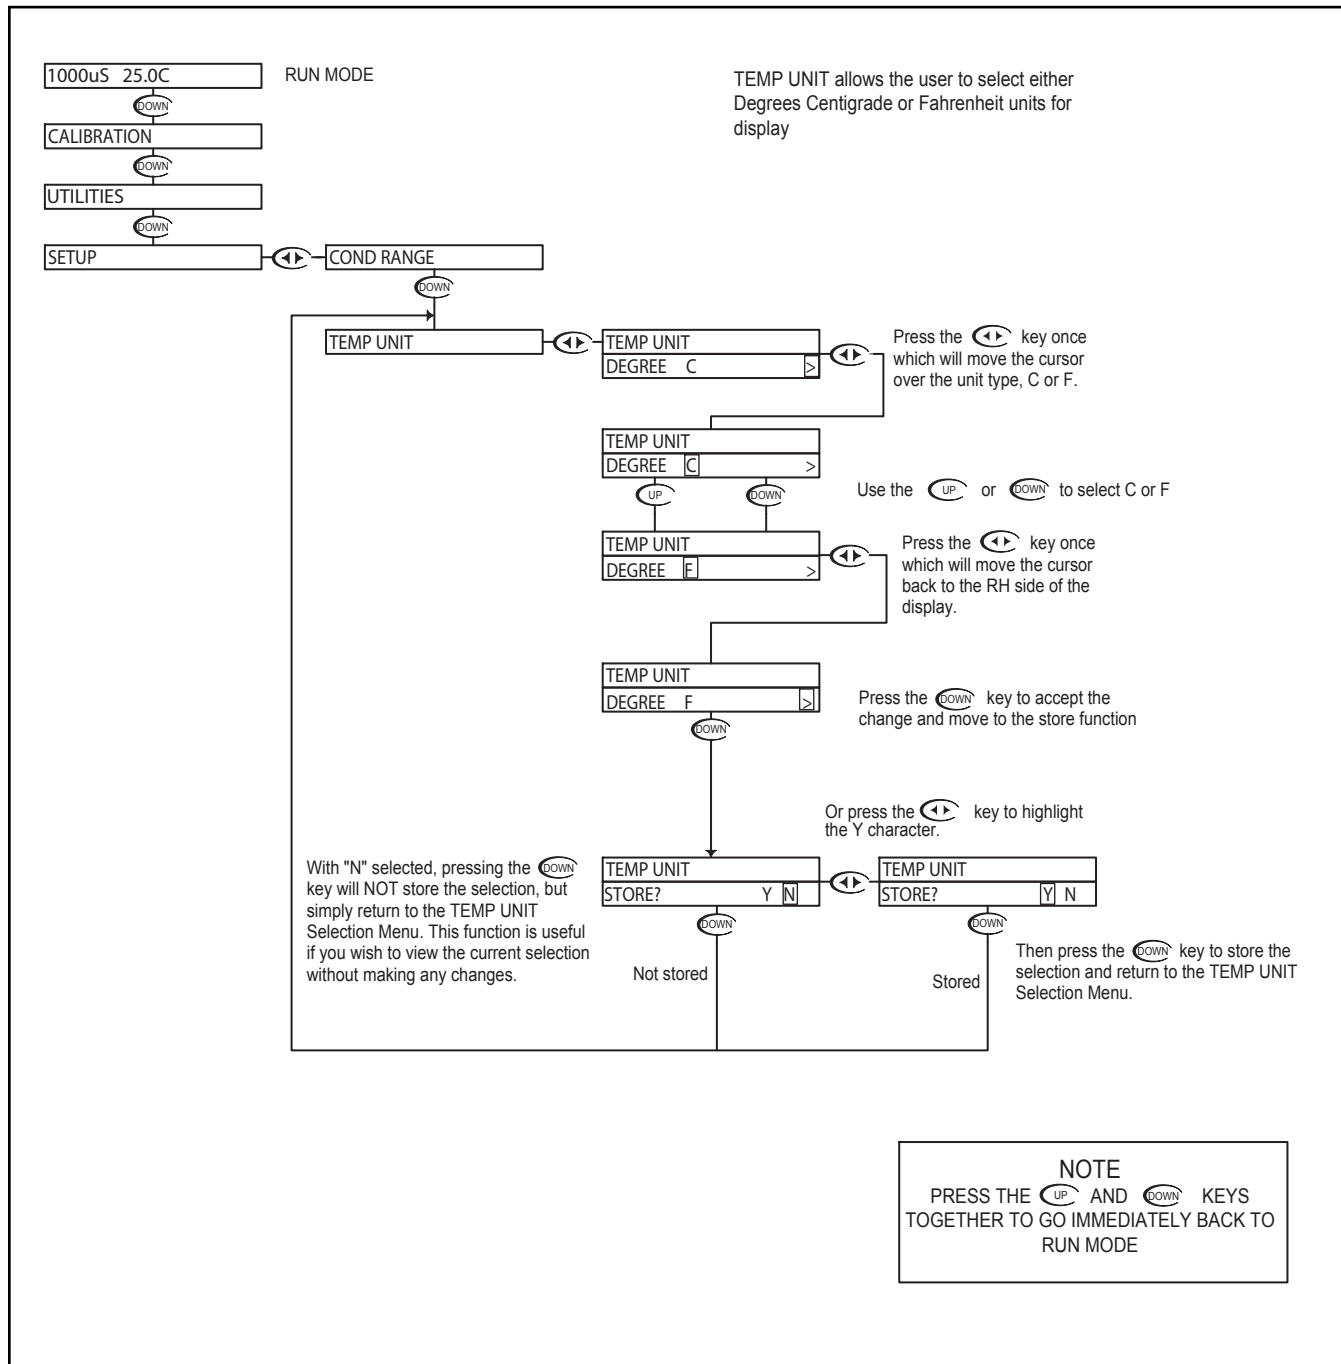



Conductivity - Setup Menu - Temp. Sensor 6.10

1000uS 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

COND RANGE

DOWN

TEMP UNIT

TEMP SENSOR

TEMP SENSOR
3000 Ω NTC

Press the key once which will move the cursor over to the sensor type.

Use the or to select the sensor type

TEMP SENSOR
3000 Ω NTC

UP

DOWN

TEMP SENSOR
300 Ω NTC

UP

DOWN

TEMP SENSOR
1000 Ω RTD

UP

DOWN

Once the correct Sensor has been selected press the key once which will move the cursor back to the RH side of the display.

TEMP SENSOR
3000 Ω NTC

DOWN

Press the key to accept the change and move to the store function

With "N" selected, pressing the key will NOT store the selection, but simply return to the TEMP SENSOR Selection Menu. This function is useful if you wish to view the current selection without making any changes.

TEMP SENSOR
STORE? Y N

DOWN

Not stored

Or press the key to highlight the Y character.

TEMP SENSOR
STORE? Y N


DOWN

Then press the key to store the selection and return to the TEMP SENSOR Selection Menu.

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




Conductivity - Setup Menu - Auto Return 6.11

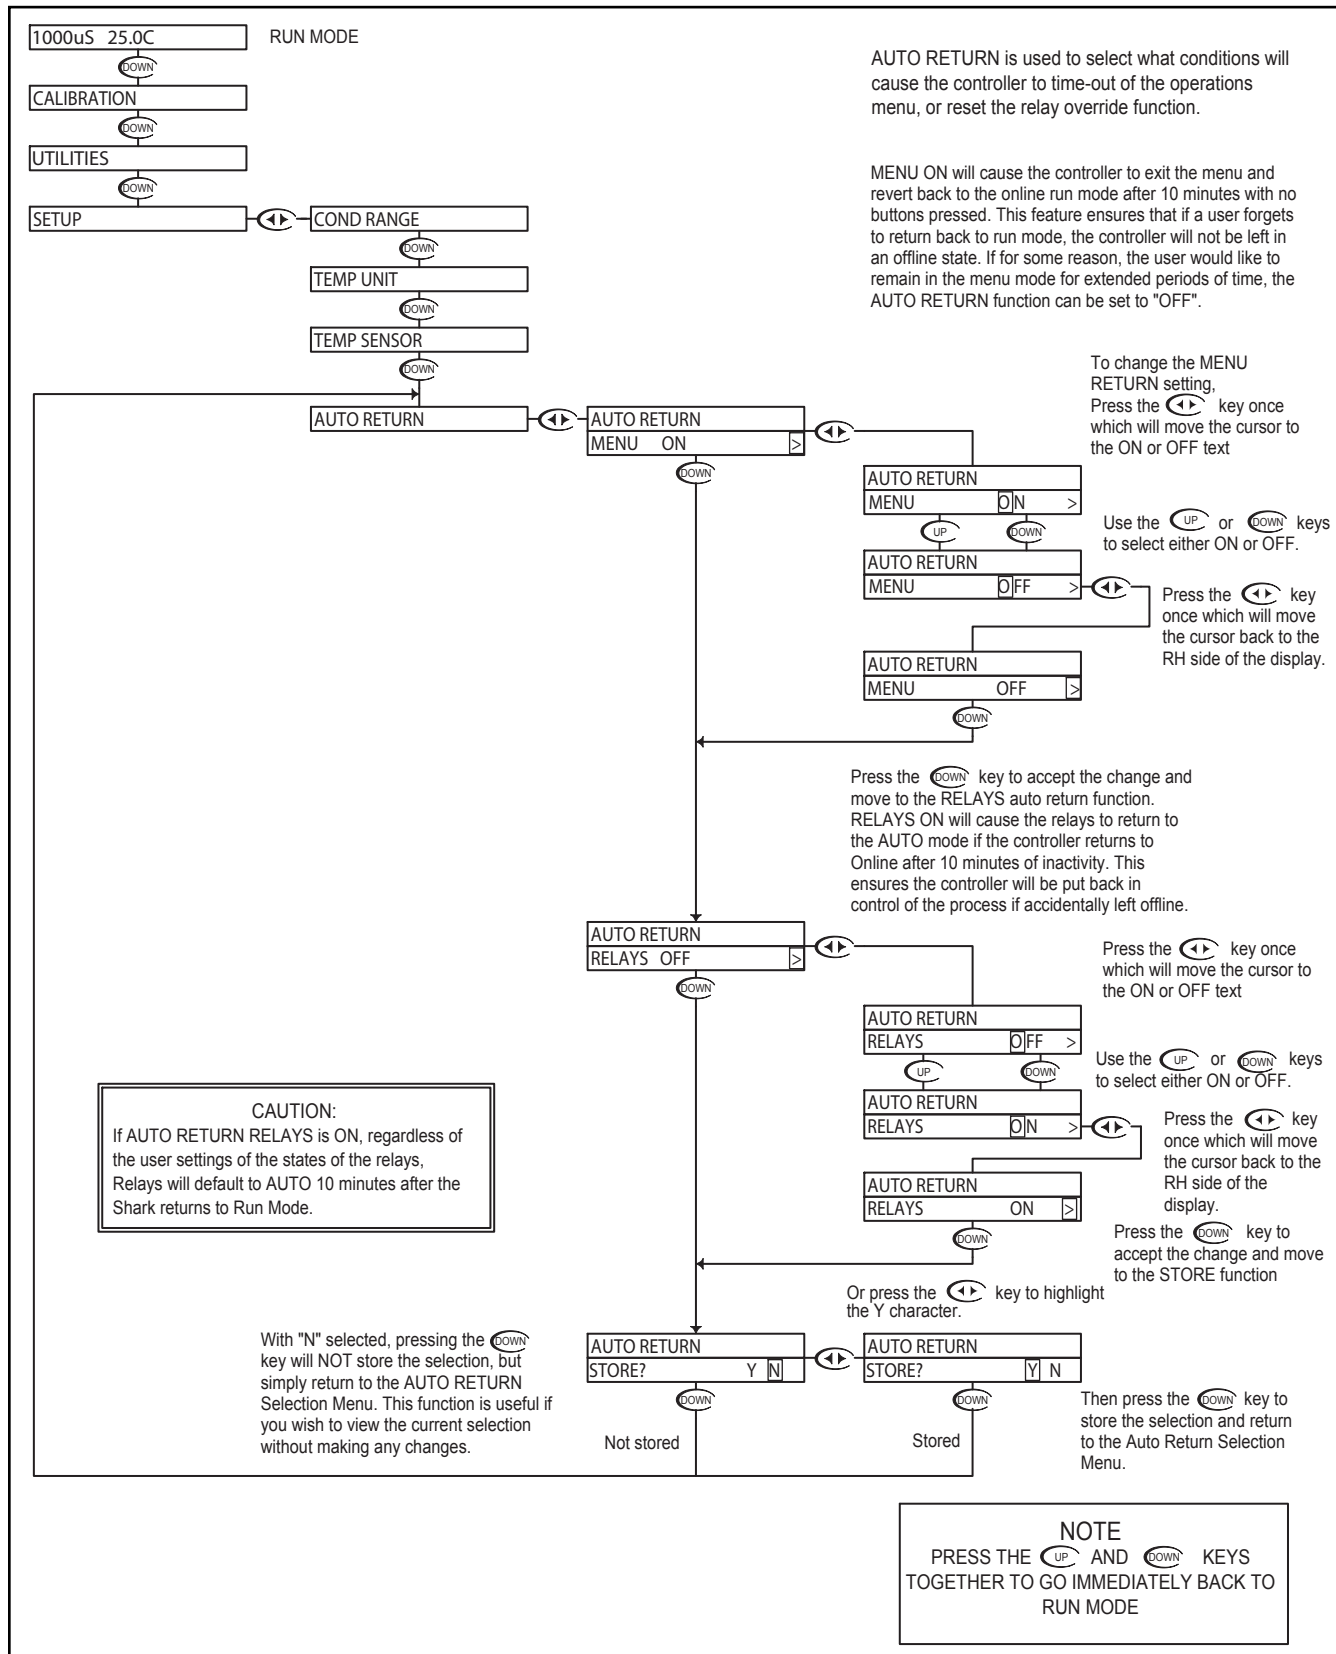




Conductivity - Setup Menu - T. Comp Override 6.12

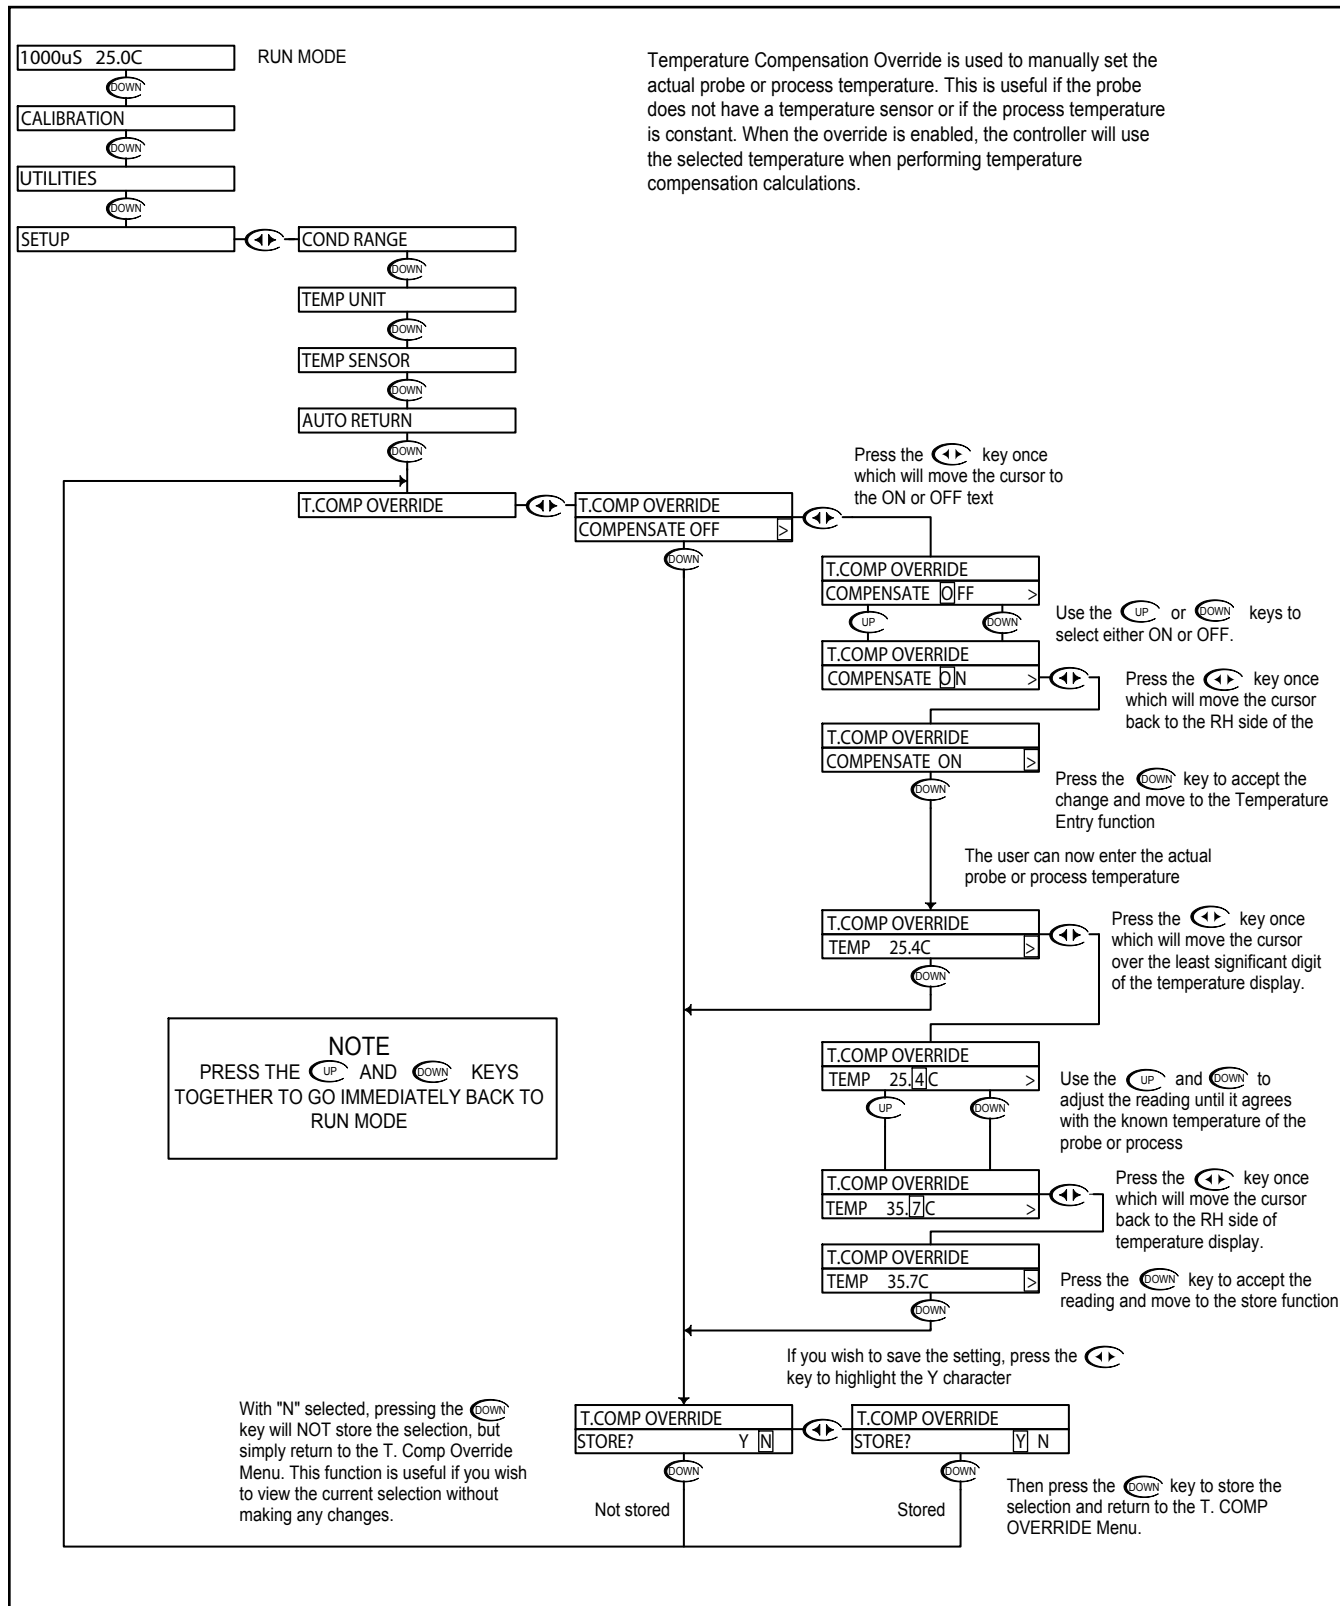




Conductivity - Setup Menu - Display Damping 6.13

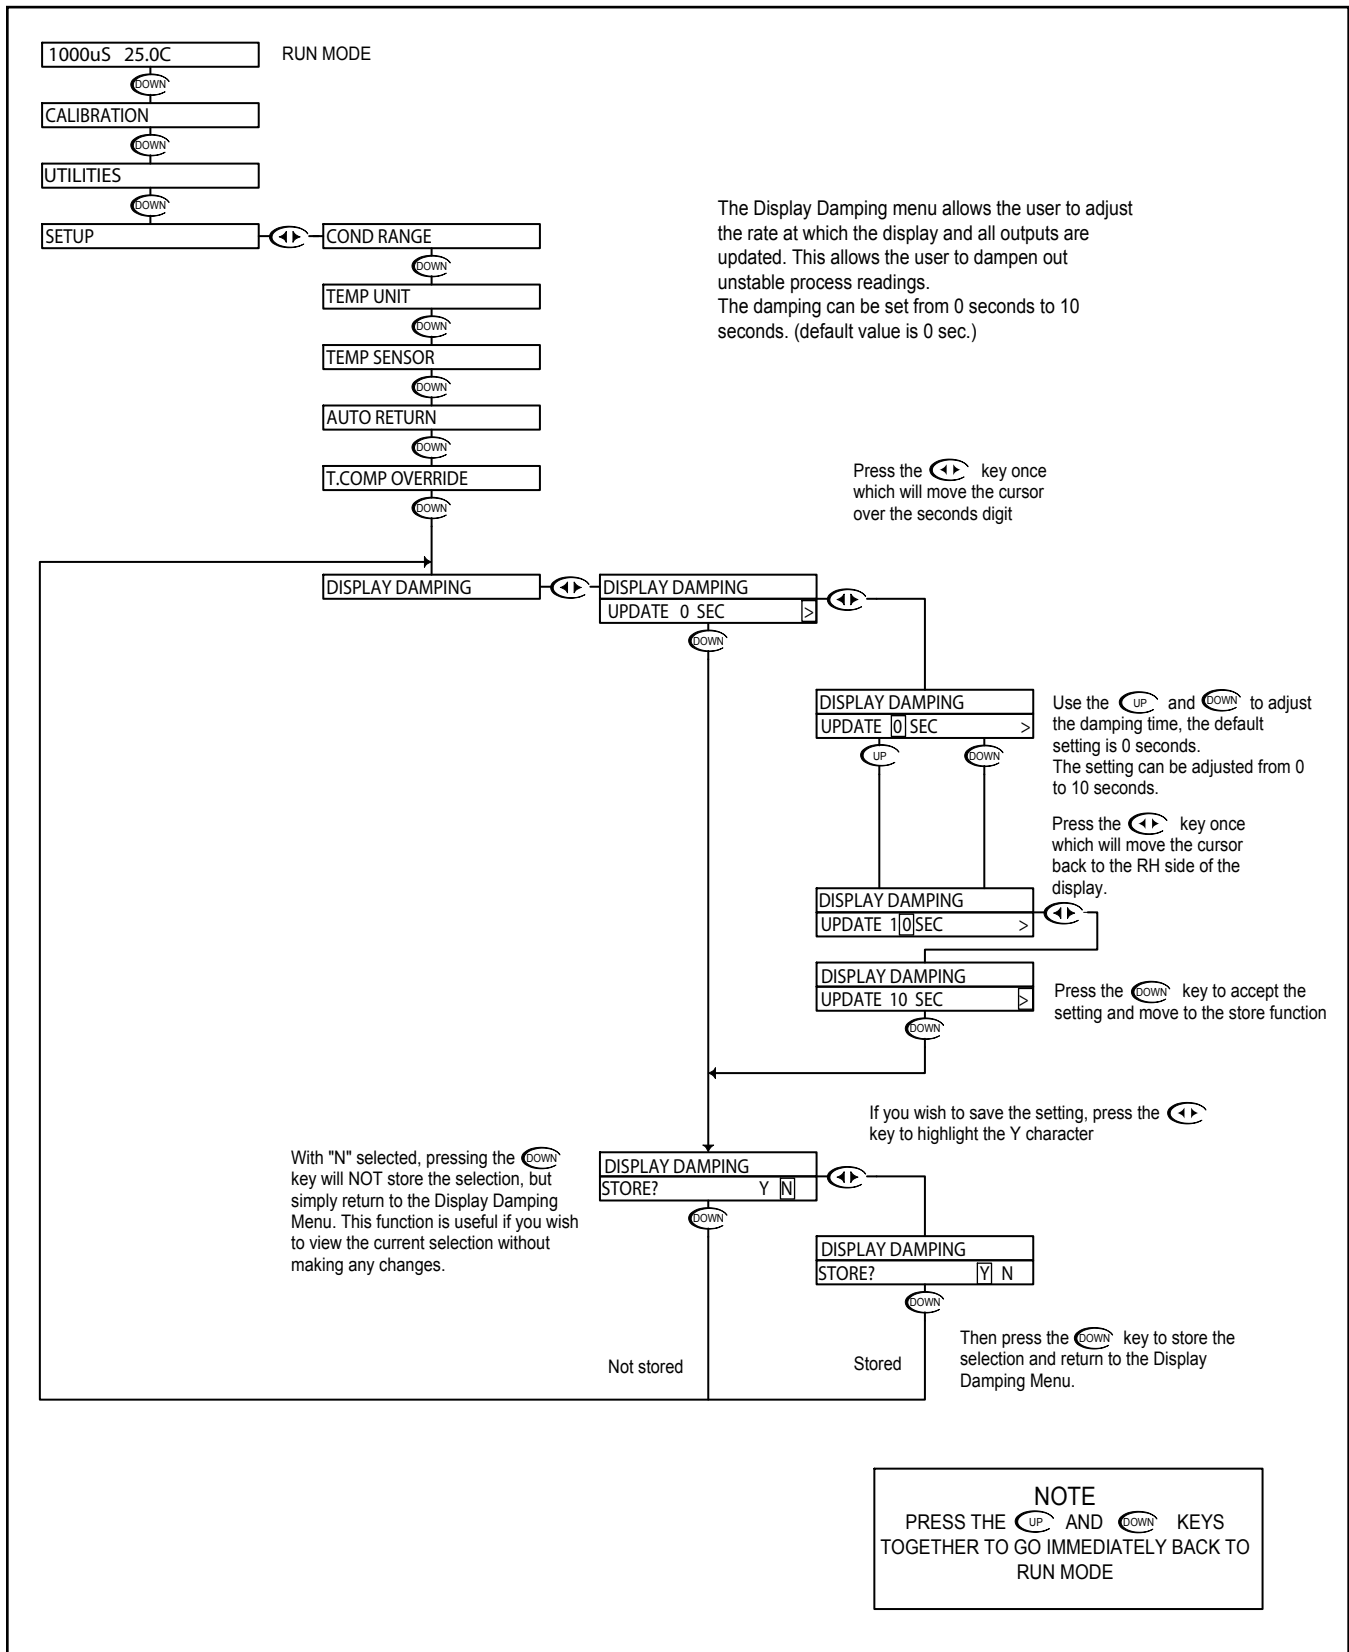



Conductivity - Setup Menu - Temp. Comp. Curve 6.14

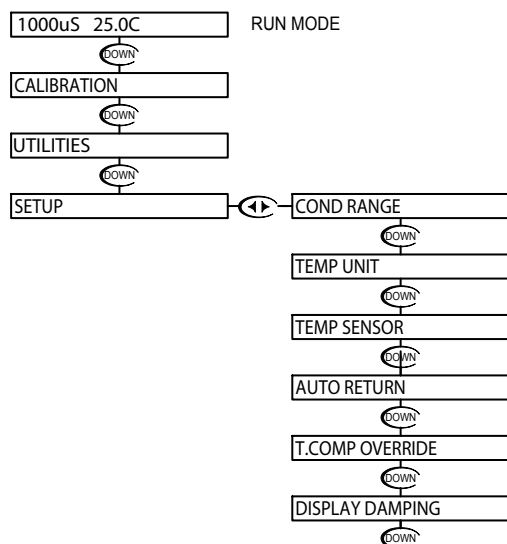


The Temperature Compensation Curve setting allows the user to select the temperature compensation to match a specific process.


The variation of Conductivity versus Temperature is dependent on the type of solids and liquids in water, so no fixed compensation value will accurately compensate every process. This setting allows the user to fine tune the compensation to their specific process.


Estimates of the correct compensation for certain chemicals are available and can be preset via this menu, otherwise the user will need to set the compensation to 0%/C, measure the effect of temperature for a specific process, calculate the actual compensation required and enter it through this menu.

The Compensation can be varied from 0%/C to 10%/C.

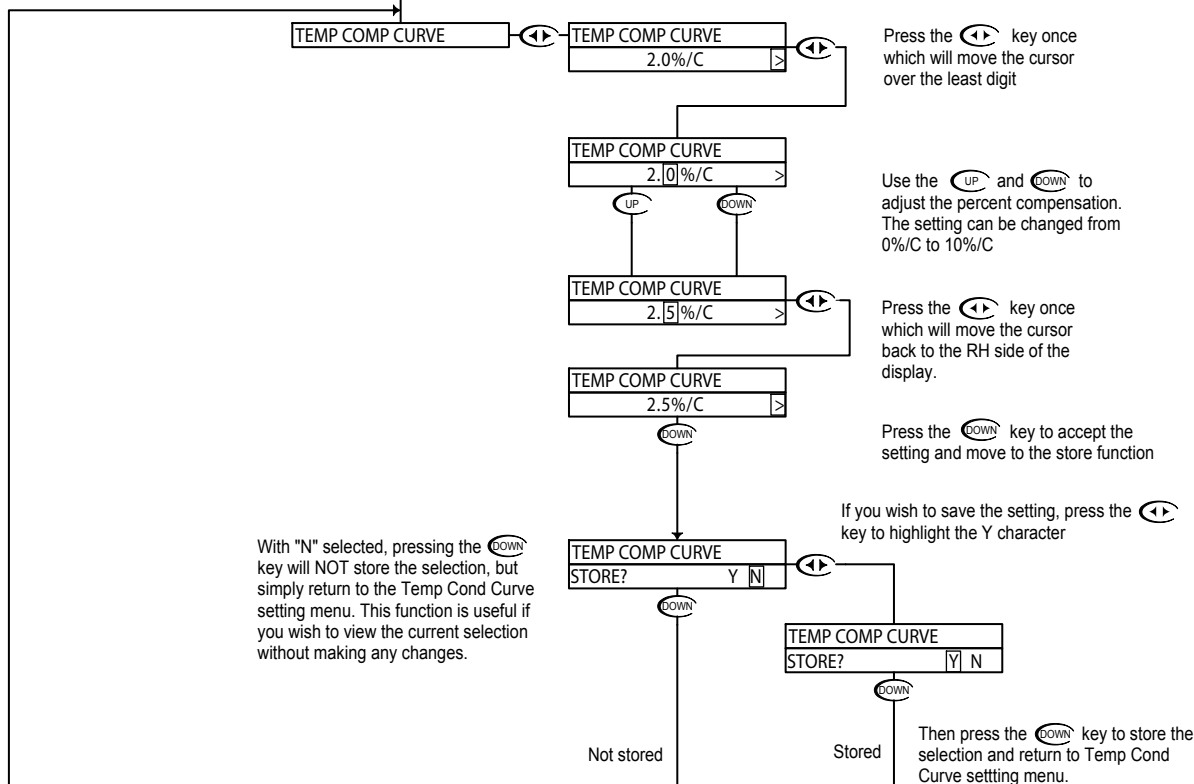

NOTE
PRESS THE **UP** AND **DOWN** KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE

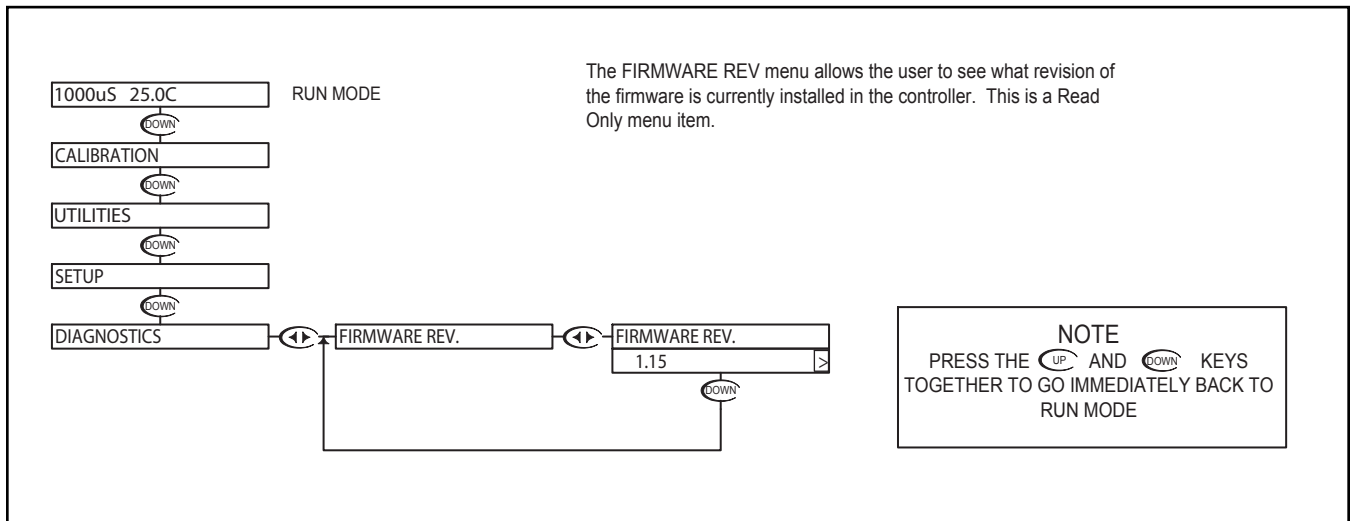

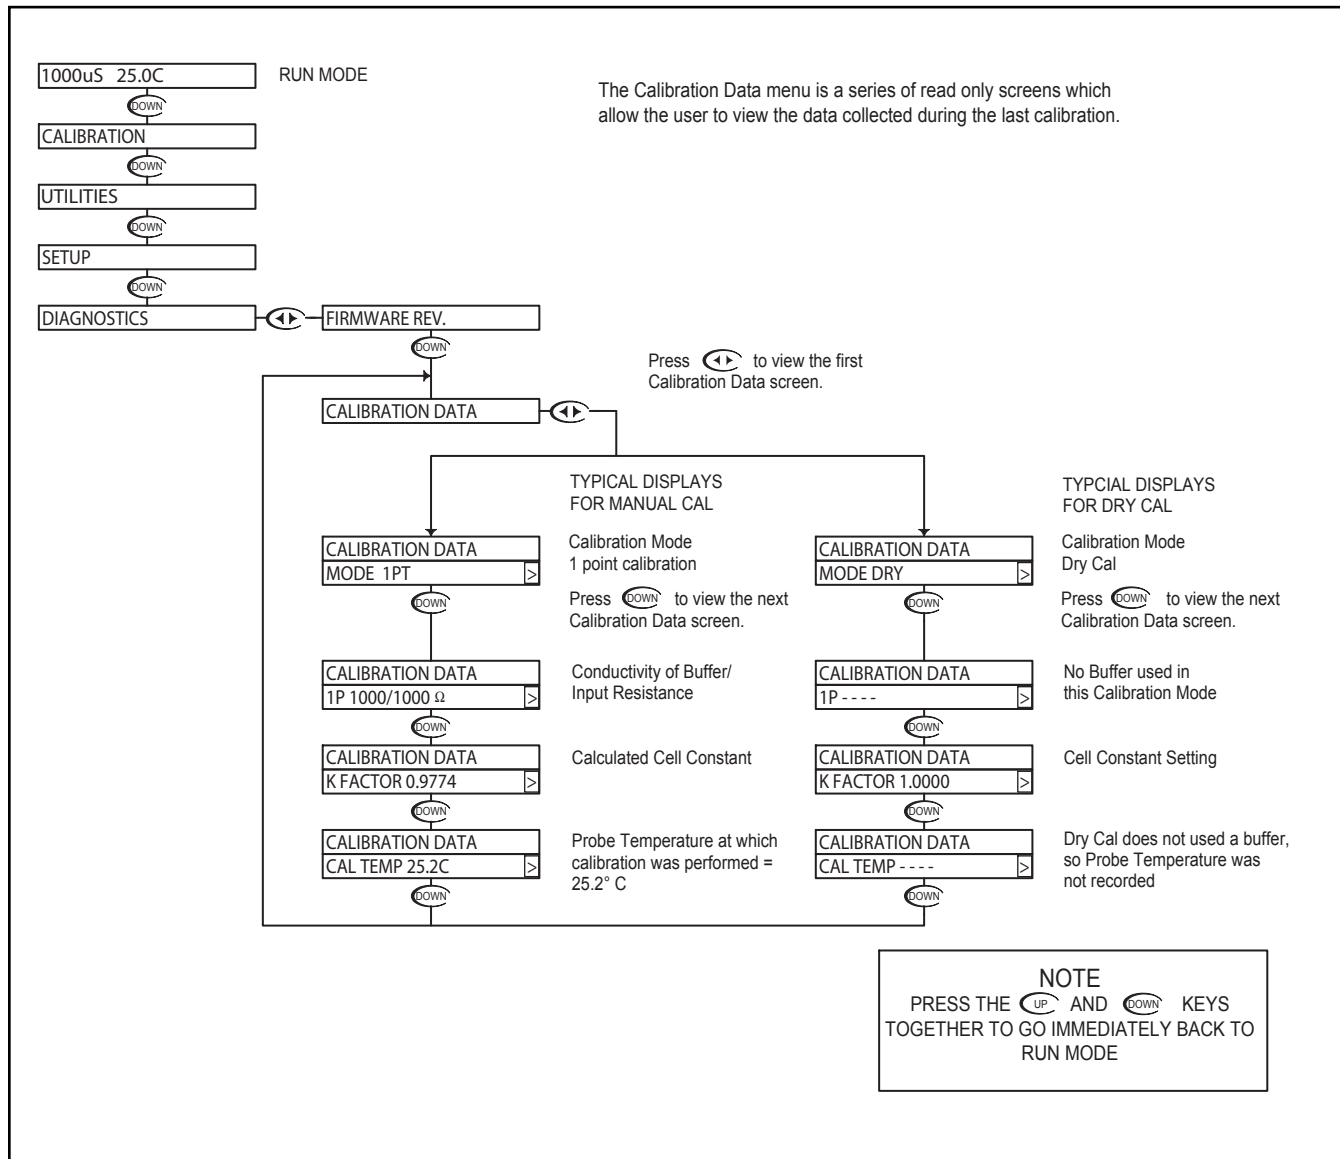



Conductivity - Diagnostics Menu - Sensor Input 6.17

1000uS 25.0C RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

LEFT/RIGHT

FIRMWARE REV.

DOWN

CALIBRATION DATA

DOWN

SENSOR INPUT

Press LEFT/RIGHT to view the Sensor Input data.

CELL 966 Ω
TEMP 2953 Ω

DOWN

The Sensor Input Menu allows the user to view real time, uncompensated process data from the conductivity cell.
This is a Read only menu item.
This "Live Data" screen is useful for trouble shooting purposes when diagnosing cell or process problems.

The top line shows the resistance of the cell,
The bottom line shows the actual value of the temperature sensor in ohms.


NOTE

PRESS THE UP AND DOWN KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Conductivity - Outputs Menu - Relay A 6.18

1000uS 25.0C RUN MODE

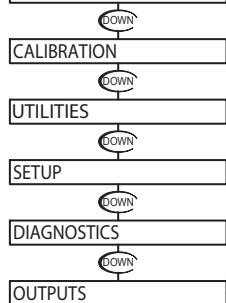

RUN MODE

Relay A can be configured for the following operations

- Response to rising or falling process values
- Adjustable on and off set-points
- Cycle on and off times
- Failsafe operation

The relay can be set to control either a RISING or FALLING process.
In a FALLING process, the control relay will energize when the process falls below a set value. In this case, the ON set-point must be set lower than the OFF set-point.
In a RISING process, the control relay will energize when the process rises above a set value. In this case, the ON set-point must be set higher than the OFF set-point.

The RELAY ON setting is the process value at which the relay will energize. It may be set anywhere in the normal range of the sensor.

The RELAY OFF setting is the process value at which the relay will de-energize. The setting must be rationalized against the On setting. For example, in a falling process, the Off setting must be higher than the ON setting.

The controller will not allow you to select the RELAY OFF value on the wrong side of the RELAY ON value for the selected direction. If the user tries to set the RELAY OFF on the wrong side, the following errors will be displayed:

FALLING PROCESS
ON SPT < OFF SPT

Error when trying to set OFF point lower than ON point when set to falling.

RISING PROCESS
ON SPT > OFF SPT

Error when trying to set OFF point higher than ON point when set to rising.

RELAY A

RELAY A
DIRECTION FALL

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY A
DIRECTION FALL

Use the and keys to change the setting

RELAY A
DIRECTION RISE

RELAY A
DIRECTION FALL

Press the key once which will move the cursor back to the RH side of the display.

RELAY A
DIRECTION FALL

Press the key to accept the setting and move to the next setting

RELAY A
RELAY ON 600

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY A
RELAY ON 600

Use the and keys to change the setting

RELAY A
RELAY ON 680

Press the key once which will move the cursor back to the RH side of the display.

RELAY A
RELAY ON 680

Press the key to accept the setting and move to the next setting

RELAY A
RELAY OFF 800

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

RELAY A
RELAY OFF 800

Use the and keys to change the setting

RELAY A
RELAY OFF 880

Press the key once which will move the cursor back to the RH side of the display.

RELAY A
RELAY OFF 880

Press the key to accept the setting and move to the next setting

TO CYCLE ON

NOTE
PRESS THE AND KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Conductivity - Outputs Menu - Relay A 6.18

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds.
The default ON time is 5 seconds.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0.

The Default OFF time is 0 seconds.

The OVERFEED TIMER is designed to help safeguard against a process or instrumentation error causing one of the control relays to remain energized for extended periods of time.

When enabled, the user must select the desired overfeed timeout time (1-999 min.)

If the overfeed timer times out:

- Alarm relay will energize.
- Control (A&B) will de-energize
- LED on front will flash

Must be reset via Utilities Menu or Power reset.


The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption.

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

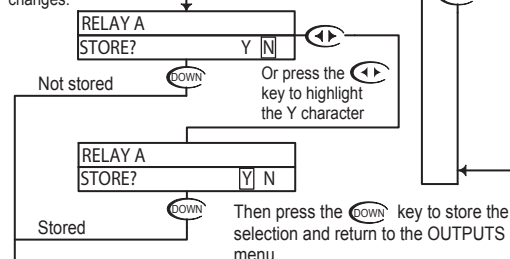

TO OUTPUTS MENU

FROM CYCLE ON

RELAY A
CYCLE ON 5S

DOWN

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

RELAY A
CYCLE ON 5S

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

RELAY A
CYCLE ON 100S

UP

DOWN

Press the **LEFT** key once which will move the cursor back to the RH side of the display.

RELAY A
CYCLE ON 100S

DOWN

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

RELAY A
CYCLE OFF 0S

DOWN

RELAY A
CYCLE OFF 0S

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

RELAY A
CYCLE OFF 200S

UP

DOWN

Press the **LEFT** key once which will move the cursor back to the RH side of the display.

RELAY A
CYCLE OFF 200S

DOWN

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

RELAY A
OVERFD TIMER OFF

DOWN

RELAY A
OVERFD TIMER OFF

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

RELAY A
OVERFD TIMER ON

UP

DOWN

Press the **LEFT** key once which will move the cursor back to the RH side of the display.

RELAY A
OVERFD TIMER ON

DOWN

Press the **DOWN** key to accept the setting and move to the next setting

RELAY A OVERFD
TIME (MIN) 10

UP

DOWN

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

RELAY A OVERFD
TIME (MIN) 6

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

RELAY A OVERFD
TIME (MIN) 6

UP

DOWN

Press the **LEFT** key once which will move the cursor back to the RH side of the display.

RELAY A OVERFD
TIME (MIN) 6

DOWN

Press the **DOWN** key to accept the setting and move to the next setting

If you wish to change the setting, press the **LEFT** key once which will move the cursor to the first character of the value to be changed

RELAY A
FAIL SAFE OFF

DOWN

RELAY A
FAIL SAFE OFF

UP

DOWN

Use the **UP** and **DOWN** keys to change the setting

RELAY A
FAIL SAFE ON

UP

DOWN


Press the **LEFT** key once which will move the cursor back to the RH side of the display.

RELAY A
FAIL SAFE ON

DOWN

Press the **DOWN** key to accept the setting and move to the STORE function.

Conductivity - Outputs Menu - Relay B 6.19

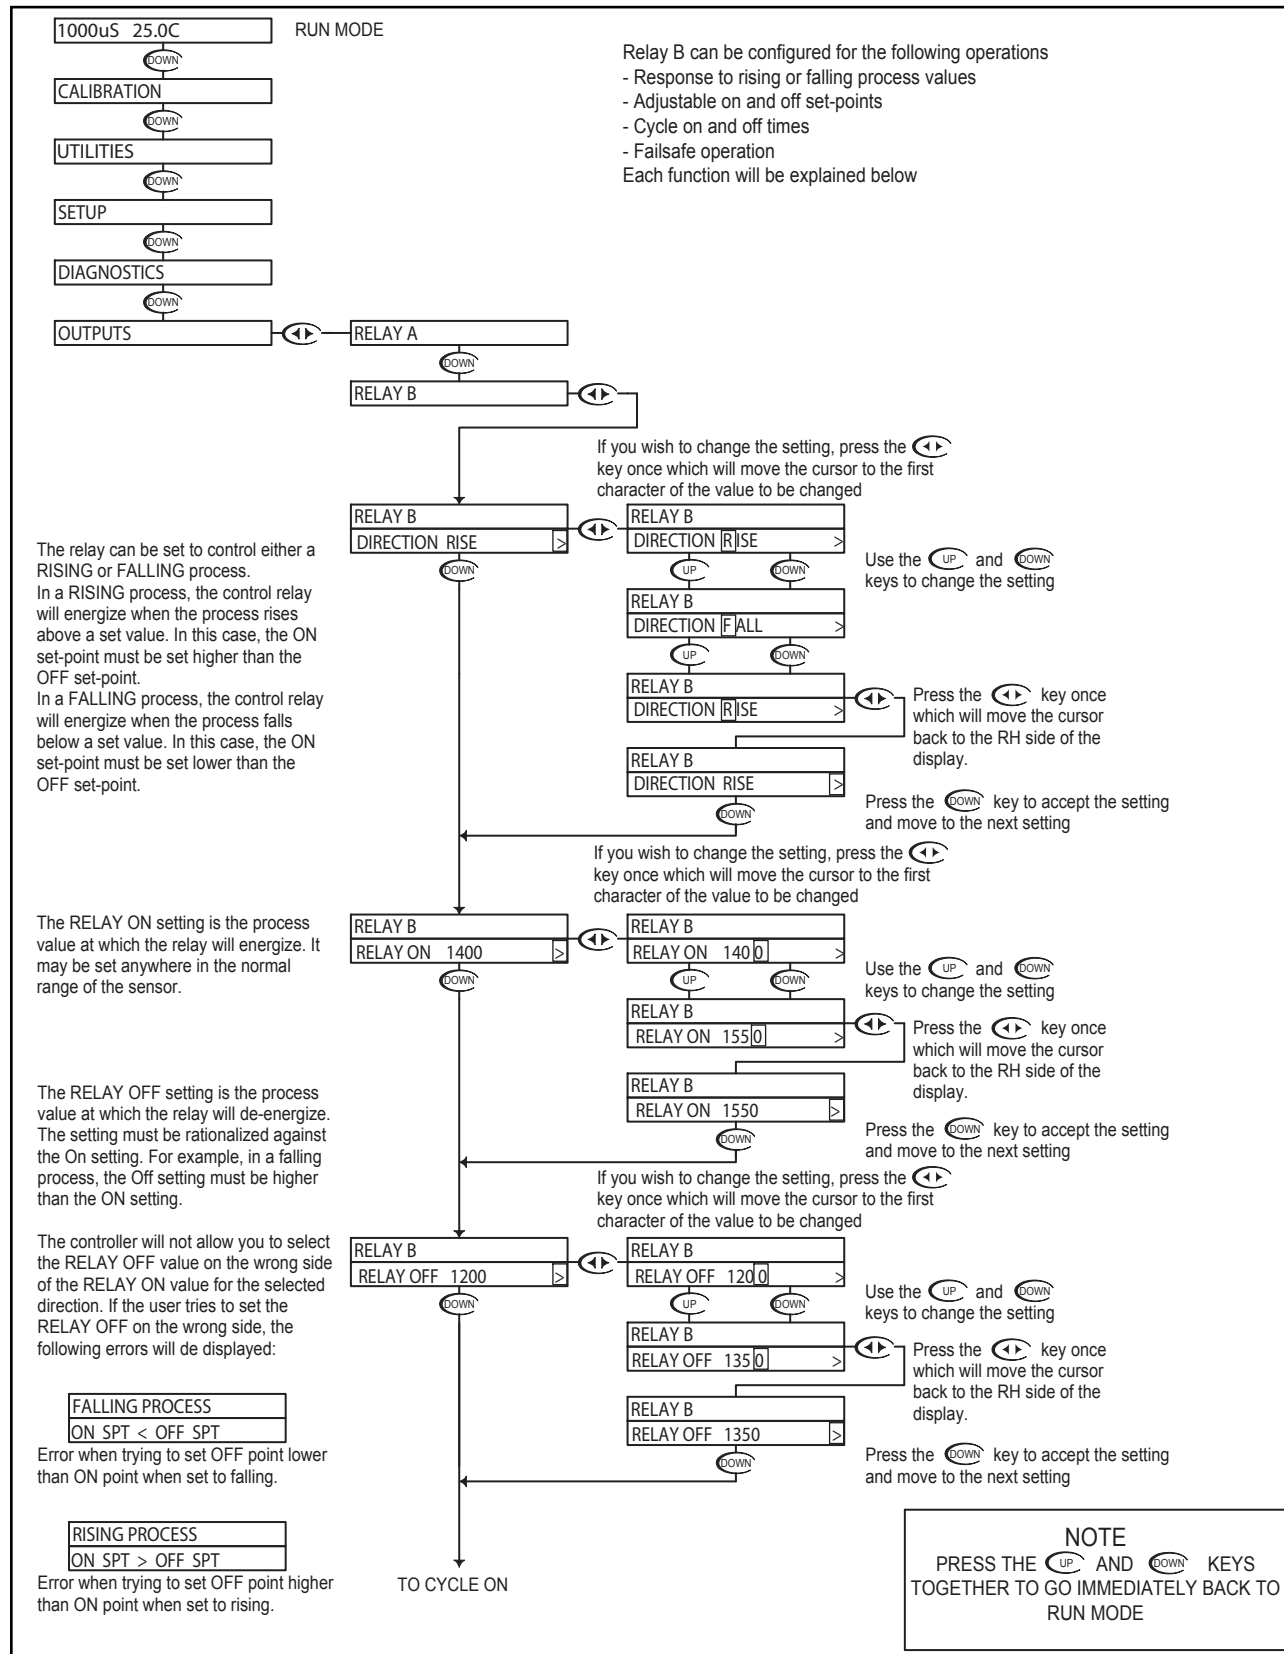

Conductivity - Outputs Menu - Relay B 6.19

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds. The default ON time is 5 seconds.

NOTE
PRESS THE  AND  KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0

The Default OFF time is 0 seconds.

The OVERFEED TIMER is designed to help safeguard against a process or instrumentation error causing one of the control relays to remain energized for extended periods of time.

When enabled, the user must select the desired overfeed timeout time (1-999 min.)

If the overfeed timer times out:

- Alarm relay will energize.
- Control (A&B) will de-energize
- LED on front will flash

Must be reset via Utilities Menu or Power reset


The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.


The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption. For example, a process that needs a constant feed, would want a pump to turn on in the event of a controller power failure.


With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

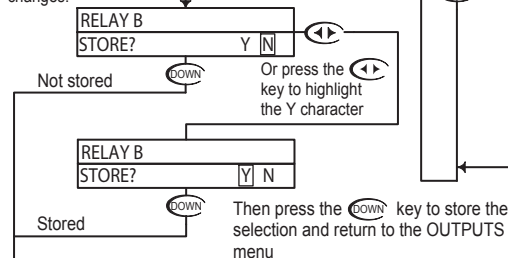


TO OUTPUTS MENU

FROM CYCLE ON

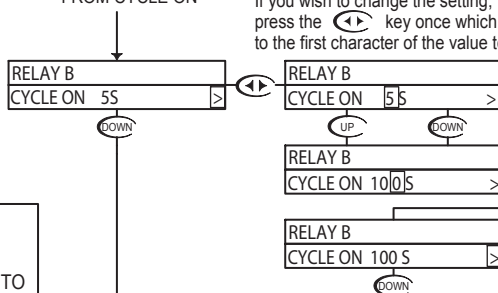


If you wish to change the setting, press the  key once which will move the cursor to the first character of the value to be changed


Use the **UP** and **DOWN** keys to change the setting.

Press the  key once which will move the cursor back to the RH side of the display.


If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

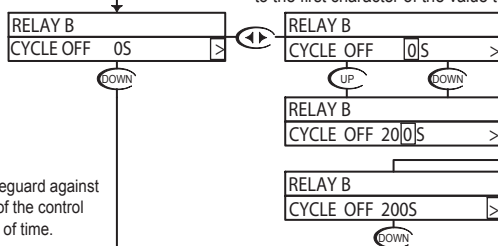


Use the **UP** and **DOWN** keys to change the setting.


Press the  key once which will move the cursor back to the RH side of the display.


Press the **DOWN** key to accept the setting and move to the next setting


If you wish to change the setting, press the  key once which will move the cursor to the first character of the value to be changed

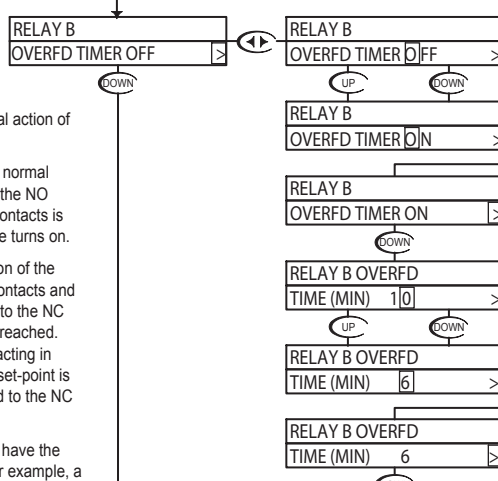


Use the **UP** and **DOWN** keys to change the setting.

Press the  key once which will move the cursor back to the RH side of the display.


Press the  key to accept the setting and move to the next setting


If you wish to change the setting, press the  key once which will move the cursor to the first character of the value to be changed

Use the **UP** and **DOWN** keys to change the setting


Press the  key once which will move the cursor back to the RH side of the display.


Press the **DOWN** key to accept the setting and move to the next setting.

If you wish to change the setting, setting and move press the  key once which will move the cursor to the first character of the value to be changed

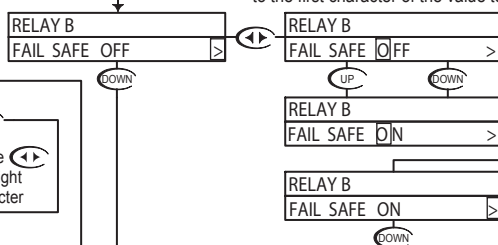

Use the **UP** and **DOWN** keys to change the setting.

Press the  key once which will move the cursor back to the RH side of the display.

Press the  key to accept the setting and move to the STORE function.



Conductivity - Outputs Menu - Alarm Relay 6.20

1000uS 25.0C RUN MODE

CALIBRATION

UTILITIES

SETUP

DIAGNOSTICS

OUTPUTS

RELAY A

RELAY B

ALARM RELAY

The ALARM RELAY will respond to both a rising and falling process. The ALARM RELAY will act as a low alarm (falling process) and a high alarm (rising process). Both relay bands will have independently adjustable on and off set-points. If a low alarm on set-point is set at a value 800uS for example, the off set-point must be set higher. The controller will not let the user input a value below the low alarm on. The same rule holds true for the high alarm.

The Alarm Relay can be configured for the following operations

- LOW ON Set-point
- LOW OFF Set-point
- HIGH ON Set-point
- HIGH OFF Set-point
- Failsafe

The LOW ON set point is the low process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.

ALARM RELAY
LOW ON 500

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
LOW ON 500

Use the and keys to change the setting

ALARM RELAY
LOW ON 400

Press the key once which will move the cursor back to the RH side of the display.

ALARM RELAY
LOW ON 400

Press the key to accept the setting and move to the next setting

The LOW OFF set point is the value that the process must reach in order to de-energize the alarm relay after it has dropped below and tripped the LOW ON set-point. This value must be higher than the LOW ON Set-point.

ALARM RELAY
LOW OFF 600

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
LOW OFF 600

Use the and keys to change the setting

ALARM RELAY
LOW OFF 450

Press the key once which will move the cursor back to the RH side of the display.

ALARM RELAY
LOW OFF 450

Press the key to accept the setting and move to the next setting

The HIGH ON set-point is the high process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.

ALARM RELAY
HIGH ON 1500

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

ALARM RELAY
HIGH ON 1500

Use the and keys to change the setting

ALARM RELAY
HIGH ON 1800

Press the key once which will move the cursor back to the RH side of the display.

ALARM RELAY
HIGH ON 1800

Press the key to accept the setting and move to the next setting

TO HIGH OFF

NOTE
PRESS THE AND KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Conductivity - Outputs Menu - Alarm Relay 6.20

The HIGH OFF set-point is the value that the must reach in order to de-energize the alarm relay after it has increased over and tripped the HIGH ON set-point. This value must be lower than the HIGH ON Set-point.

The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption.

If the Low On set-point is set higher than the factory default Low Off set-point, when the user advances from the low on set-point to the Low Off set-point the controller will adjust the Low Off set-point to be equal to the Low On set-point. If the user then tries to decrease the Low Off set-point the Controller will display the Low Alarm setup error screen.


LOW ALARM
ON SPT < OFF SPT

This screen will be displayed for 10 seconds, then return back to the setup screen that was previously displayed. The same conditions apply to the High alarm set-points. Except the High Off set-point must be lower than the High On set-point. If the user tries to increase the High Off set-point higher than the High On set-point the High Alarm setup error screen will be displayed.

HIGH ALARM
ON SPT > OFF SPT

If the user sets the low on set-point and the low off set-point equal to 0, it will disable the Low Alarm relay. Similarly, setting the High On set-point and the HIGH OFF set-point to 0 will disable the High Alarm.


With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

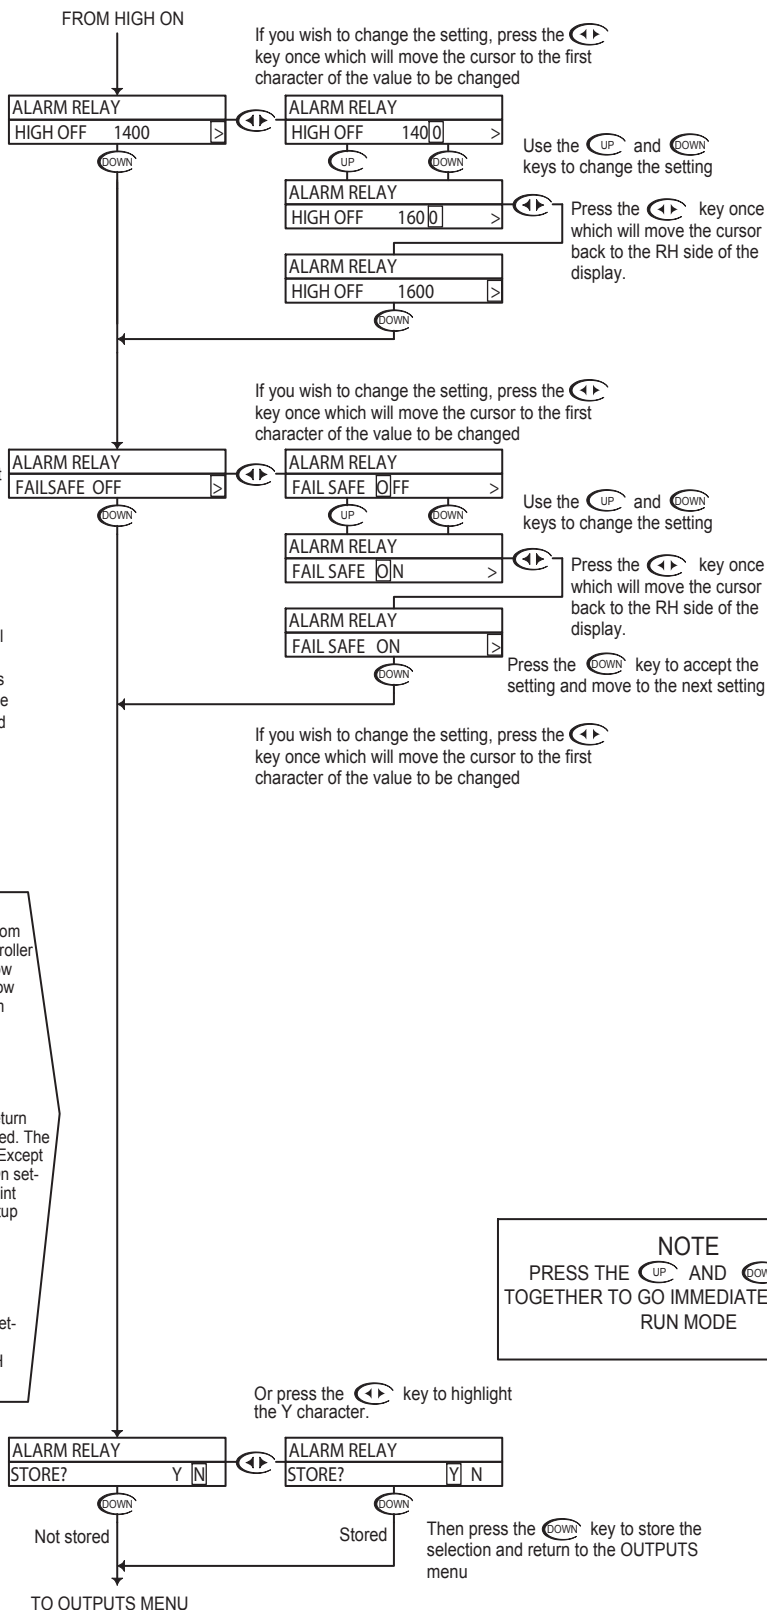


NOTE
PRESS THE **UP** AND **DOWN** KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Conductivity - Outputs Menu - 4-20mA CH1 Output 6.21

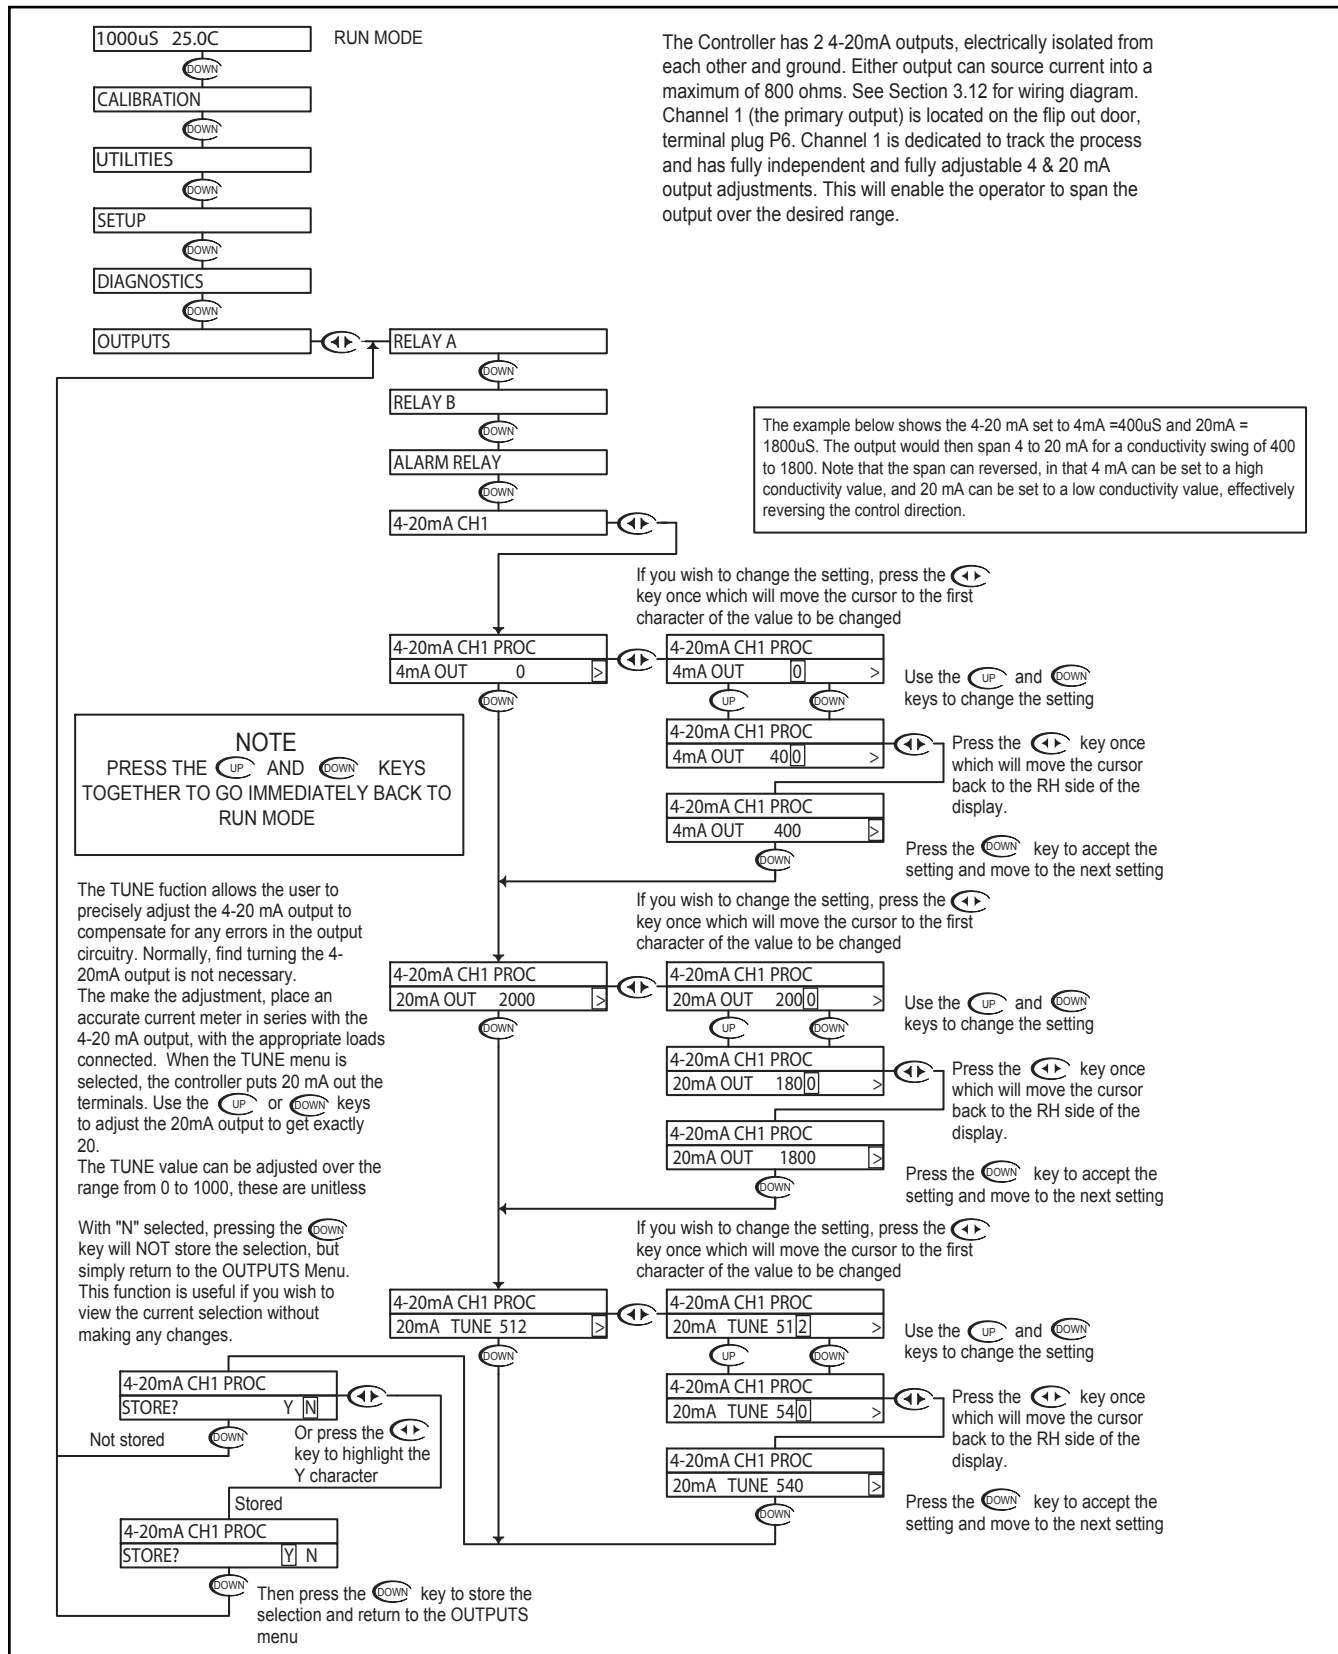

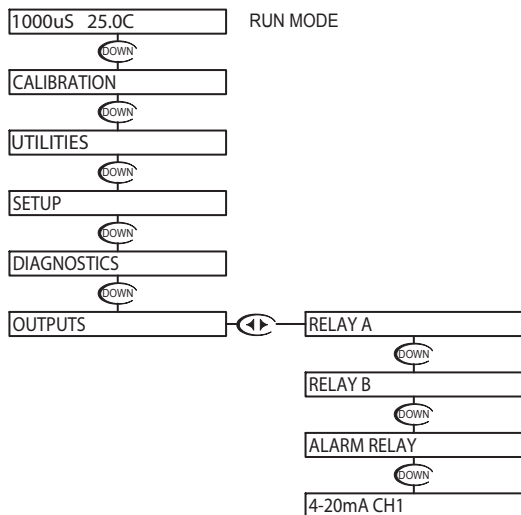

The Controller has 2 4-20mA outputs, electrically isolated from each other and ground. Either output can source current into a maximum of 800 ohms.

Channel 2 can be selected to track the process or temperature.


Channel 2 has fully independent and fully adjustable 4 & 20 mA output adjustments. This will enable the operator to span the output over the desired range.

Note that if the T COMP OVERRIDE is ON and Channel 2 output is set to track temperature, the output will not change, but hold at a value representing the temperature set in the T COMP OVERRIDE.

The example below shows the 4-20 mA set to 4mA = 0 C° and 20mA = 100 C°.

The output would then span 4 to 20 mA for a temperature swing of 0 C° to 100 C°.


Note that the span can be reversed, in that 4 mA can be set to a high process value, and 20 mA can be set to a low process value, effectively reversing the control direction.

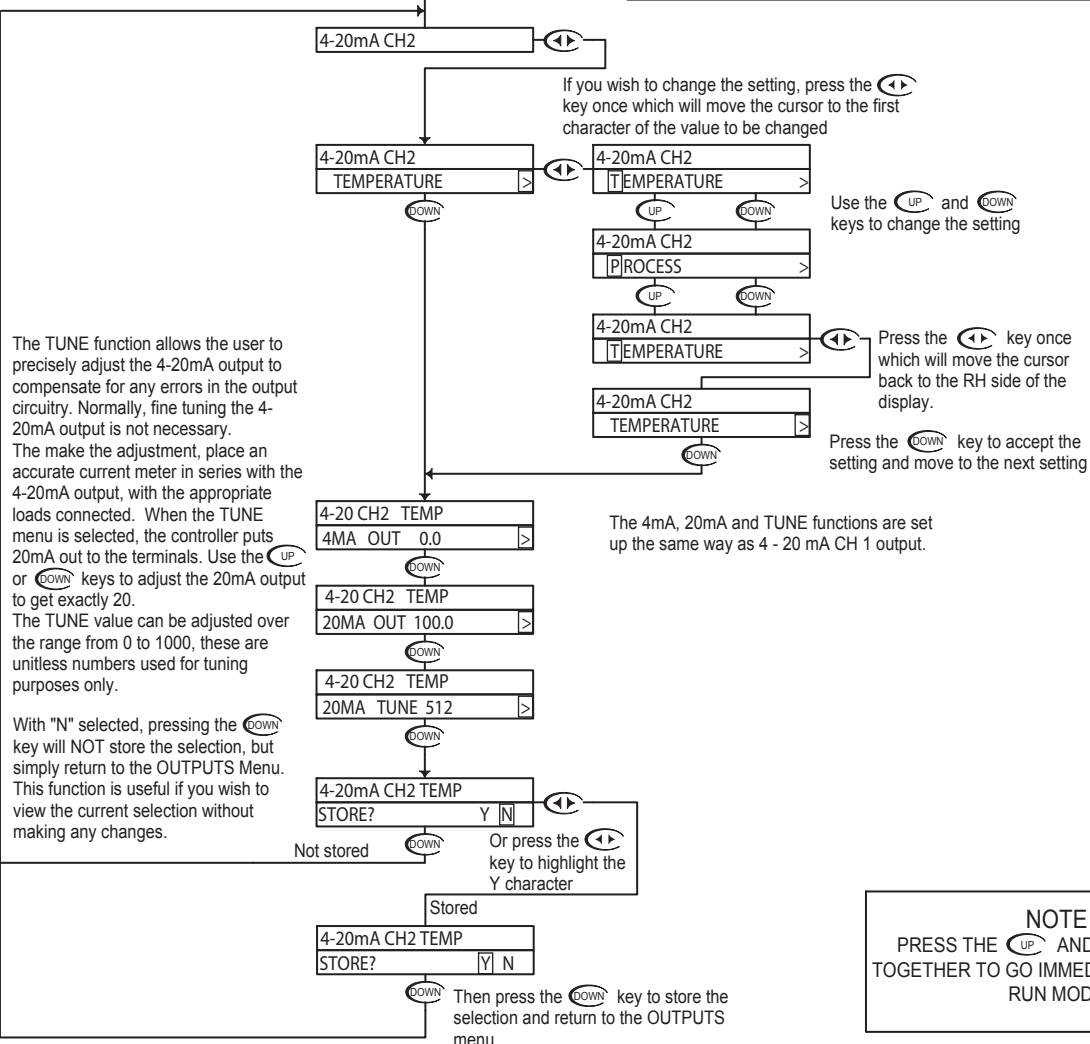

NOTE
PRESS THE UP AND DOWN KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




Conductivity - LED Display Menu - Conductivity Manual Calibrate 6.23

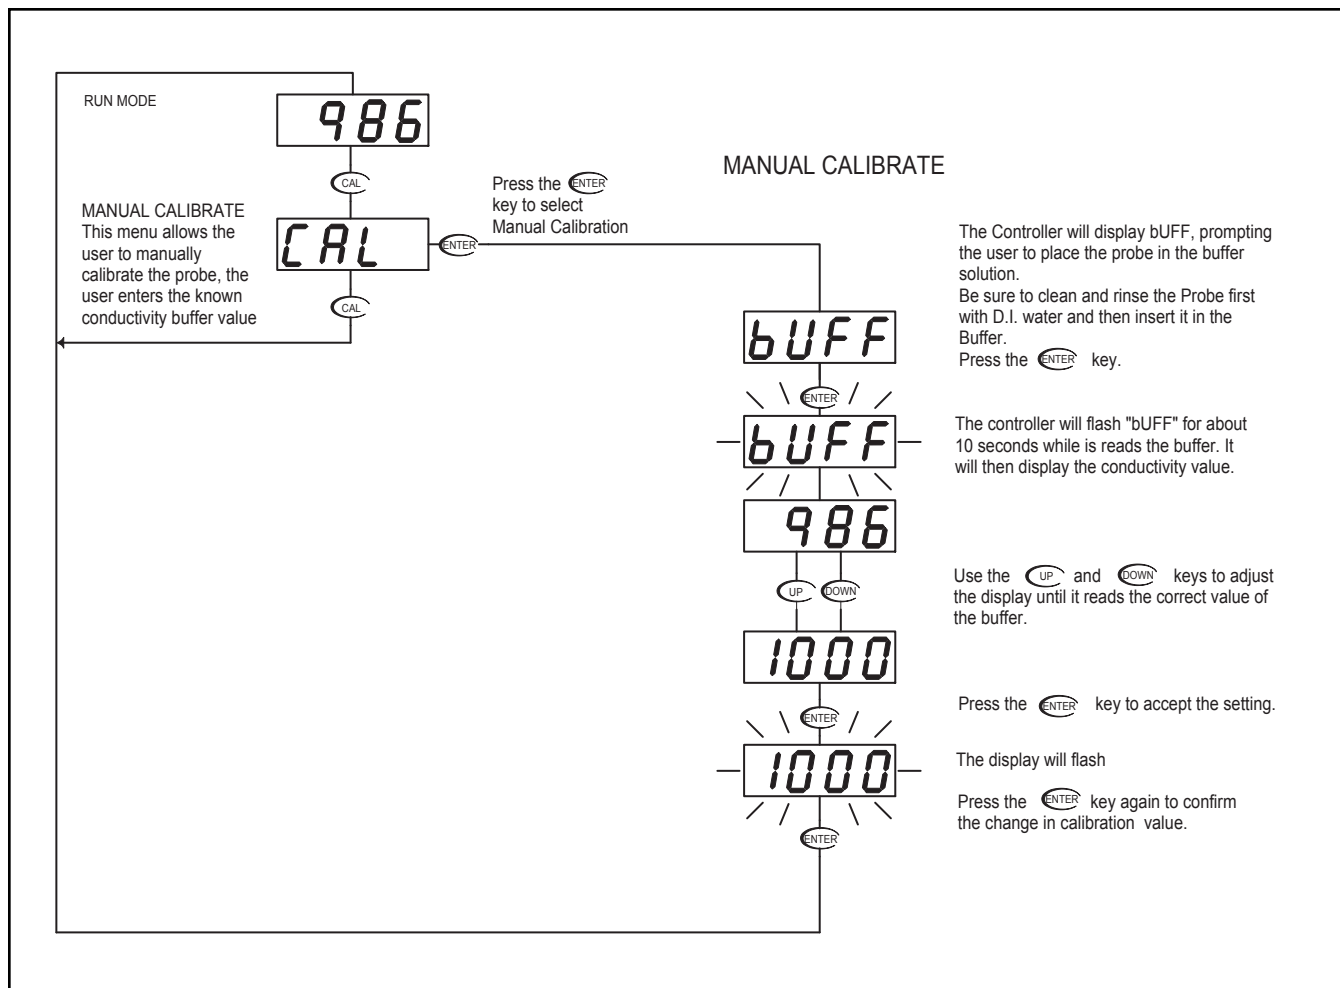




Section 7 - Using the SHARK in Flow Mode

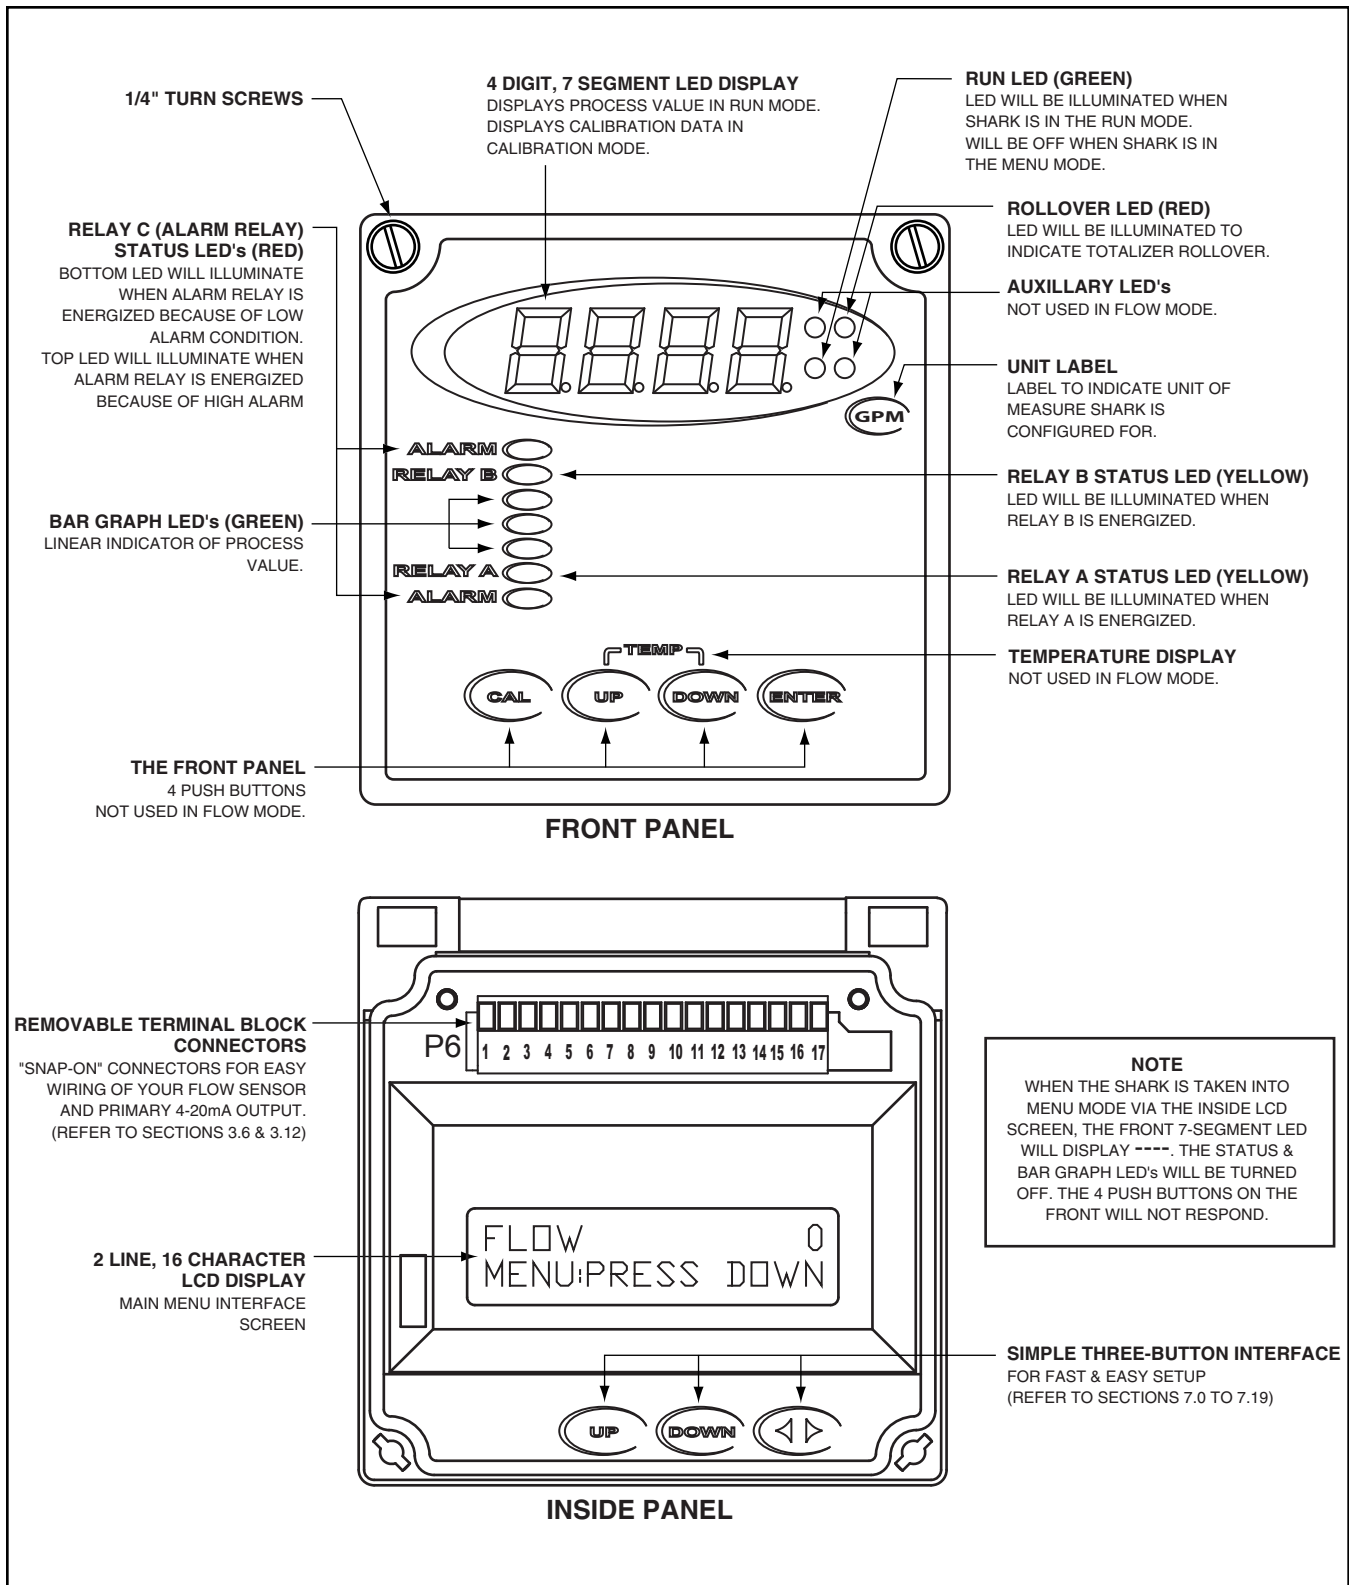



Flow - Menu Overview 7.0

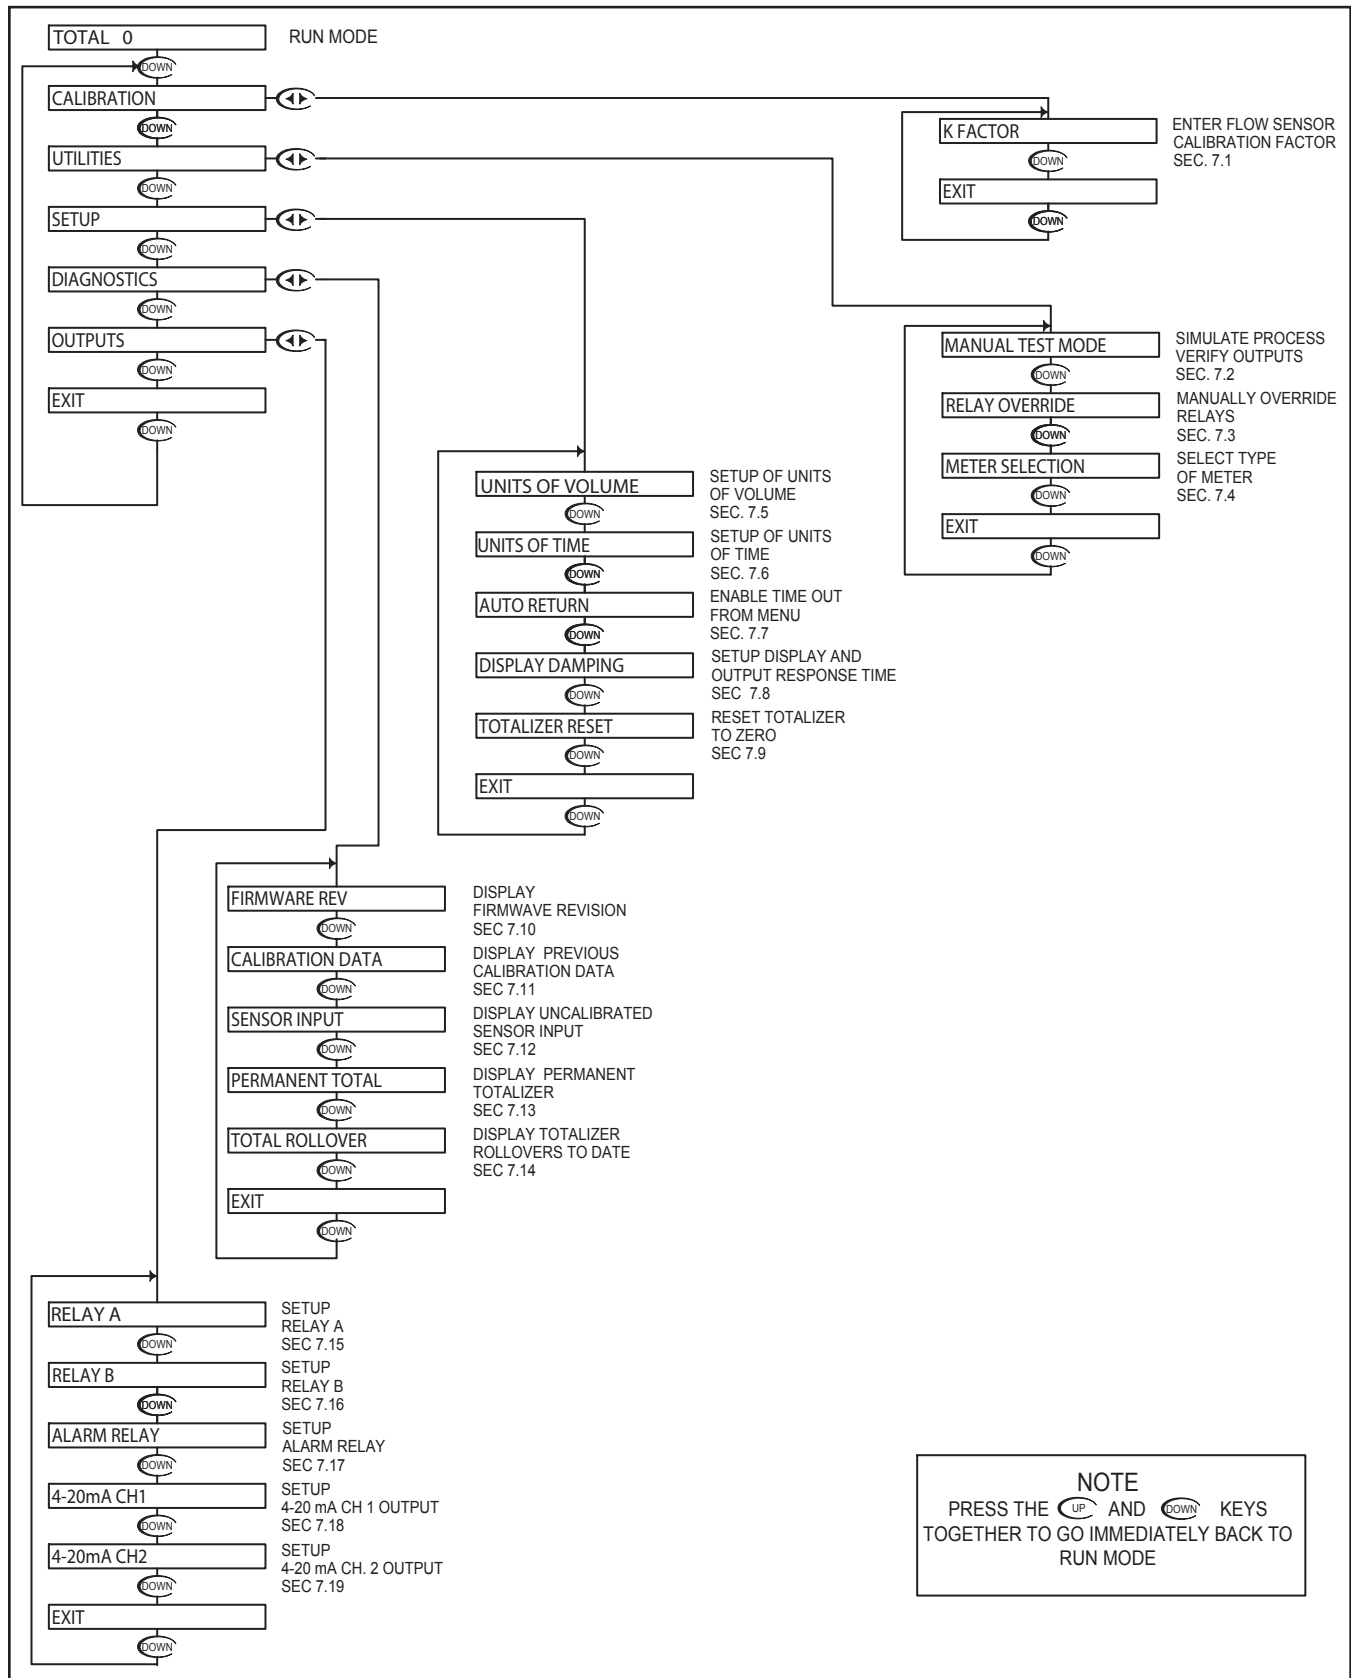



Flow - Calibration Menu - K Factor 7.1

The K Factor menu is used to enter the flow sensor calibration factor. The K Factor represents the number of pulses per U.S. Gallon, generated by the combination of sensor and flow fitting. It is normally stamped on the flow fitting or attached to a tag on the cable. Typical K factors range between 0.5000 to 1500.0.

TOTAL 0 RUN MODE

CALIBRATION

K FACTOR

K FACTOR
100.00

To enter the K factor, use the **DOWN** key to enter the Calibration menu and then the **RIGHT** key to select the K Factor menu.

Press the **RIGHT** key once which will move the cursor over the least sign. digit of the display.

If you just wish to view the current K Factor without changing it, press the **DOWN** key which will move to the store function

K FACTOR
100.00

Use the **UP** and **DOWN** keys to adjust the reading until it agrees with the actual K Factor as specified on the sensor

K FACTOR
125.00

Then press **RIGHT** to move the cursor to the RH position

K FACTOR
125.00

Press the **DOWN** key to accept the change and move to the store function

If the K Factor setting is OK, use the **RIGHT** key to move the cursor over the Y text and press the down key.

K FACTOR
STORE? Y N

K FACTOR
STORE? Y N

Press **DOWN** to store the calibration data and return back to the menu so the user can select another function.


NOTE:
ACCELERATOR KEYS
Pressing the **UP** or **DOWN** key once will change the value by the smallest digit. Holding the key down will cause the value to change at an increasing rate until the key is released. Pressing the key again will cause the value to start changing at it's slowest rate again. This allows the user to get to the new K Factor value quickly.
The K Factor can be set anywhere from 0.5000 pulses per U.S.Gallon to 1500.0 pulses per U.S.Gallon

If the calibration did not appear to be correct, press the **DOWN** key which will return back to the K Factor menu without storing the value.

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE




Flow - Utilities Menu - Manual Test Mode 7.2

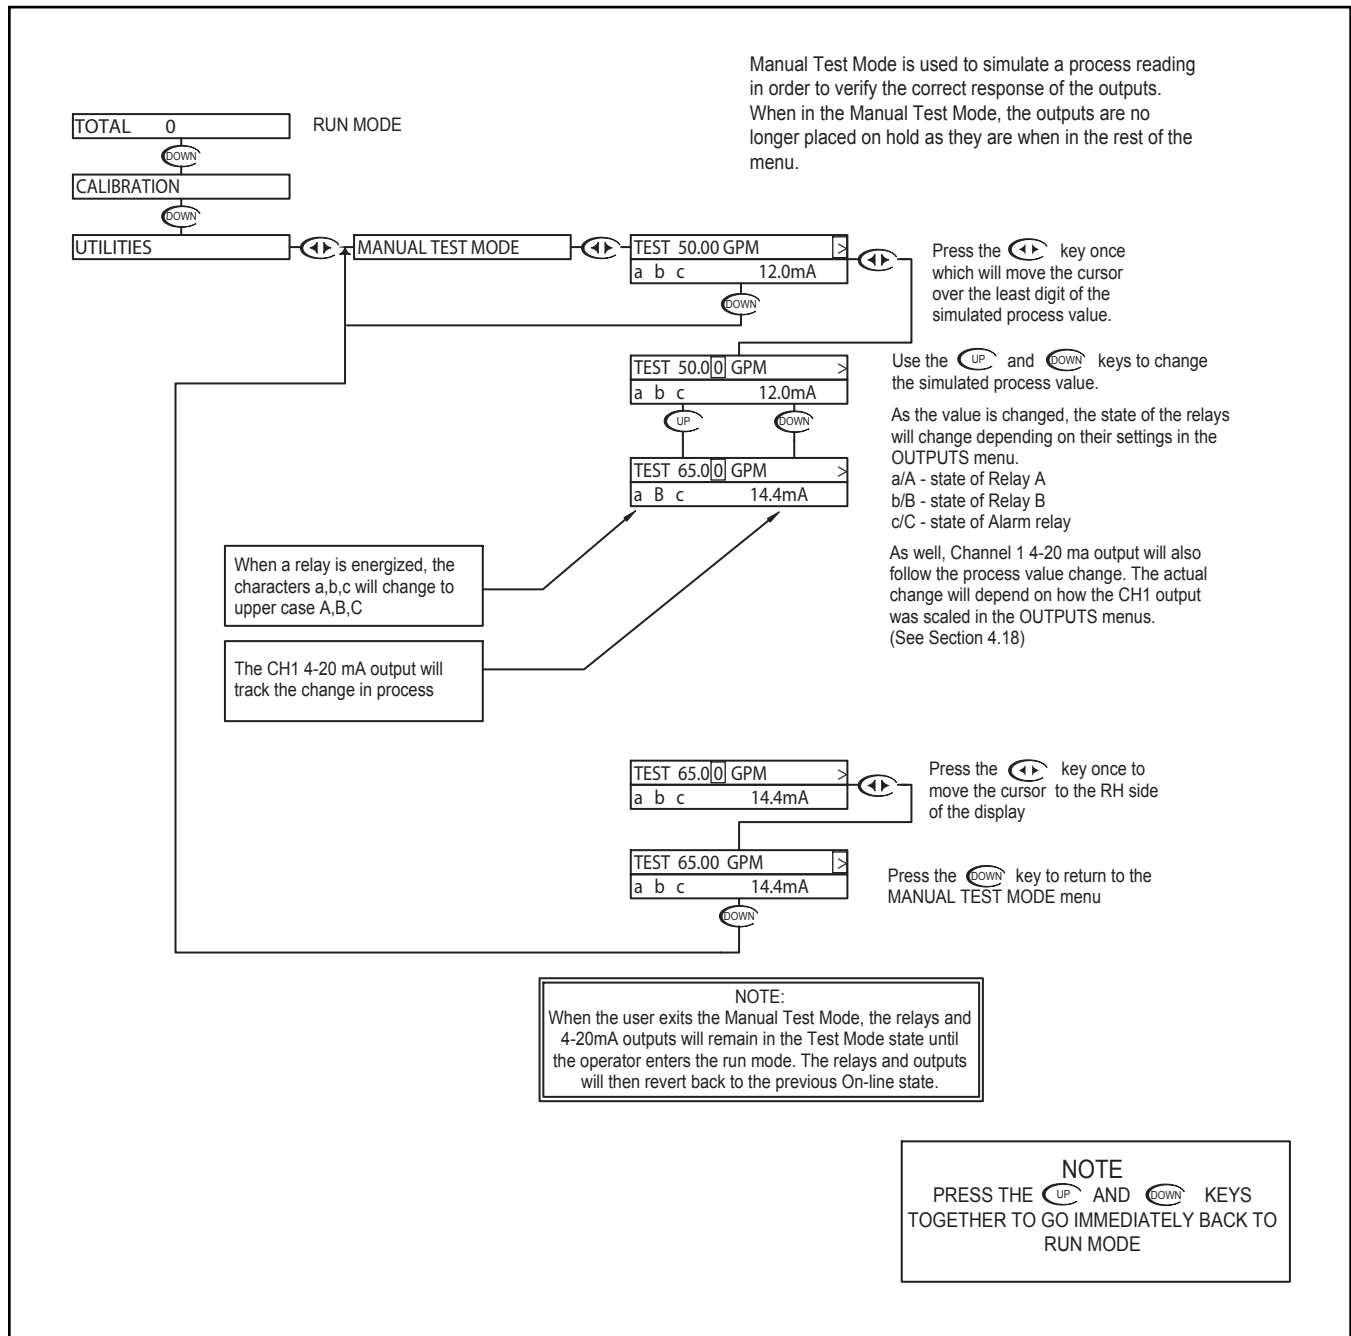




Flow - Utilities Menu - Relay Override 7.3

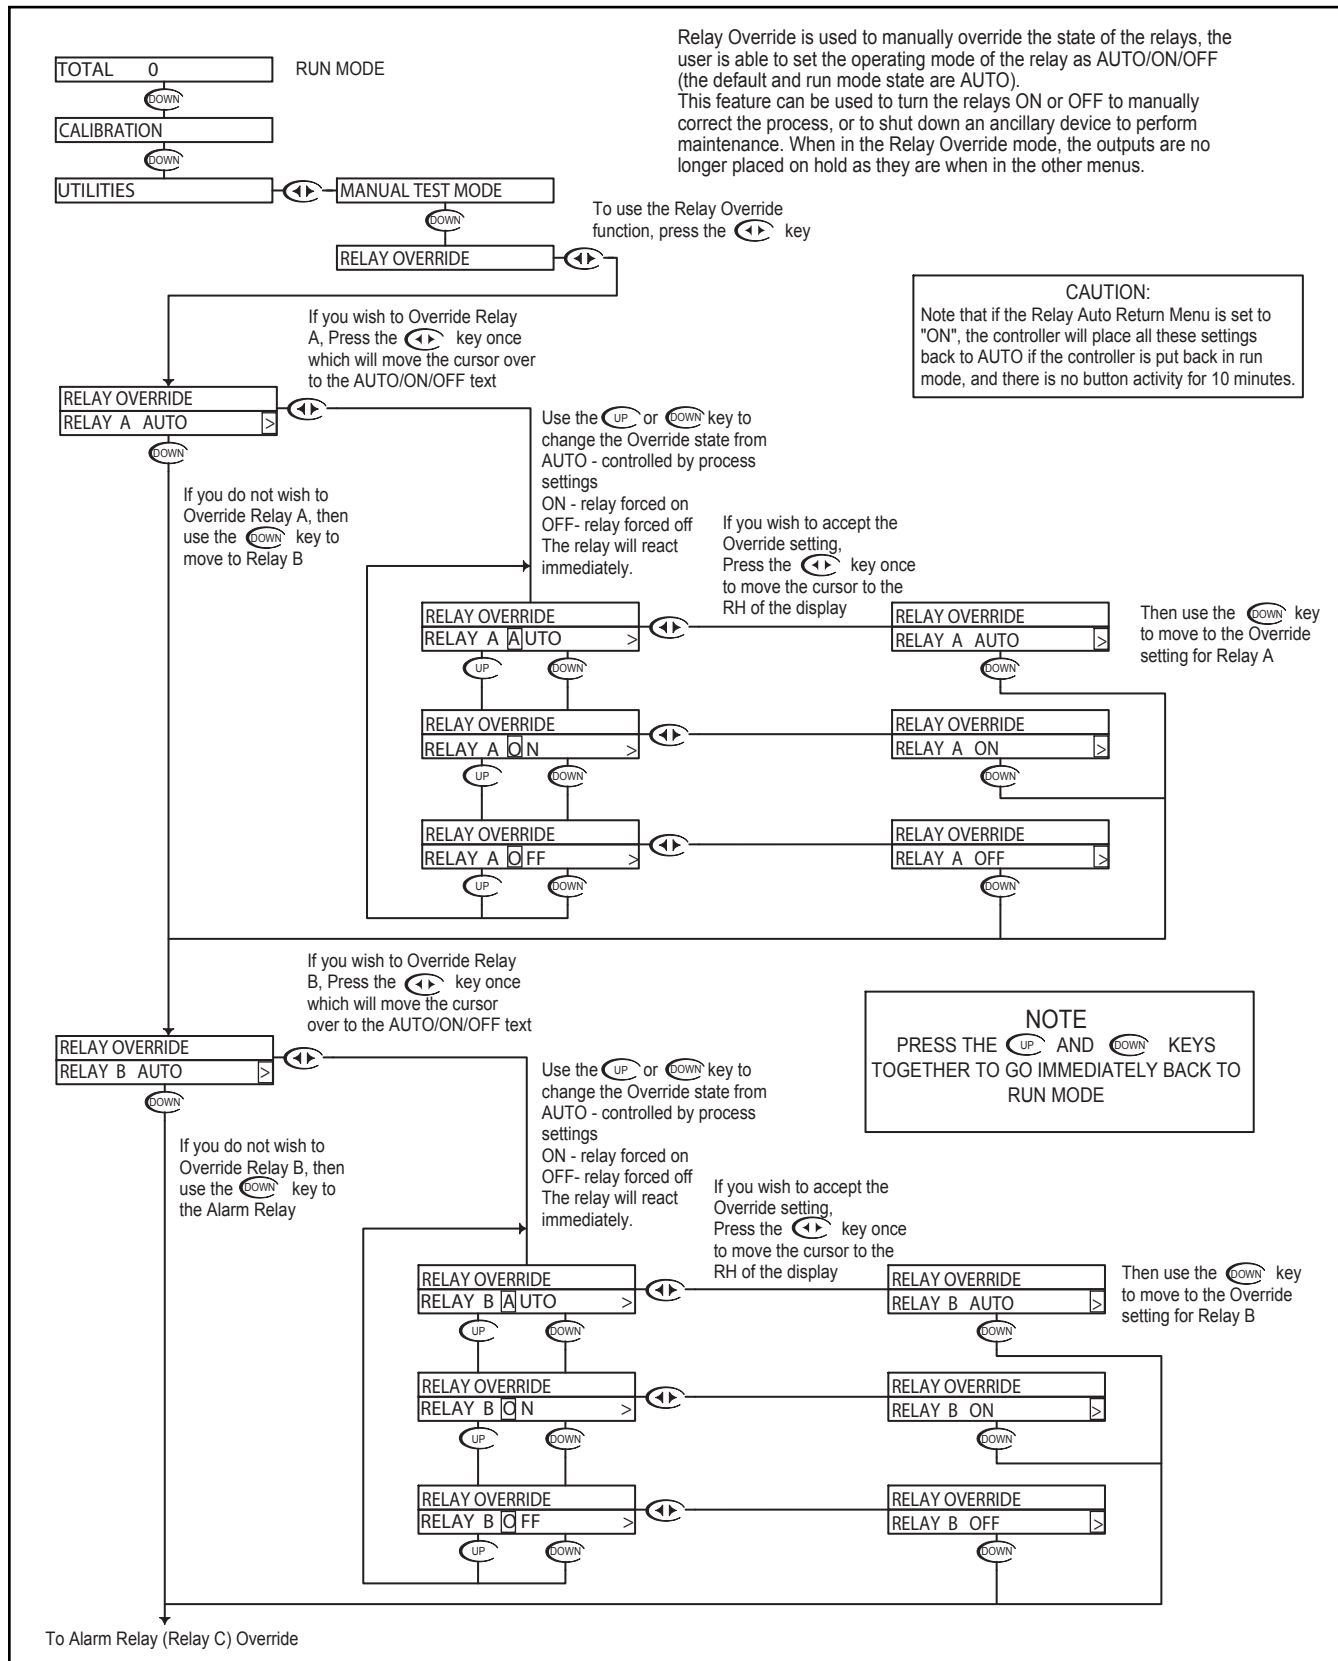




Flow - Utilities Menu - Relay Override 7.3

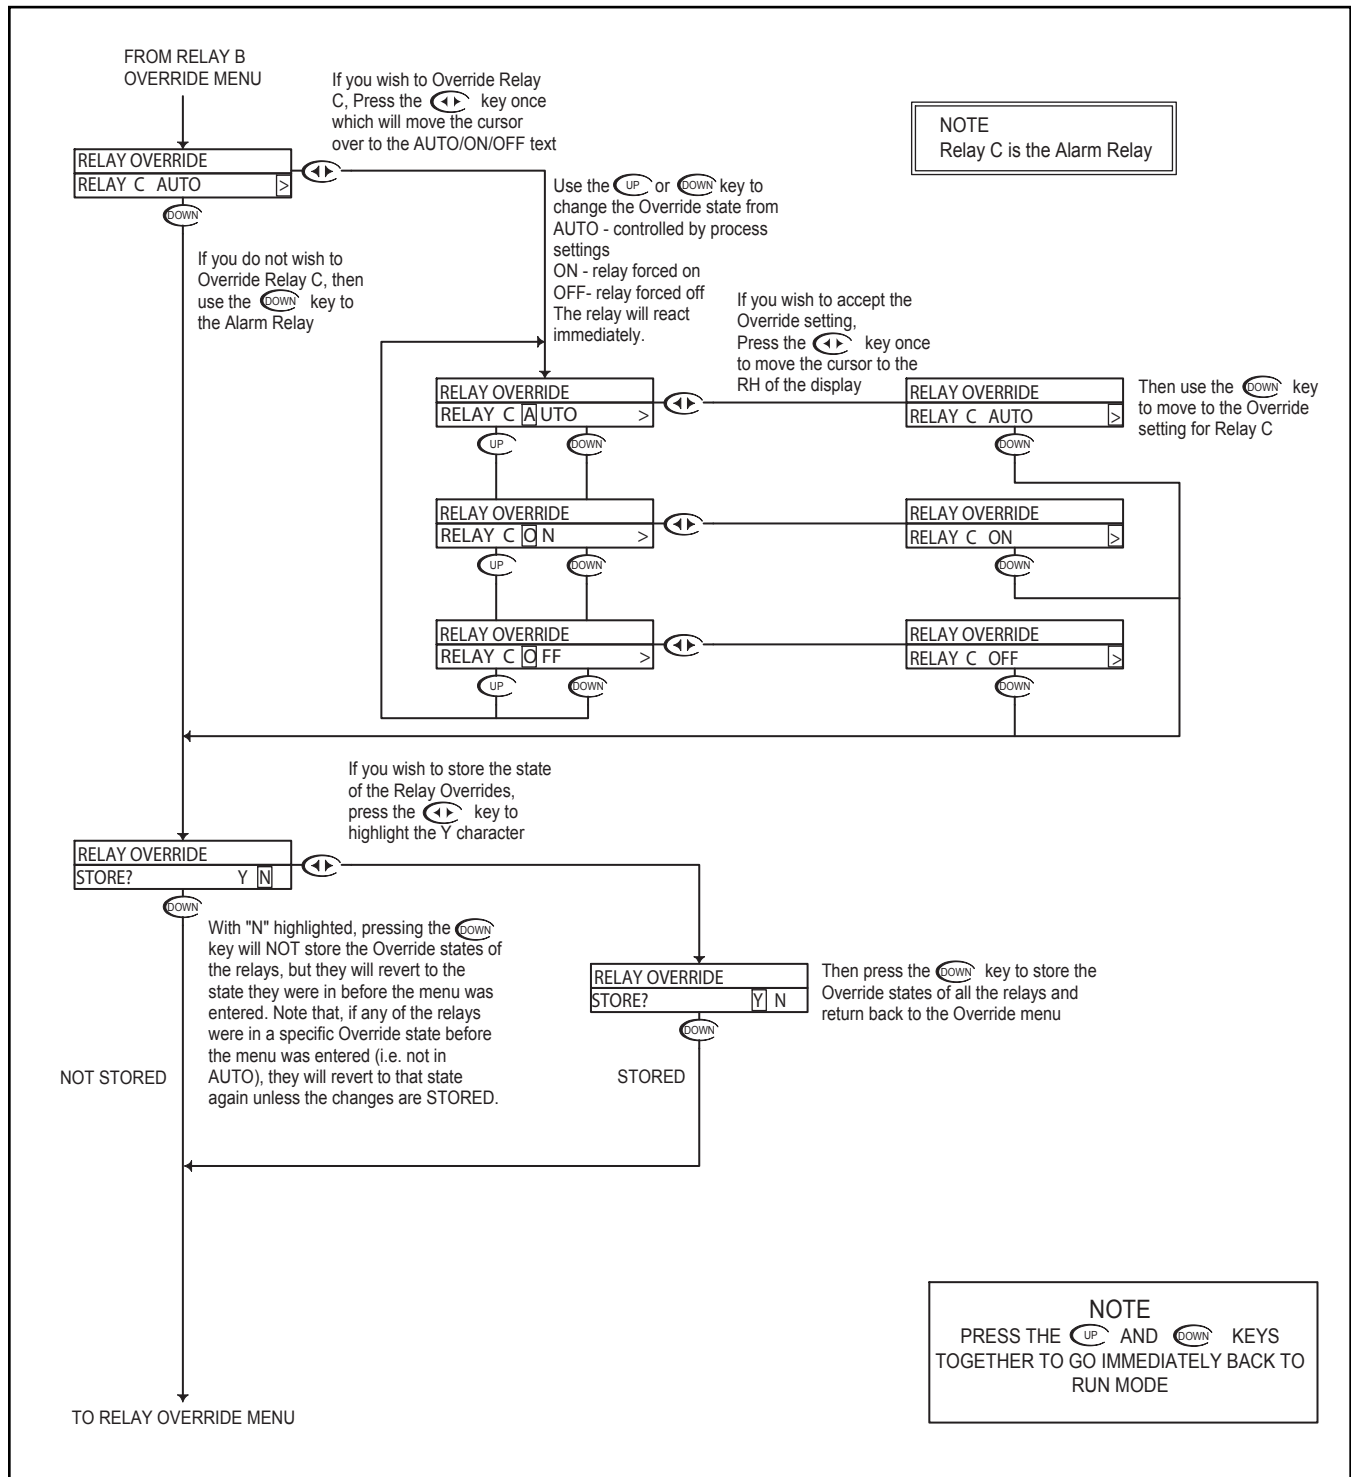

Flow - Utilities Menu - Meter Selection 7.4

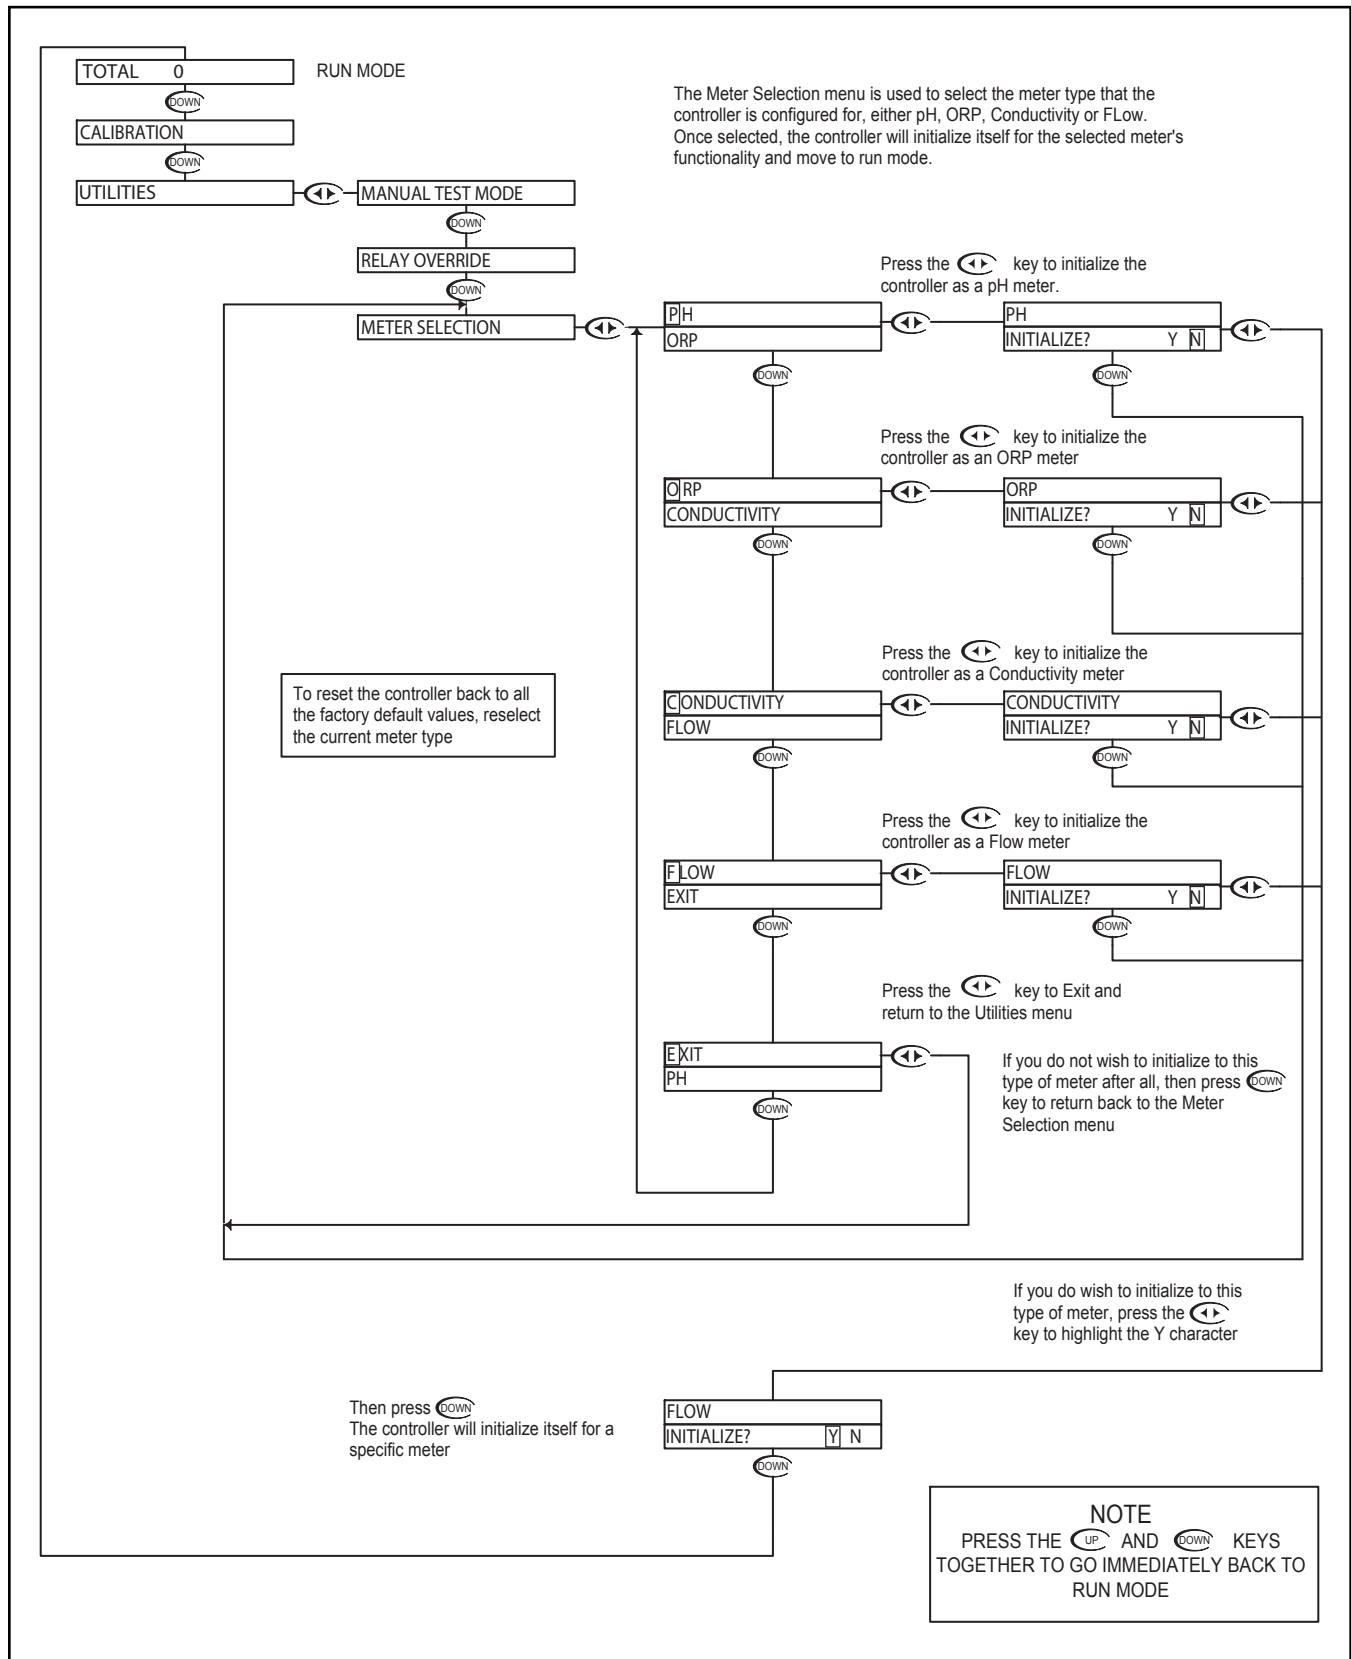



Flow - Setup Menu - Units of Volume 7.5

TOTAL 0
CALIBRATION
UTILITIES
SETUP

RUN MODE

The Units of Measurement is broken into two variables, UNITS OF VOLUME and UNITS OF TIME. The two variables are then combined to display the desired units of measure. For example, if units of Volume is to set Cubic Meters (CM) and Units of Time is set for Seconds (S), the the controller will display flow as Cubic Meters per Second on the front LED display.

UNITS OF VOLUME

The user can select from four predefined units of Volume, or create their own custom value. The four predefined units are

US Gallons GP

Cubic Feet CF

Liters LP

Cubic Meters CM

The user can also select any custom two characters to represents units from AA to ZZ and an input multiplier which will numerically relate the custom unit of measure to US Gallons. The input multiplier can be set at any value between 0.0001 and 10000.

WARNING

Changing the units of Volume with an accumulated flow total will reset the flow total to zero.

Example: If the controller has been running in GPM mode and has a totalized flow, changing from GPM to another unit will reset the totalizer to zero.


NOTE:

ACCELERATOR KEYS

Pressing the **UP** or **DOWN** key once will change the value by the smallest digit. Holding the key down will cause the value to change at an increasing rate until the key is released. Pressing the key again will cause the value to start changing at it's slowest rate again. This allows the user to get to the new multiplier value quickly.


NOTE

PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE

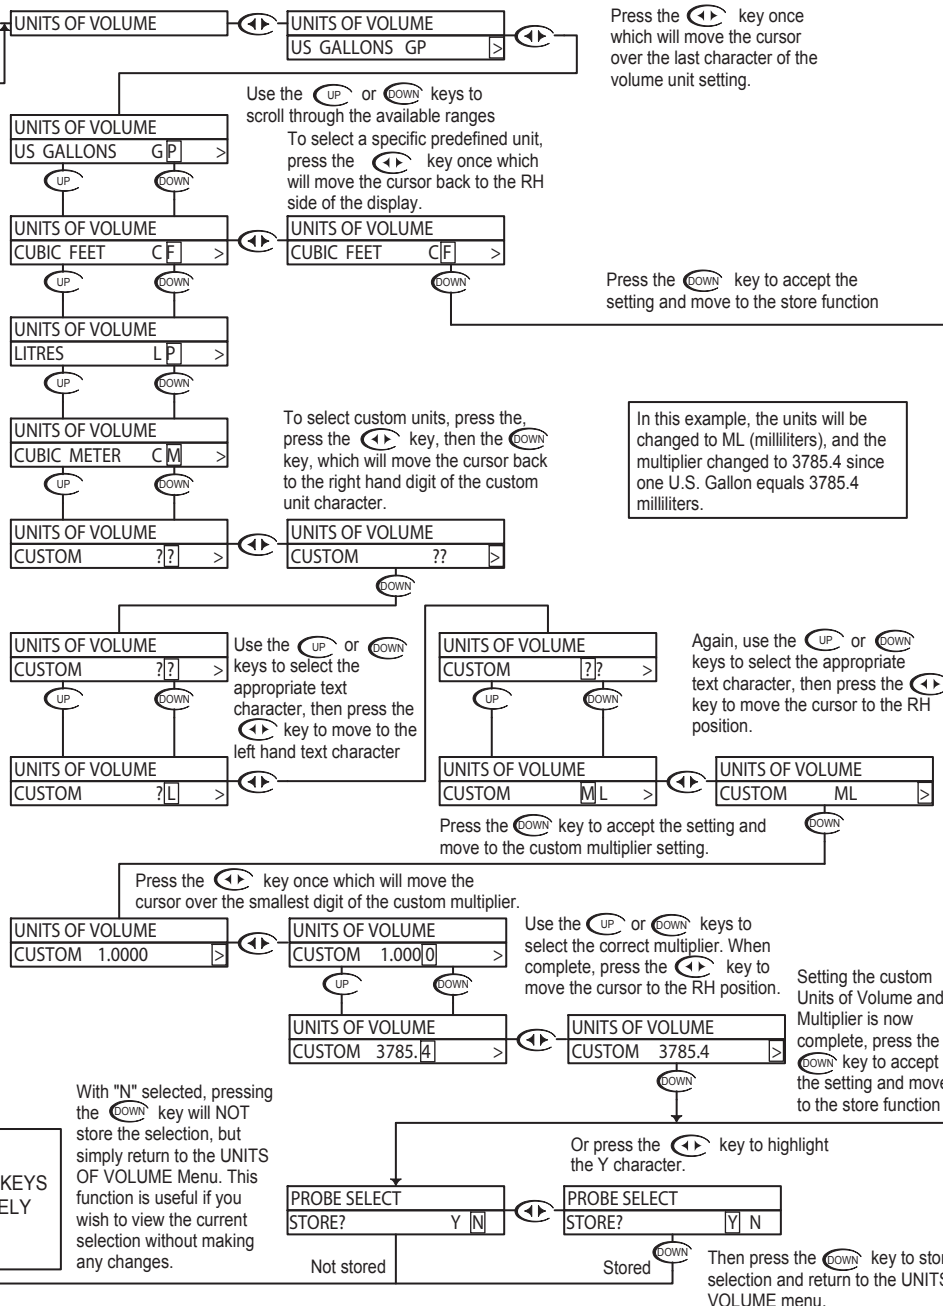




Flow - Setup Menu - Units of Time 7.6

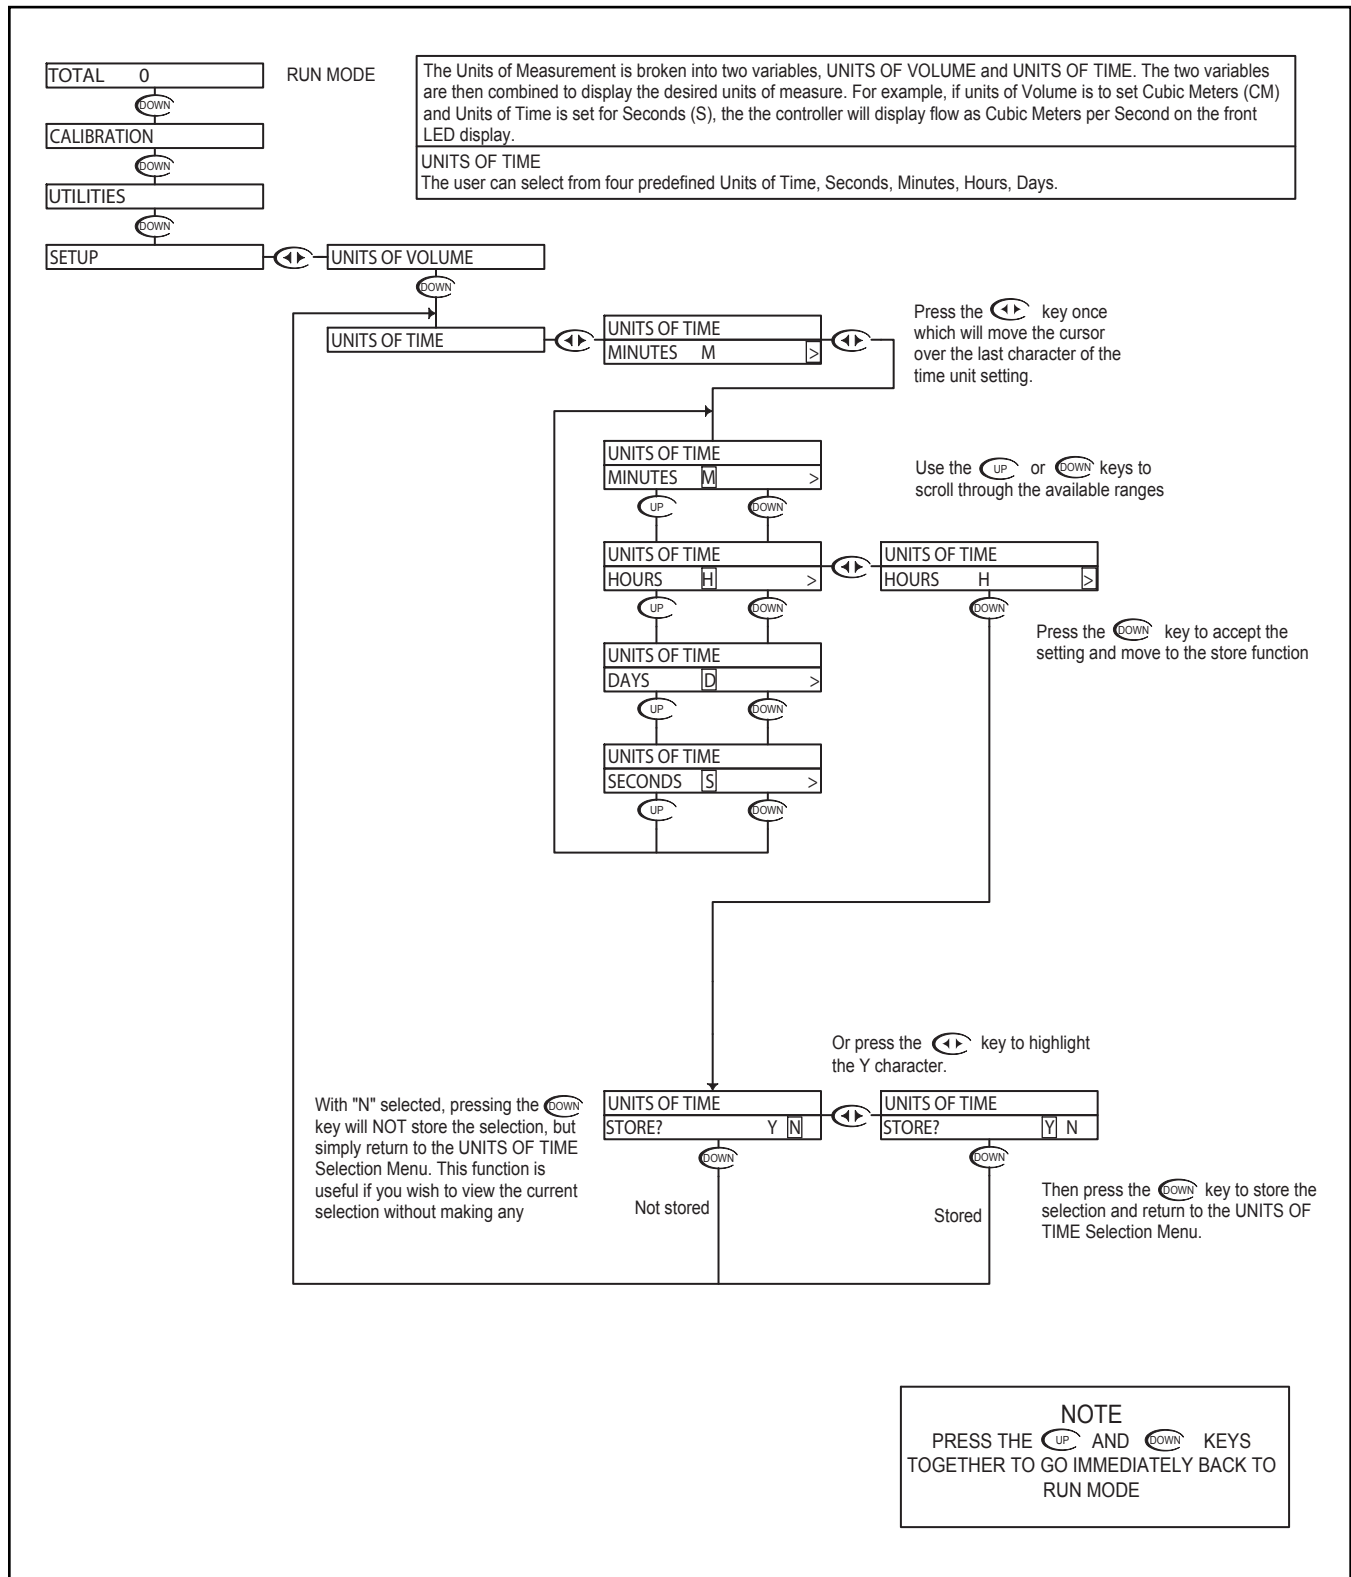




Flow - Setup Menu - Auto Return 7.7

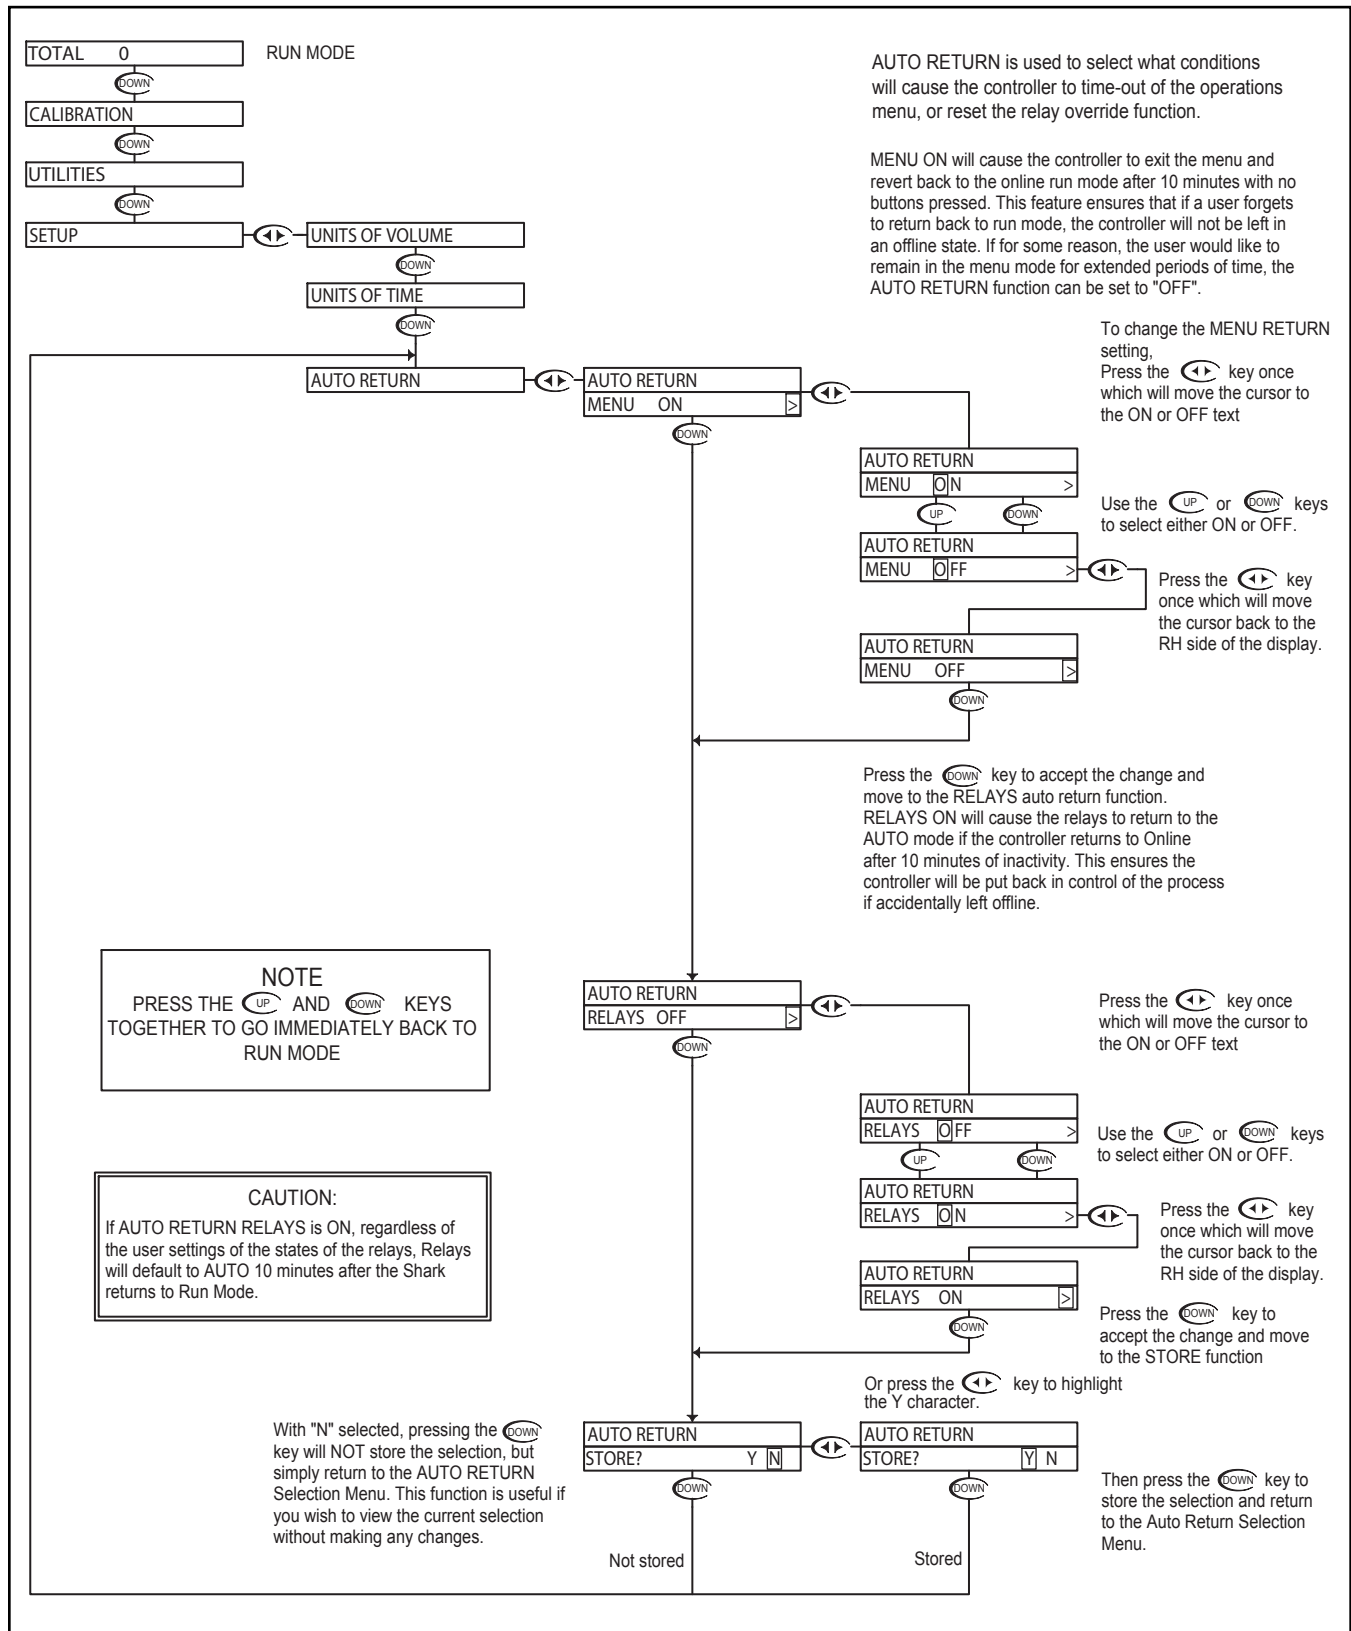




Flow - Setup Menu - Display Damping 7.8

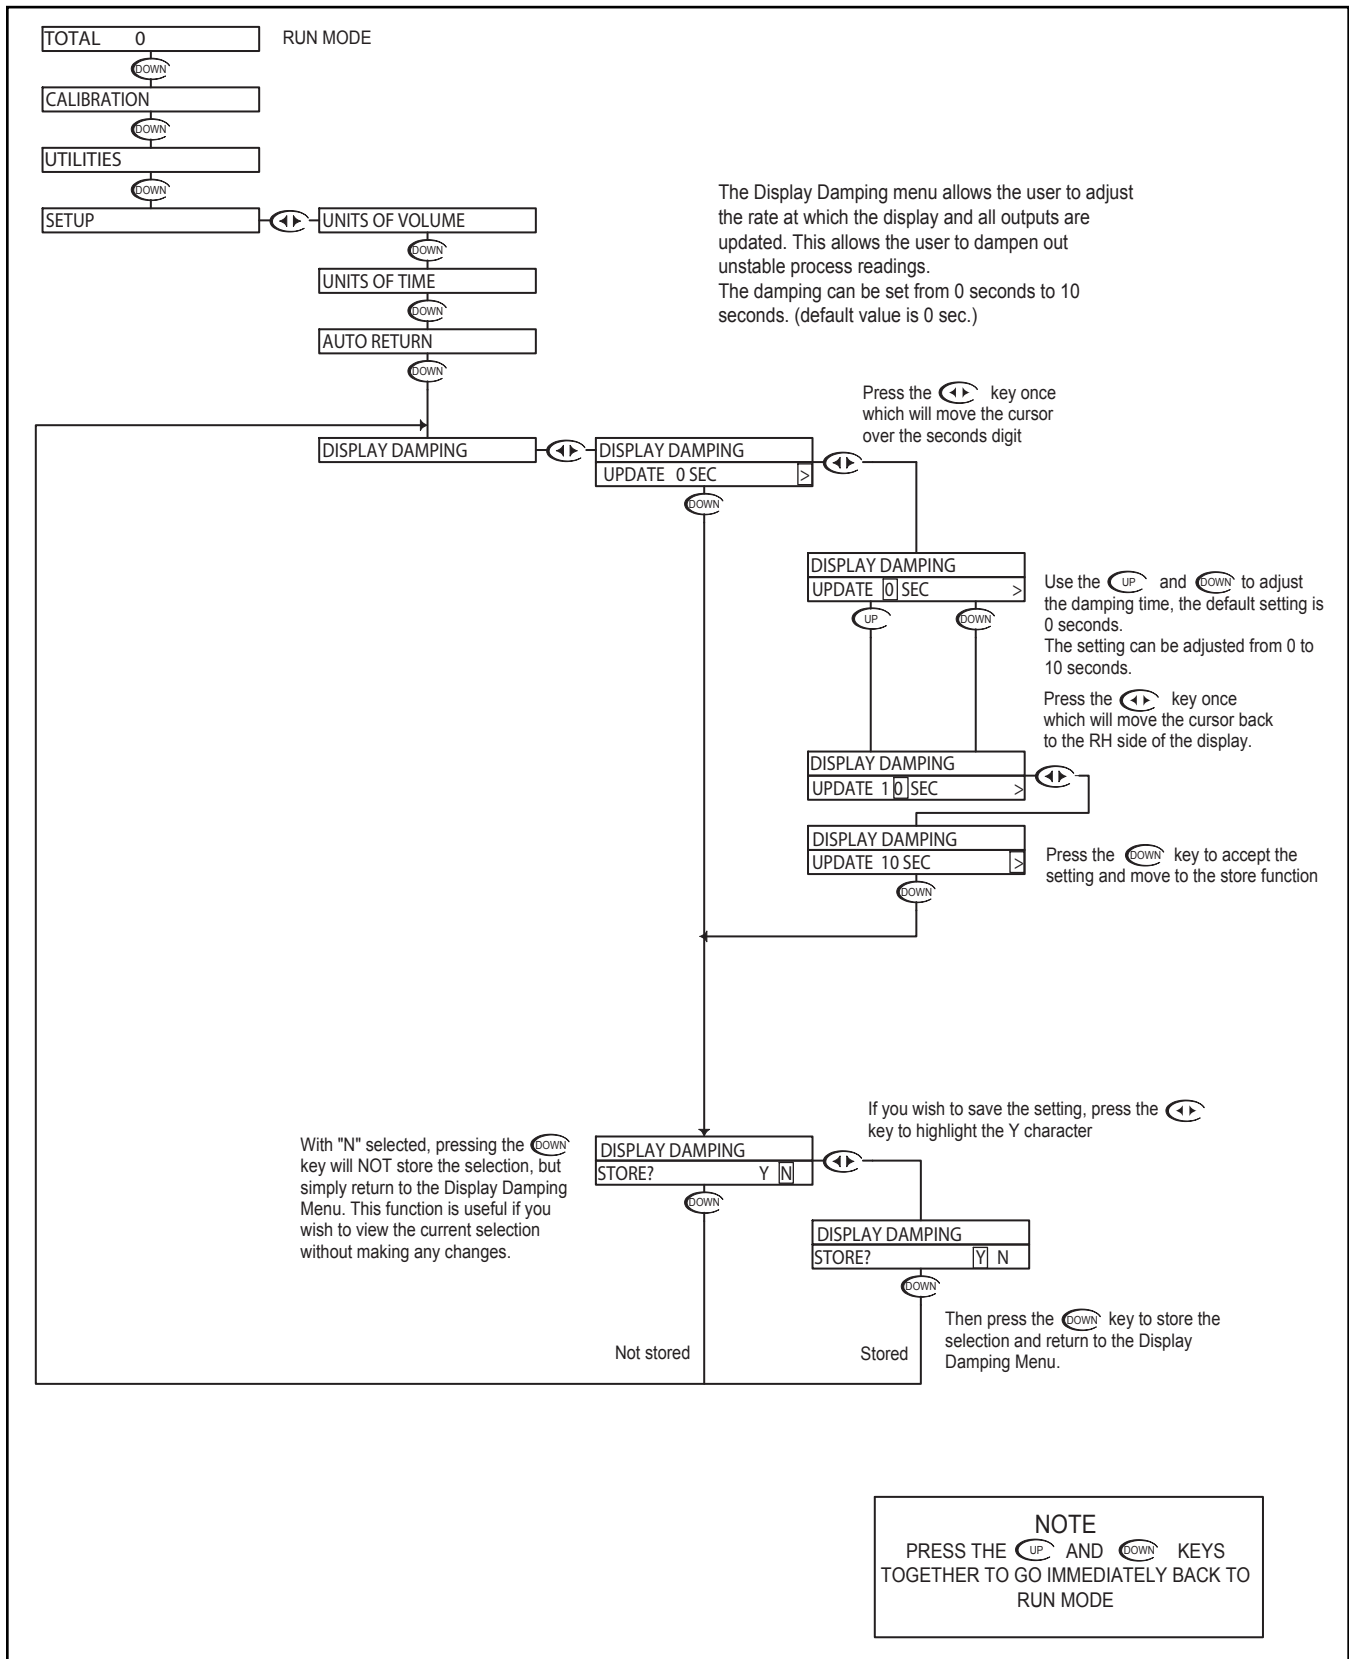



Flow - Setup Menu - Totalizer Reset 7.9

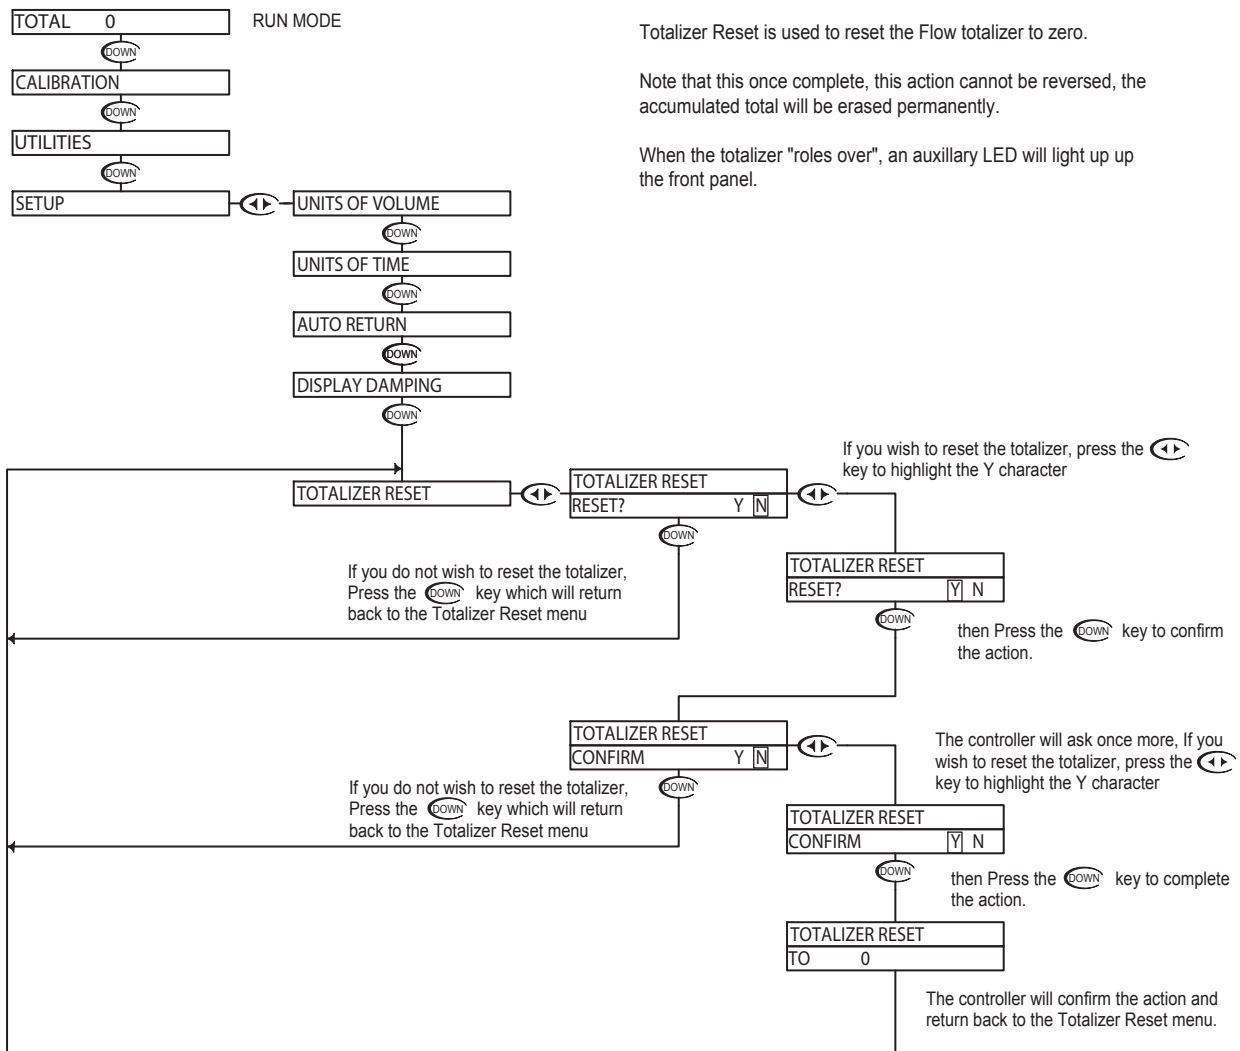

NOTE
PRESS THE **UP** AND **DOWN** KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Flow - Diagnostics Menu - Firmware Rev 7.10

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

FIRMWARE REV.

The FIRMWARE REV menu allows the user to see what revision of the firmware is currently installed in the controller. This is a Read Only menu item.

FIRMWARE REV.

1.15

DOWN

NOTE
PRESS THE **UP** AND **DOWN** KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Flow - Diagnostics Menu - Calibration Data 7.11

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

FIRMWARE REV.

DOWN

CALIBRATION DATA

Press to view the first Calibration Data screen.

CALIBRATION DATA
K FACTOR 125.00

DOWN

This screen shows the K factor entered during calibration.

Press to return to the Calibration Data menu.

NOTE

PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Flow - Diagnostics Menu - Sensor Input 7.12

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

RIGHT

FIRMWARE REV.

DOWN

CALIBRATION DATA

DOWN

SENSOR INPUT

RIGHT

FREQ 101 Hz

DOWN

The Sensor Input Menu allows the user to view real time signals from the probe. The display will show the current input pulse rate in Hz (pulses per second).

Press **RIGHT** to view the Sensor Input data.

Press **DOWN** to return to the menu.

NOTE
PRESS THE **UP** AND **DOWN** KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Flow - Diagnostics Menu - Permanent Total 7.13

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

LEFT/RIGHT

FIRMWARE REV.

DOWN

CALIBRATION DATA

DOWN

SENSOR INPUT

DOWN

PERMANENT TOTAL

LEFT/RIGHT

TOTAL LIFE FLOW

7421413

DOWN

Press to view the Total Life Flow to date.

Press to return to the menu.

NOTE

PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Flow - Diagnostics Menu - Total Rollover 7.14

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

LEFT/RIGHT

FIRMWARE REV.

DOWN

CALIBRATION DATA

DOWN

SENSOR INPUT

DOWN

PERMANENT TOTAL

DOWN

TOTAL ROLLOVER

LEFT/RIGHT

Press LEFT/RIGHT to view the
Totalizer Rollovers to date.

TOTAL ROLLOVER
PER 0 RST 0

DOWN

The Total Rollover menu is another read only screen. It is used to indicate how many times the Permanent and Resetable Totalizers have rolled over during the life of the controller.

PER indicate the number of times the
Permanent Totalizer has rolled over.
RST indicates the number of times the
Resetable Totalizer has rolled over.

Press DOWN to return to the
menu.

NOTE
PRESS THE UP AND DOWN KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Flow - Outputs Menu - Relay A 7.15

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

DOWN

OUTPUTS

RELAY A

DOWN

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

RELAY B

Relay B can be configured for the following operations

- Response to rising or falling process values
- Adjustable on and off set-points
- Cycle on and off times
- Failsafe operation

Each function will be explained below

The relay can be set to control either a RISING or FALLING process. In a RISING process, the control relay will energize when the process rises above a set value. In this case, the ON set-point must be set higher than the OFF set-point. In a FALLING process, the control relay will energize when the process falls below a set value. In this case, the ON set-point must be set lower than the OFF set-point.

The RELAY ON setting is the process value at which the relay will energize. It may be set anywhere in the normal range of the sensor.

The RELAY OFF setting is the process value at which the relay will de-energize. The setting must be rationalized against the On setting. For example, in a falling process, the Off setting must be higher than the ON setting.

The controller will not allow you to select the RELAY OFF value on the wrong side of the RELAY ON value for the selected direction. If the user tries to set the RELAY OFF on the wrong side, the following errors will be displayed:

FALLING PROCESS
ON SPT < OFF SPT

Error when trying to set OFF point lower than ON point when set to falling.

RISING PROCESS
ON SPT > OFF SPT

Error when trying to set OFF point higher than ON point when set to rising.

TO CYCLE ON

Use the UP and DOWN keys to change the setting

Press the key once which will move the cursor back to the RH side of the display.

Press the DOWN key to accept the setting and move to the next setting

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

Use the UP and DOWN keys to change the setting

Press the key once which will move the cursor back to the RH side of the display.

Press the DOWN key to accept the setting and move to the next setting

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

Use the UP and DOWN keys to change the setting

Press the key once which will move the cursor back to the RH side of the display.

NOTE
PRESS THE UP AND DOWN KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Flow - Outputs Menu - Relay A 7.15

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds. The default ON time is 5 seconds.

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0.

The Default OFF time is 0 seconds.


The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption.


With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

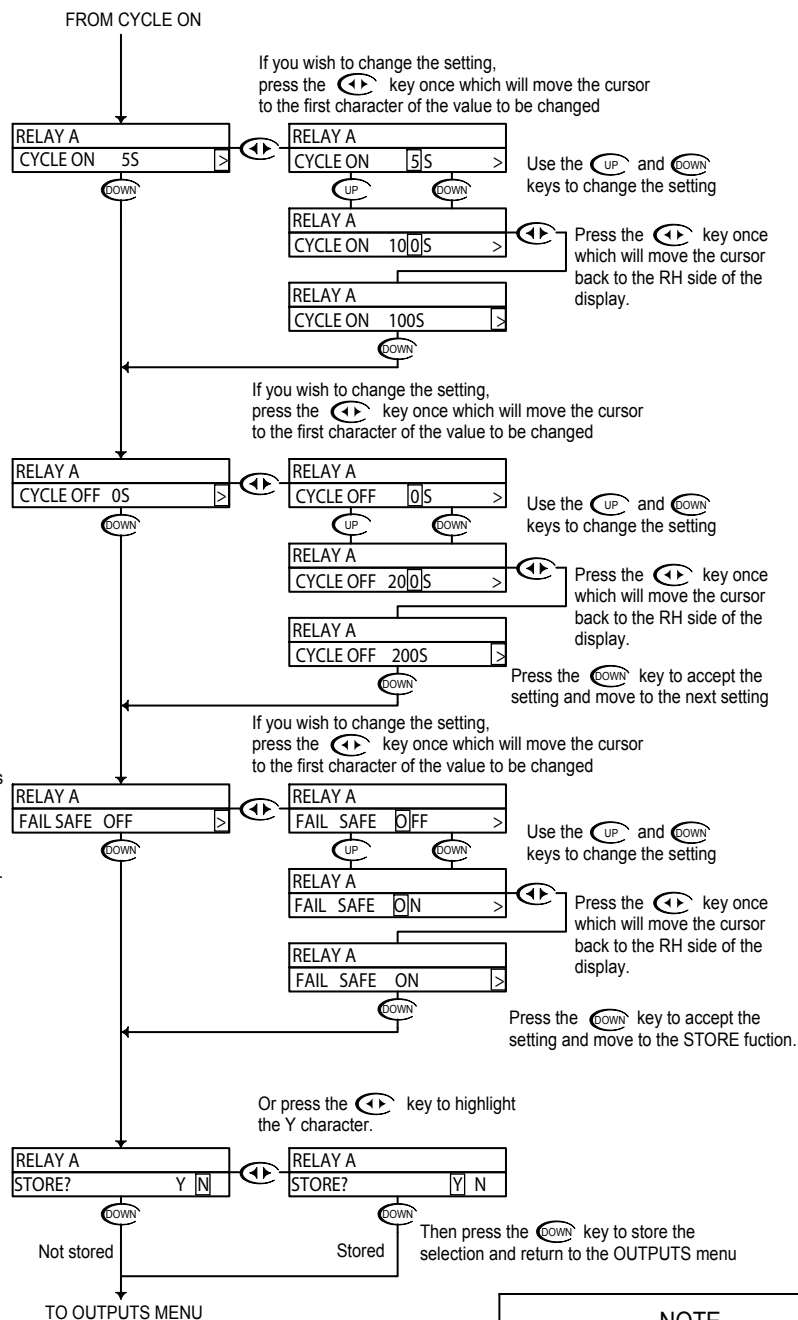

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Flow - Outputs Menu - Relay B 7.16

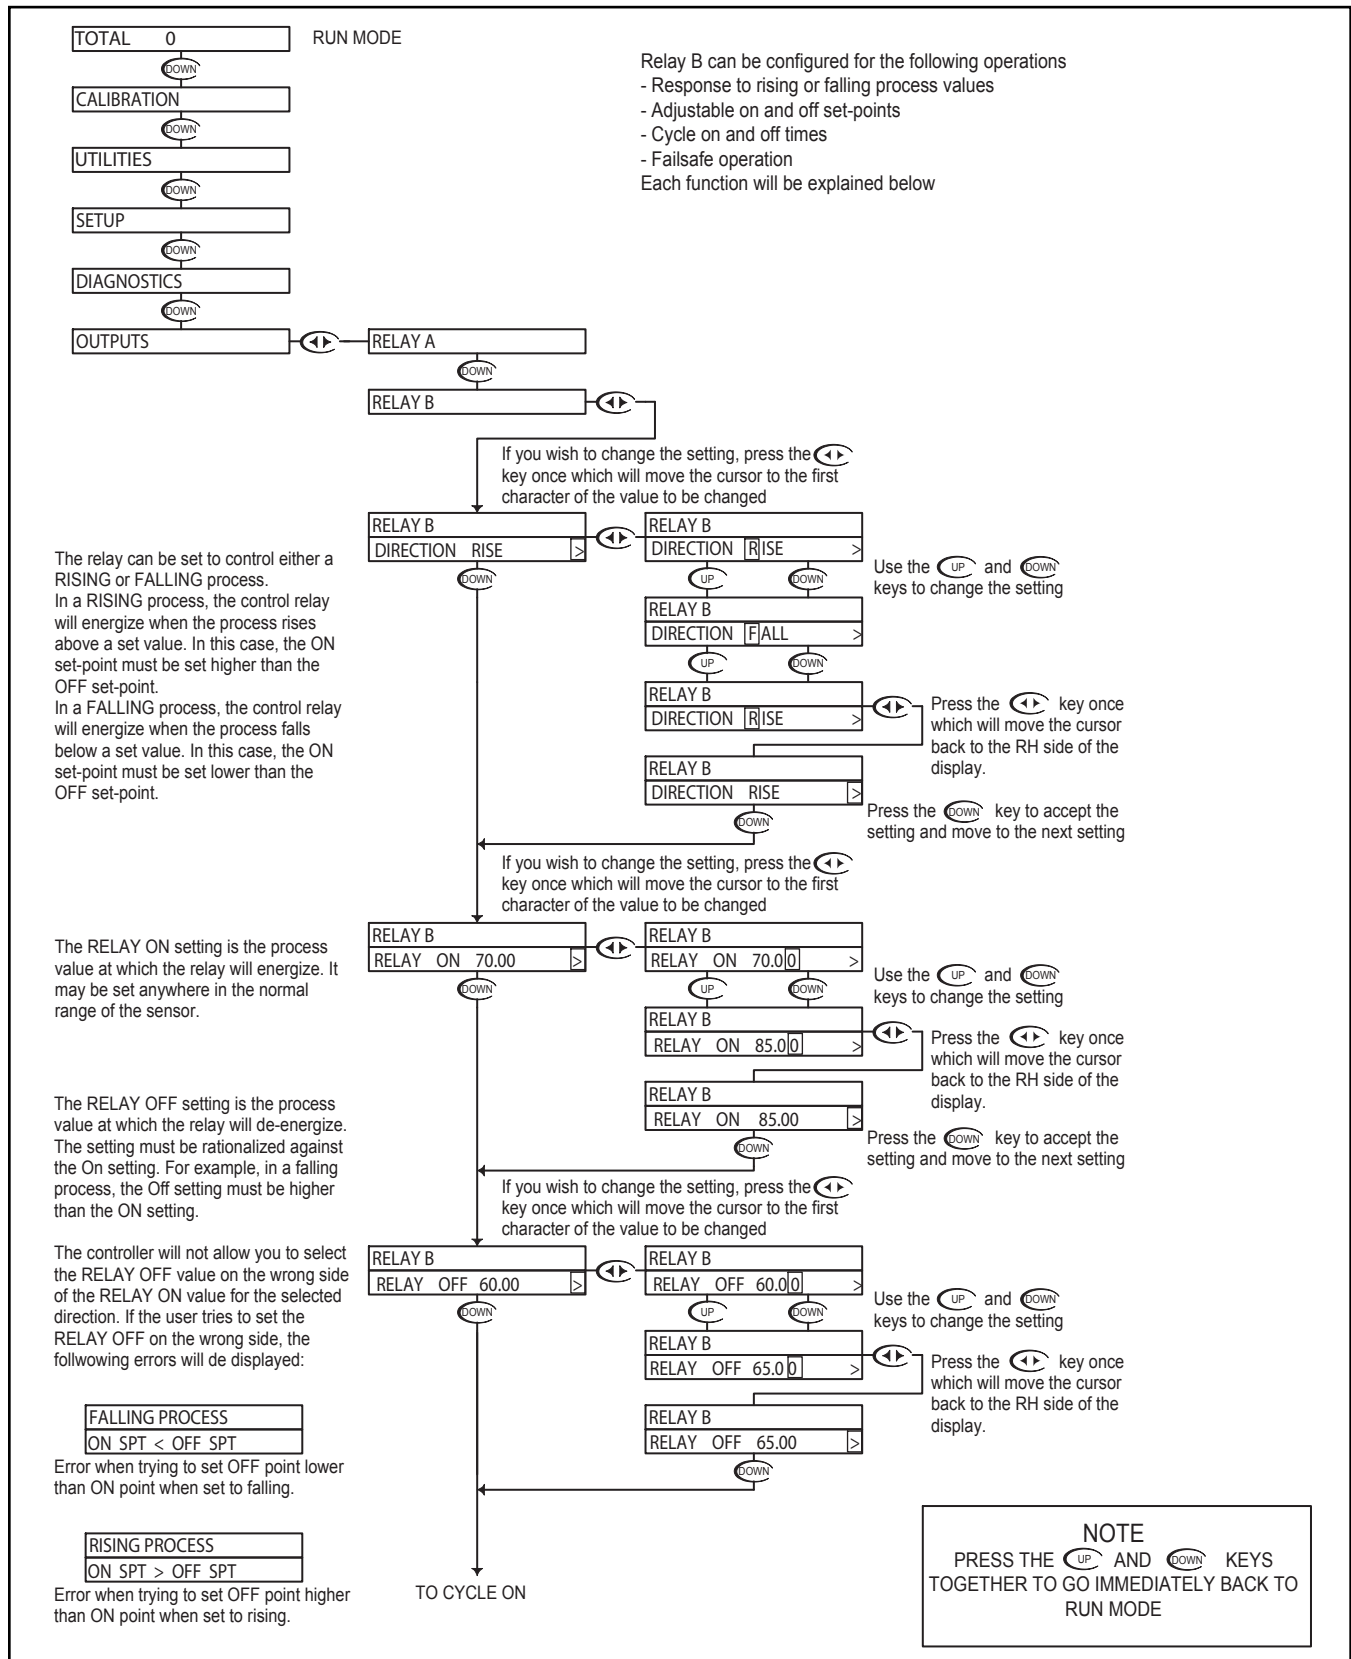



Flow - Outputs Menu - Relay B 7.16

The relay can be set to CYCLE when the process is between the RELAY ON setting and the RELAY OFF setting. This is meant to help eliminate overshoot.

The CYCLE ON time is the amount of time in seconds that the relay will be on. The value can be set between 0 and 600 seconds. The default ON time is 5 seconds.

The CYCLE OFF time is the amount of time in seconds that the relay will be off for, it can be set between 0 - 600 seconds.

To disable the cycling feature set the cycle off time to 0.

The default OFF time is 0 seconds.


The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off.

The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption. For example, a process that needs a constant feed, would want a pump to turn on in the event of a controller power failure.

With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

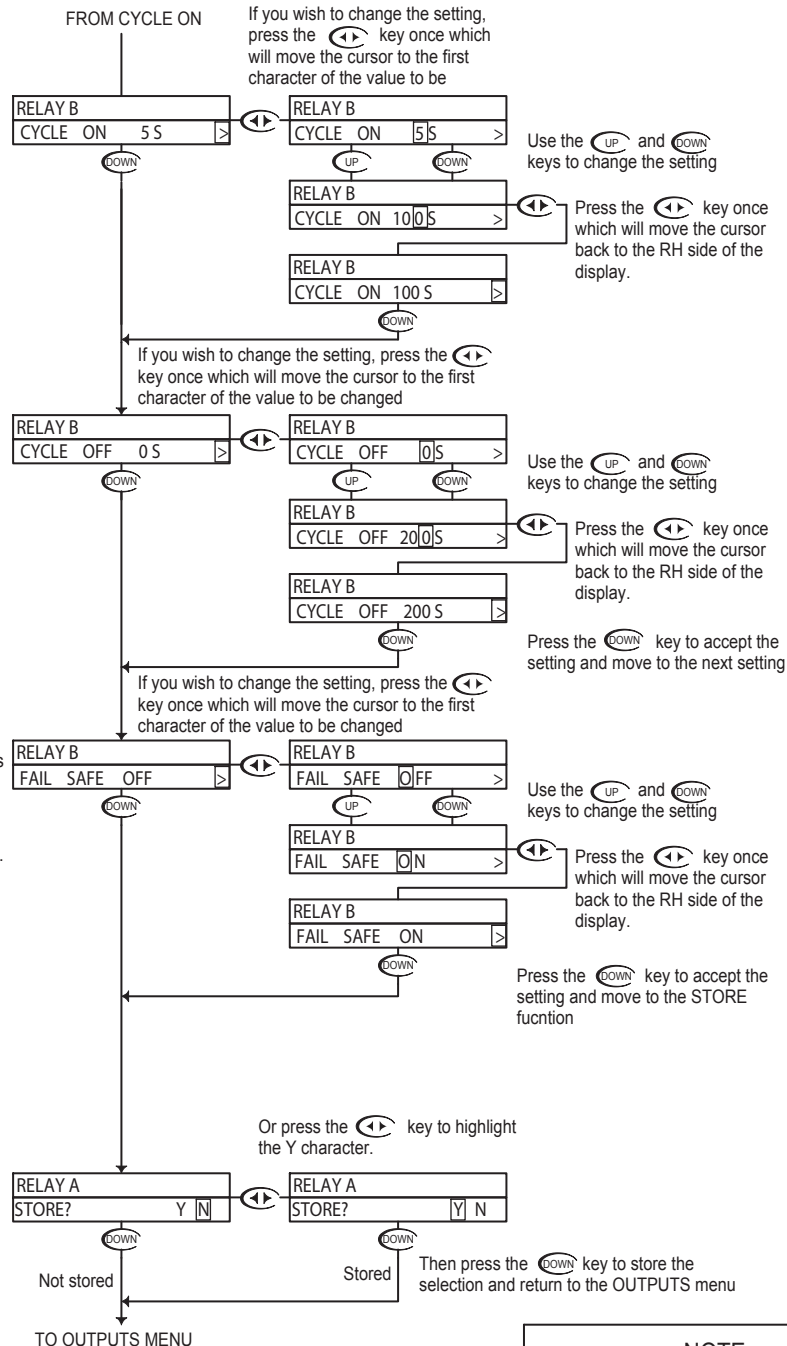

NOTE
PRESS THE **UP** AND **DOWN** KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Flow - Outputs Menu - Alarm Relay 7.17

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

DOWN

OUTPUTS

RELAY A

DOWN

RELAY B

DOWN

ALARM RELAY

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

The LOW ON set point is the low process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.

ALARM RELAY
LOW ON 25.00

DOWN

ALARM RELAY
LOW ON 25.00

UP

DOWN

Use the and keys to change the setting

ALARM RELAY
LOW ON 20.00

Press the key once which will move the cursor back to the RH side of the display.

ALARM RELAY
LOW ON 20.00

DOWN

Press the key to accept the setting and move to the next setting

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

The LOW OFF set point is the value that the process must reach in order to de-energize the alarm relay after it has dropped below and tripped the LOW ON set-point. This value must be higher than the LOW ON Set-point.

ALARM RELAY
LOW OFF 30.00

DOWN

ALARM RELAY
LOW OFF 30.00

UP

DOWN

Use the and keys to change the setting

ALARM RELAY
LOW OFF 22.00

Press the key once which will move the cursor back to the RH side of the display.

ALARM RELAY
LOW OFF 22.00

DOWN

Press the key to accept the setting and move to the next setting

If you wish to change the setting, press the key once which will move the cursor to the first character of the value to be changed

The HIGH ON set-point is the high process value that will cause the relay to energize. This value can be set anywhere 0-100% of Full Scale.

ALARM RELAY
HIGH ON 75.00

DOWN

ALARM RELAY
HIGH ON 75.00

UP

DOWN

Use the and keys to change the setting

ALARM RELAY
HIGH ON 90.00

Press the key once which will move the cursor back to the RH side of the display.

ALARM RELAY
HIGH ON 90.00

DOWN

TO HIGH OFF

NOTE
PRESS THE AND KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Flow - Outputs Menu - Alarm Relay 7.17

The HIGH OFF set-point is the value that the must reach in order to de-energize the alarm relay after it has increased over and tripped the HIGH ON set-point. This value must be lower than the HIGH ON Set-point.

The FAIL SAFE feature is designed to reverse the normal action of the relay.

When set to FAIL SAFE OFF, the relay will operate as a normal relay, which means that when the relay is not energized the NO contacts are open, and a device connected via the NO contacts is turned off. When the relay becomes energized the device turns on.

When the relay is set to FAIL SAFE ON, the normal action of the relay is reversed. Thus the NO contact acts as the NC contacts and the NC acts as the NO. Therefore the device connected to the NC contacts will be turned on when the relay on set-point is reached. Actually the relay will be de-energized but because it is acting in reverse the device will be turned on. When the relay off set-point is reached the relay will energize and the device connected to the NC contact will turn off. The reason that the Fail Safe option would be used is to have the device turned on in the event of a power interruption.

If the Low On set-point is set higher than the factory default Low Off set-point, when the user advances from the low on set-point to the Low Off set-point the controller will adjust the Low Off set-point to be equal to the Low On set-point. If the user then tries to decrease the Low Off set-point the Controller will display the Low Alarm setup error screen.


LOW ALARM
ON SPT < OFF SPT

This screen will be displayed for 10 seconds, then return back to the setup screen that was previously displayed. The same conditions apply to the High alarm set-points. Except the High Off set-point must be lower than the High On set-point. If the user tries to increase the High Off set-point higher than the High On set-point the High Alarm setup error screen will be displayed.

HIGH ALARM
ON SPT > OFF SPT

If the user sets the low on set-point and the low off set-point equal to 0, it will disable the Low Alarm relay. Similarly, setting the High on set-point and the HIGH OFF set-point to 0 will disable the High Alarm.


With "N" selected, pressing the **DOWN** key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without making any changes.

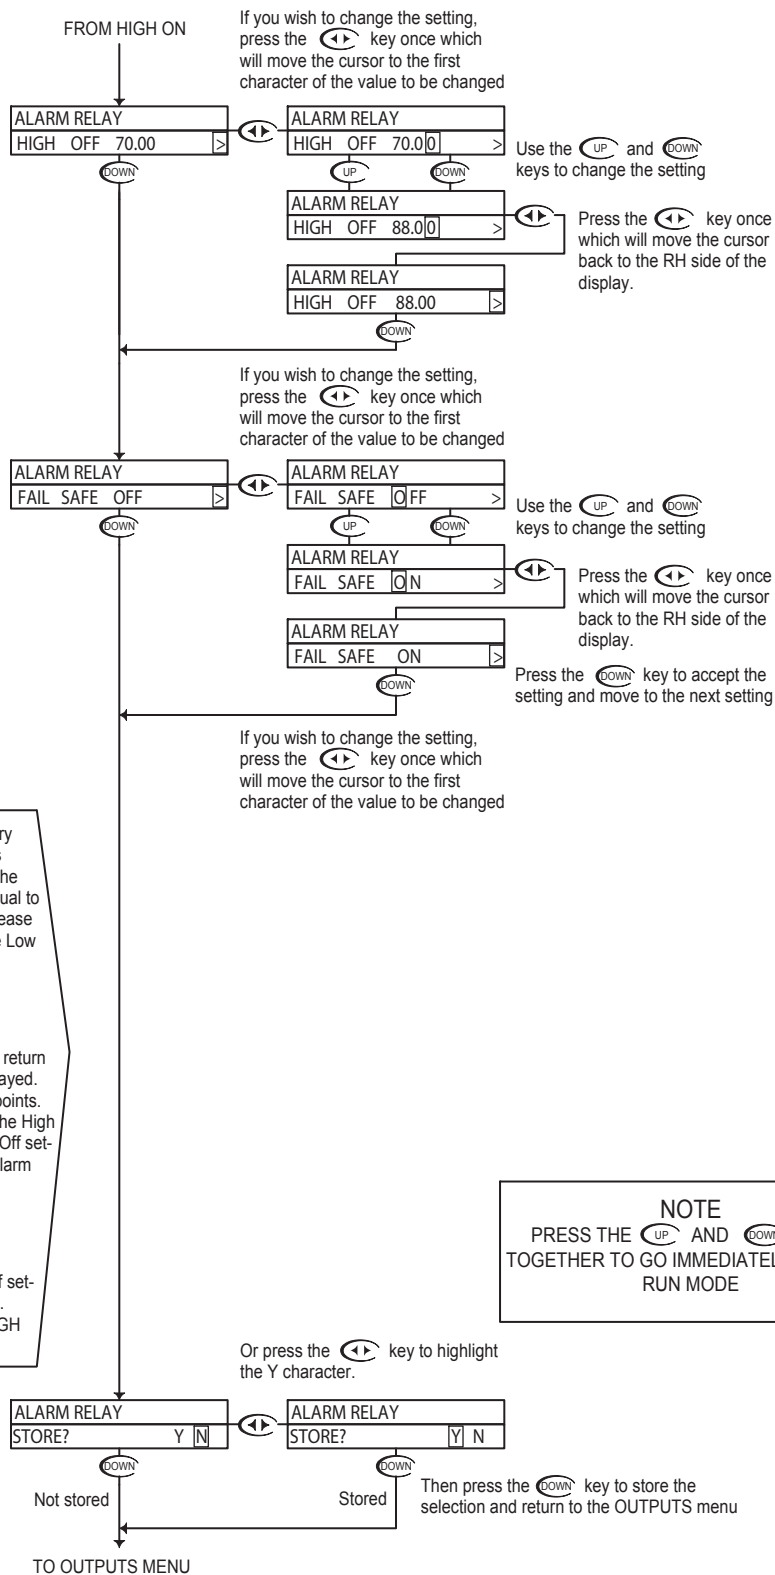

NOTE
PRESS THE **UP** AND **DOWN** KEYS TOGETHER TO GO IMMEDIATELY BACK TO RUN MODE



Flow - Outputs Menu - 4-20mA CH1 Output 7.18

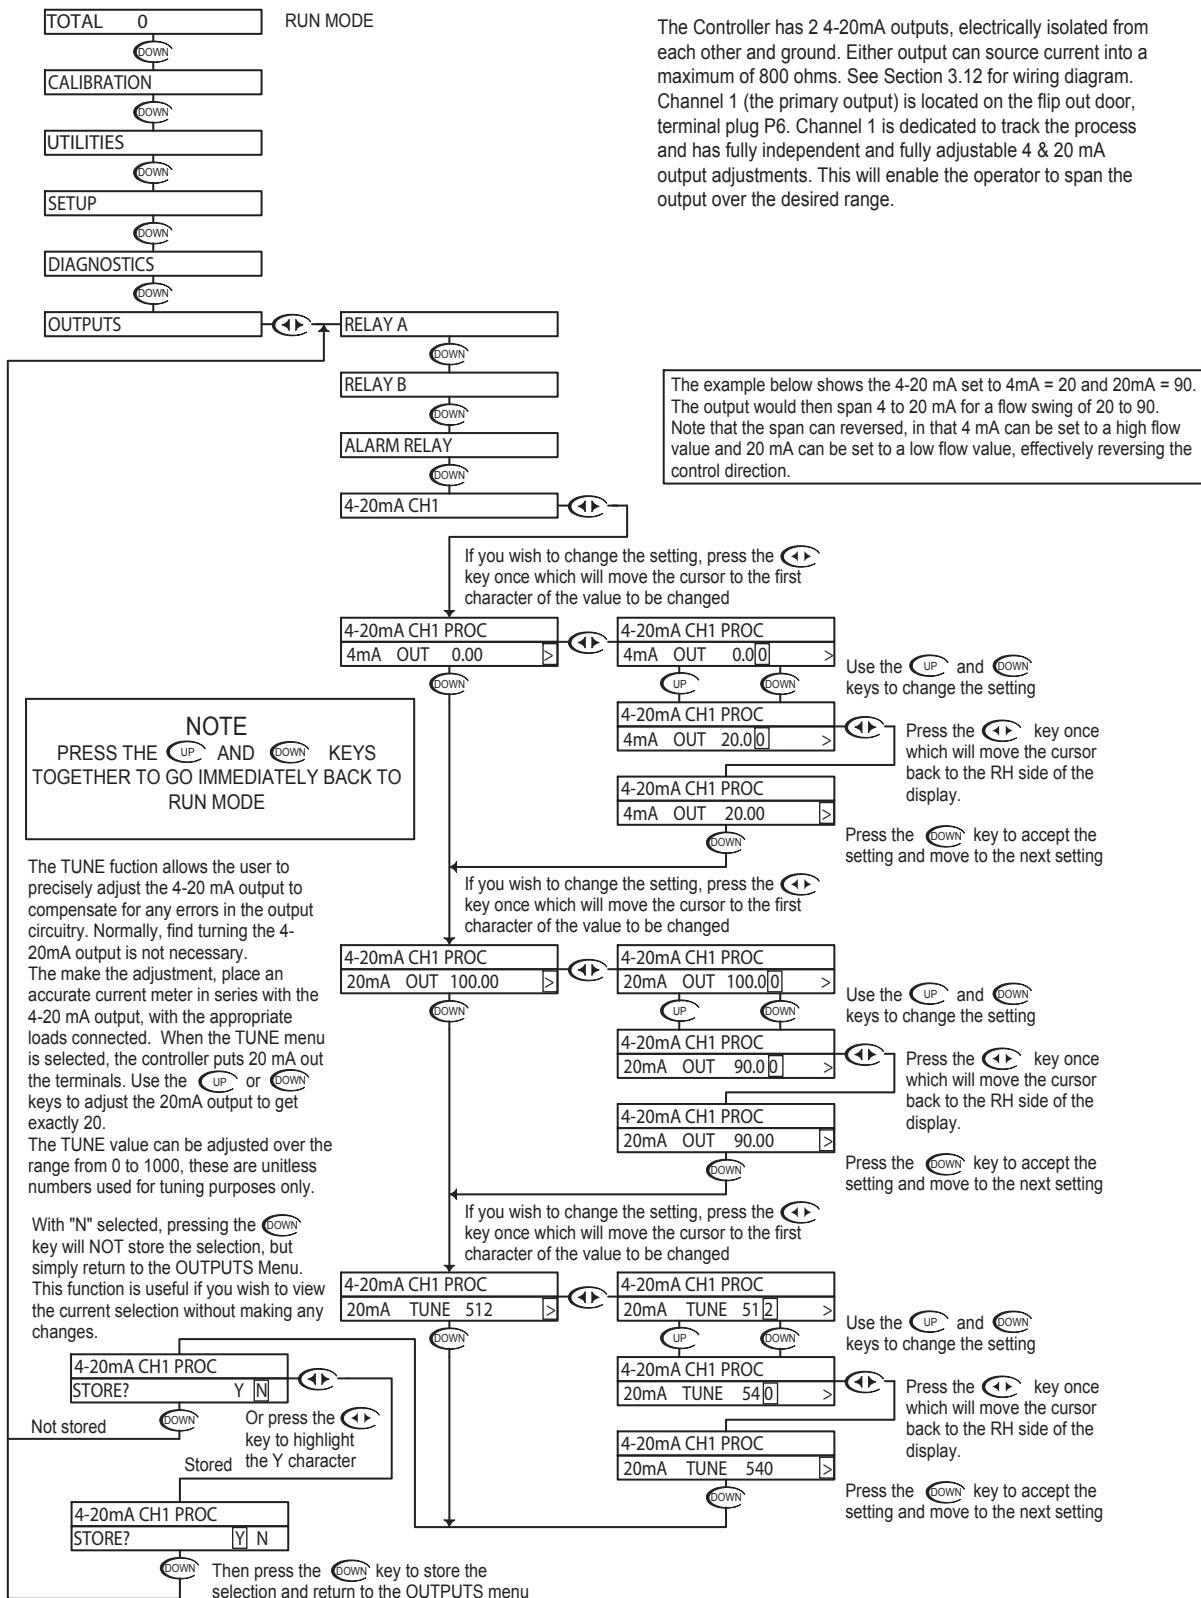



Flow - Outputs Menu - 4-20mA CH2 Output 7.19

TOTAL 0 RUN MODE

DOWN

CALIBRATION

DOWN

UTILITIES

DOWN

SETUP

DOWN

DIAGNOSTICS

DOWN

OUTPUTS

LEFT RIGHT

RELAY A

DOWN

RELAY B

DOWN

ALARM RELAY

DOWN

4-20mA CH1

DOWN

4-20mA CH2

LEFT RIGHT

The TUNE function allows the user to precisely adjust the 4-20mA output to compensate for any errors in the output circuitry. Normally, fine tuning the 4-20mA output is not necessary. To make the adjustment, place an accurate current meter in series with the 4-20mA output, with the appropriate loads connected. When the TUNE menu is selected, the controller puts 20mA out to the terminals. Use the UP or DOWN keys to adjust the 20mA output to get exactly 20.

The TUNE value can be adjusted over the range from 0 to 1000, these are unitless numbers used for tuning purposes only.

With "N" selected, pressing the DOWN key will NOT store the selection, but simply return to the OUTPUTS Menu. This function is useful if you wish to view the current selection without

If you wish to change the setting, press the LEFT RIGHT key once which will move the cursor to the first character of the value to be changed

4-20 CH2 PROC
4MA OUT 0.00

DOWN

4-20 CH2 PROC
20MA OUT 100.0

DOWN

4-20 CH2 PROC
20MA TUNE 512

DOWN

4-20mA CH2 PROC
STORE? Y N

LEFT RIGHT

Not stored

DOWN

Stored

Or press the LEFT RIGHT key to highlight the Y character

4-20mA CH2 PROC
STORE? Y N

DOWN

Then press the DOWN key to store the selection and return to the OUTPUTS menu

The Controller has 2 4-20mA outputs, electrically isolated from each other and ground. Either output can source current into a maximum of 800 ohms.

Channel 2 has fully independent and fully adjustable 4 & 20 mA output adjustments. This will enable the operator to span the output over the desired range.

The 4mA, 20mA and TUNE functions are set up the same way as 4 - 20 mA CH 1 output.

NOTE
PRESS THE UP AND DOWN KEYS
TOGETHER TO GO IMMEDIATELY BACK TO
RUN MODE



Appendix A - Probe Configuration Table

Model#	Probe Select	Temp. Sensor	Model#	Probe Select	Temp. Sensor
P60C-4	DIFFERENTIAL	300Ω	R60C-4	DIFFERENTIAL	300Ω
P60C-4-A	DIFFERENTIAL	300Ω	R60C-4-H	DIFFERENTIAL	300Ω
P60C-4-H	DIFFERENTIAL	300Ω	R60C-4-G	DIFFERENTIAL	300Ω
P60C-6	DIFFERENTIAL	300Ω	R60C-6	DIFFERENTIAL	300Ω
P60C-6-H	DIFFERENTIAL	300Ω	R60C-6-H	DIFFERENTIAL	300Ω
P60C-6-F	DIFFERENTIAL	300Ω	R60C-6-G	DIFFERENTIAL	300Ω
P60C-7	DIFFERENTIAL	300Ω	R60C-7	DIFFERENTIAL	300Ω
P60C-7-H	DIFFERENTIAL	300Ω	R60C-7-H	DIFFERENTIAL	300Ω
P60C-7-F	DIFFERENTIAL	300Ω	R60C-7-G	DIFFERENTIAL	300Ω
P60C-8	DIFFERENTIAL	300Ω	R60C-8	DIFFERENTIAL	300Ω
P60C-8-A	DIFFERENTIAL	300Ω	R60C-8-H	DIFFERENTIAL	300Ω
P60C-8-H	DIFFERENTIAL	300Ω	R60C-8-G	DIFFERENTIAL	300Ω
P60C-S	DIFFERENTIAL	300Ω	R60C-S	DIFFERENTIAL	300Ω
P60C-S-F	DIFFERENTIAL	300Ω	R60C-S-F	DIFFERENTIAL	300Ω
AM6010-PO	DIFFERENTIAL	300Ω	AM2010-RO	DIFFERENTIAL	300Ω
AM6070-PO	DIFFERENTIAL	300Ω	AM2070-RO	DIFFERENTIAL	300Ω
P525	COMBINATION	no. temp. sensor	AM2010-R1	DIFFERENTIAL	300Ω
P525-BNC	COMBINATION	no. temp. sensor	AM2070-R1	DIFFERENTIAL	300Ω
P575	COMBINATION	no. temp. sensor	R525	COMBINATION	no. temp. sensor
P575K-1	COMBINATION	Pt. 1000 RTD	R525-BNC	COMBINATION	no. temp. sensor
P575K-2	COMBINATION	300Ω	R575	COMBINATION	no. temp. sensor
P575-BNC	COMBINATION	no. temp. sensor	R575-BNC	COMBINATION	no. temp. sensor
P585	COMBINATION	no. temp. sensor	R585	COMBINATION	no. temp. sensor
P585K-1	COMBINATION	Pt. 1000 RTD	R585-BNC	COMBINATION	no. temp. sensor
P585K-2	COMBINATION	300Ω	R565	COMBINATION	no. temp. sensor
P585-BNC	COMBINATION	no. temp. sensor	R565L	COMBINATION	no. temp. sensor
P565	COMBINATION	no. temp. sensor			
P565L	COMBINATION	no. temp. sensor			



Return Policy & Warranty Plan

AQUAMETRIX, INC. RETURN POLICY

1. Contact Aquamatrix for a "Return Material Authorization" (RMA) form & number. This RMA number is required for all returns or they will not be accepted.
2. The RMA number must be written on the outside of the box for proper identification.
3. A copy of the RMA form along with a description of the problem, model & serial number must be attached with the returning item(s).
4. All C.O.D. & freight collect shipments will be refused unless authorized by AquaMetrix.
5. Shipping documents must indicate "RETURNING FOR REPAIR ONLY, NO COMMERCIAL VALUE".

12-MONTH AQUAMETRIX WARRANTY REPLACEMENT PLAN

AquaMetrix, Inc. will replace or repair any AquaMetrix SHARK controller that fails due to defects in material or workmanship for a period of up to 12 months from the date of shipment from our facility.

A warranty claim will not be honored if defects are not reported within the warranty period, or if AquaMetrix determines that defects or damages are due to normal wear, misapplication, lack of maintenance, abuse, improper installation, alteration, or abnormal conditions. AquaMetrix's obligation under this warranty shall be limited to, at its option, replacement or repair of this product. The product must be returned to AquaMetrix Inc, freight prepaid, for examination. The product must be accompanied with an MSDS for all the process chemicals used, must be thoroughly cleaned and any process chemicals removed before it will be accepted for replacement or repair. AquaMetrix liability shall not exceed the cost of the product. Under no circumstances will AquaMetrix be liable for any incidental or consequential damages, whether to person or property. AquaMetrix will not be liable for any other loss, damage or expense of any kind, including loss of profits, resulting from the installation, use, or inability to use this product.