- "EZ Setup"- Guided Setup for First Time Users
- Liquid, Gas, Steam and Heat Flow Equations
- Utility Metering Steam, Heating/Cooling, Chilled Water, Natural Gas, Compressed Air
- Menu Selectable Hardware & Software Features
- Internal Data Logger
- Isolated Pulse and Analog Outputs Standard
- RS-232 Port Standard, Provides Power for Modem
- RS-485 with Modbus RTU Optional
- Internal Communication Card Option Supports: BACnet IP, BACnet MS/TP, Metasys N2, Modbus TCP, AB Ethernet IP, AB DF1, LonWorks*
- Windows[™] Setup Software
- NX19 Gas Equations, Stacked DP Transmitters

Description:

The ES-749 Flow Computer satisfies the instrument requirements for a variety of flowmeter types in liquid, gas, steam and heat applications. Multiple flow equations are available in a single instrument with many advanced features.

The alphanumeric display offers measured parameters in easy to understand format. Manual access to measurements and display scrolling is supported

The versatility of the Flow Computer permits a wide measure of versatility within the instrument package. The various hardware inputs and outputs can be "soft" assigned to meet a variety of common application needs. The user "soft selects" the usage of each input/output while configuring the instrument.

Applications Include:

Steam Mass, Steam Heat, Natural Gas, Fuel 0il, Compressed Air, Chilled Water Only, Heated Water Only including Low DeltaT Cutout.

The isolated analog output can be chosen to follow the volume flow, corrected volume flow, mass flow, heat flow, temperature, pressure, or density by means of a menu selection. Most hardware features are assignable by this method.

The user can assign the standard RS-232 Serial Port for external data logging, transaction printing, or for connection to a modem for remote meter reading.

A Service or Test mode is provided to assist the user during start-up system check out by monitoring inputs and exercising outputs. The system setup can also be printed.

* LonWorks protocol requires a different module assembly from the other available protocols. LonWorks is not field selectable.

Utility Metering Flow Computer



- DDE Server & HMI Software Available
- Remote Metering by External Wireless or Modem
- Attractive Wall Mount Enclosure Available

Specifications: Environmental

Operating Temperature: 0 to +50 C Storage Temperature: -40 to +85 C Humidity: 0-95% Non-condensing Materials: UL, CSA, VDE approved

Display

Type: 2 lines of 20 characters

Types: Backlit LCD, OLED and VFD ordering options Character Size: 0.2" nominal

User selectable label descriptors and units of measure

Keypad

Keypad Type: Membrane Keypad with 16 keys

Keypad Rating: Sealed to NEMA 4X / IP65

Enclosure

Enclosure Options: Panel, Wall, Explosion Proof Size: See Dimensions

Depth behind panel: 6.5" including mating connector

Type: DIN Materials: Plastic, UL94V-0, Flame retardant

Bezel: Textured per matt finish

Power Input

The factory equipped power option is internally fused. An internal line to line filter capacitor is provided for added transient suppression. MOV protection for surge transient is also supported

Universal AC Power: 85 to 276 Vrms, 50/60 Hz DC Power Option: 24 VDC (16 to 48 VDC) **Power Cosumption** AC Power: 6.5 V/A DC Power: 300 mA max.

990239 08/14/17



Flow Meter Types:

Linear: Vortex, Turbine, Positive Displacement, Magnetic, GilFlo, ILVA, Mass Flow and others Square Law: Orifice, Venturi, Nozzle, V-Cone, Wedge, Averaging Pitot, Target, Verabar, Accelabar and others Multi-Point Linearization: May be used with all flowmeter types. Including: 16 point, UVC and dynamic compensation. Flow Inputs: **Analog Input:** Accuracy: 0.02% FS at 20° C Ranges Voltage: 0-10 VDC, 0-5 VDC, 1-5 VDC Current: 4-20 mA, 0-20 mA, 4-20 mA stacked, 0-20 mA stacked **Basic Measurement Resolution: 16 bit** Update Rate: 4 updates/sec Automatic Fault detection: Signal over/under-range, Current Loop Broken Calibration: Operator assisted learn mode Extended calibration: Learns Zero and Full Scale of each range Fault Protection: Fast Transient: 500 V Protection (capacitive clamp) Reverse Polarity: No ill effects Over-Voltage Limit: 50 VDC Over voltage protection Over-Current Protection: Internally current limited protected to 24VDC **Pulse Inputs:** Number of Flow Inputs: one Input Impedance: 10 k Ω nominal Trigger Level: (menu selectable) **High Level Input** Logic On: 2.5 to 30 VDC Logic Off: 0 to 2 VDC Low Level Input (mag pickup) Selectable sensitivity: 10 mV and 100 mV Minimum Count Speed: 0.25 Hz (to maintain rate display) Maximum Count Speed: Selectable: 0 to 50 kHz

Overvoltage Protection: 50 VDC

Temperature, Pressure, Density Inputs

The compensation inputs usage are menu selectable for temperature, temperature 2, pressure, density or not used.

Calibration: Operator assisted learn mode **Operation:** Ratiometric Accuracy: 0.02% FS at 20° C Basic Measurement Resolution: 16 bit Update Rate: 2 updates/sec minimum Automatic Fault detection: Signal Over-range/under-range Current Loop Broken RTD short RTD open Reverse Polarity: No ill effects **Over-Current Limit** (current input)Internally limited to protect input to 24 VDC) Available Input Ranges Current: 4-20 mA, 0-20 mA Resistance: 100 Ohms DIN RTD 100 Ohm DIN RTD (DIN 43-760, BS 1904): Three Wire Lead Compensation Internal RTD linearization learns ice point resistance 1 mA Excitation current with reverse polarity

protection Temperature Resolution: 0.1° C Temperature Accuracy: ± 0.5° C

Stored Information (ROM)

Steam Tables (saturated & superheated), Fluid Properties: Water, Air, Natural Gas or Generic

User Entered Stored Information (EEPROM / Nonvolatile RAM)

Transmitter Ranges, Signal Types Fluid Properties (specific gravity, expansion factor, specific heat, viscosity, isentropic exponent, combustion heating value, Z factor) Units Selections (English/Metric) Language Translations (optional)

Excitation Voltage

24 VDC @ 100 mA (fault protected)

Relay Outputs

The relay outputs usage is menu assignable to (Individually for each relay) Hi/Lo Rate Alarm, Hi/Lo Temperature Alarm, Hi/Lo Pressure Alarm, Pulse Output (pulse options), Wet Steam or General purpose warning (security).

Number of relays: 2 (3 optional) Contact Style: Form C contacts Contact Ratings: 240 V, 5 amp

Analog Outputs

The analog outputs are menu assignable to correspond to the Uncompensated Volume Rate, Corrected Volume Rate, Mass Rate, Heat Rate, Temperature, Density, or Pressure.

Number of Outputs: 2

Type: Isolated Current Sourcing (shared common) Available Ranges: 0-20 mA, 4-20 mA (menu selectable) Resolution: 16 bit Accuracy: 0.05% FS at 20 Degrees C Update Rate: 5 updates/sec Temperature Drift: Less than 200 ppm/C Maximum Load: 1000 ohms Compliance Effect: Less than .05% Span 60 Hz rejection: 40 dB minimum EMI: No effect at 3 V/M Calibration: Operator assisted Learn Mode Averaging: User entry of DSP Averaging constant to cause a smooth control action

Listing: CE Approved, UL/CSA Pending

Serial Communication

The serial port can be used for printing, datalogging, modem connection and communication with a computer. Power is provided for KEP's MPP2400N (modem) communication accessory.

RS-232:

Device ID: 01-99 Baud Rates: 300, 1200, 2400, 9600 Parity: None, Odd, Even Handshaking: None, Software, Hardware Print Setup: Configurable print list and formatting, Compatible with external dataloggers.

RS-485:

Device ID: 01-247

Baud Rates: 300, 600, 1200, 2400, 4800, 9600, 19200

Parity: None, Odd, Even Protocol: Modbus RTU (Half Duplex)

Data Logging

The data logger captures print list information to internal storage for approximately 5000 transactions. This information can be used for later uploading or printing. Storage format is selectable for Comma-Carriage Return or Printer formats.

Isolated Pulse output

The isolated pulse output is menu assignable to Uncompensated Volume Total, Compensated Volume Total, Heat Total or Mass Total.

Pulse Output Form (menu selectable): Open Collector NPN or

24 VDC voltage pulse Nominal On Voltage: 24 VDC Maximum Sink Current: 25 mA Maximum Source Current: 25 mA Maximum Off Voltage: 30 VDC Saturation Voltage: 0.4 VDC Pulse Duration: User selectable Pulse output buffer: 8 bit Fault Protection Reverse polarity: Shunt Diodes Over-current Protected Over-voltage Protected

Real Time Clock

The Flow Computer is equipped with a non-volatile real time clock with display of time and date. Format:

24 hour format for time Day, Month, Year for date

Terminal Designations

	-				
1	DC OUTPU	-		. FLO	N
2	PULSE IN		Vin (+	·) IN	··
3		-	lin (+) ""	
4	COMMON				
5	RTD EXCIT	(+)	TEI	MPERATU	JRE
6	RTD SENS			IN	
7	RTD SENS	(-)	lin (+)		
8	DC OUTPU	Г			
9	RTD EXCIT	(+)		PRESS	
10	RTD SENS			(TEMP	2)
11	RTD SENS	(-)	lin (+)	IN	
12	PULSE OUT	ΡL	JT (+)		
13	PULSE OUT	ΡL	JT (-)		
14	ANALOG O	JTI	PUT 1 (+	-)	
15	ANALOG O	JT	PUT 2 (+	-)	
16	ANALOG O	JTI	PUT CO	MMON (-)	
17	NO				
18	COM RLY1				
19	NC				
20	NC				
21	COM RLY2				
22	NO				
23	AC LINE	D	C(+) _F	OWER IN	J
24	AC LINE	D	C (-)		

Internal Multi-protocol Communication Card Option

FEATURES

- Internal communication card eliminates the need for external protocol converters.
- Supports: BACnet IP, BACnet MS/TP, Metasys N2, Modbus TCP, AB Ethernet IP, AB DF1, LonWorks*
- Easy to configure via the Web Interface.
- · Dedicated internal LonWorks is also available
- · Dedicated internal RS485 Modbus RTU is also available


DESCRIPTION

The multi-protocol communication card is an internal, high performance, Building Management System communication solution for the ST2 flow computer family. The card provides an instant interface, enabling the KEP flow computers to communicate with multiple BMS protocols, including:


- BACnet MS/TP
- BACnet IP
- Modbus TCP
- Metasys N2
- AB DF1
- AB EtherNet/IP
- LonWorks*

CONFIGURATION

Use a web browser to locate the internal web page and configure the settings. The detailed settings vary with the different communication protocols. Only one communication port/protocol can be used. A web browser is also used to configure the site specific settings for each instrument

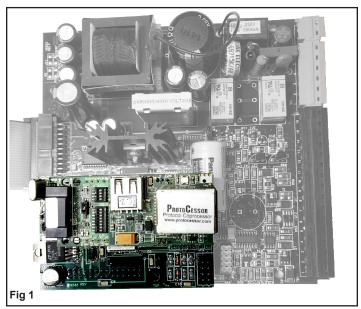

Top view of multi-protocol card installed on ES749 mother board

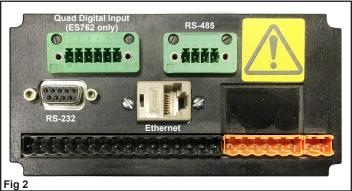

Rear view of ES749 case. Communication ports are available for RS-485 and Ethernet

* LonWorks protocol requires a different module assembly from the other available protocols. LonWorks is not field selectable.


The Web Interface makes it easy to configure.

Configuration Parameters

Parameter Name	Parameter Description	Value
protocol_select	Protocol Selector Set to 1 for BACnet IP Set to 2 for BACnet MSTP Set to 3 for Metasys N2 Set to 4 for Modbus TCP Set to 5 for EtherNet/IP Set to 6 for DF1	1Submit
node_offset	BACnet Node Offset This is used to set the BACnet device instance. The device instance will be sum of the Modbus device address and the node offset. (0 - 4194303)	50000 Submit
bac_ip_port	BACnet IP Port This sets the BACnet IP port of the Gateway. The default is 47808. (1 - 65535)	47808 Submit
bac_cov_option	BACnet COV This enables or disables COVs for the BACnet connection. Use COV_Enable to enable. Use COV_Disable to disable. (COV_Enable/COV_Disable)	COV_Disable Submit
bac_bbmd_option	BACnet BBMD This enables BBMD on the BACnet IP connection. Use BBMD to enable. Use - to disable. The bdt.ini files also needs to be downloaded. (BBMD/-)	Submit
Active profiles		
Nr Node ID Curren	t profile Parameters _SUPERtrol_II	Remove
Add	_SOPERUO_II	Renove


Sample screen shot of web interface configuration

Dimensions

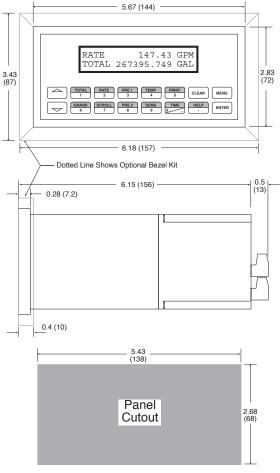


Dimensions are in inches (mm)


Wall Mount (option W)

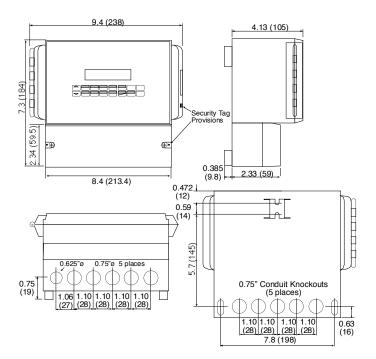

NEMA4 Wall Mount (mounting option N)





Top View with Cover



Top View with Cover Removed


NOTES: 1. Panel screws have # 10-32 threads. 2. Hinged cover opens 200° maximum.





A x B x C	DxE	GxH	LxW	F	J	K	V	Х	Y
11.50 x 8.00 x 6.78	8.75 x 6.88	10.75 x 6.00	12.00 x 9.39	6.25	5.13	1.75	0.25	9.97	7.34
(292 x 203 x 172)	(222 x 175)	(273 x 152)	(305 x 239)	(159)	(130)	(44)	(6)	(253)	(186)

Explosion Proof Mount (mounting option E)

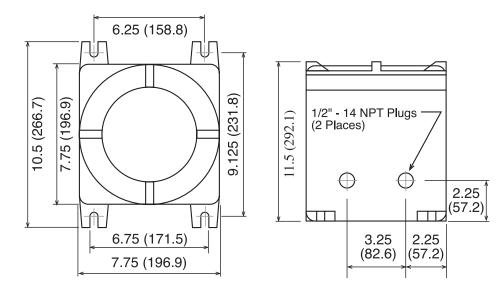

Ordering Information

Example ES749 L 1 0 P	
	ſB
Series:	
ES749ST2 = ST2 Special	
L= LCD	
O= OLED	
V= VFD	
Input Type:	
1= 85 to 276 VAC	
3= 24 VDC	
Network Card:	
0= None	
1= RS485/Modbus 3= COM CARD with Multi-Protocol	
Specify protocol (example: 3 BAC/IP)	
BAC/IP = BACnet IP	
BACMS/TP = BACnet MS/TP	
MOD/IP = Modbus TCP/IP	
METASYS/N2 = Metasys N2	
ABDF1 = AB DF1	
ABETH/IP = AB EtherNet/IP 4= COM CARD with LonWorks Protocol	
Specify protocol (example: 4 LONWORKS)	
Factory configuration of network card settings	
Mounting:	
P = Panel Mount	
N= NEMA 4 Wall Mount (see MS811)	
W= NEMA 12/13 Wall Mount w/ Clear Cover	
E= Explosion Proof (No Button Access)	
Ontioner	
9 = 3 Relay Super Chip	-
(Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission	
Stacked DP option Datalogder option Stack Emission	
option. Manifold Flowmeter Controller option)	Controller
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip	
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na	itural gas,
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip	itural gas,
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option,Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only	itural gas,
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only	itural gas,
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters	itural gas,
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal	itural gas,
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emissions option,Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card	itural gas,
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emissions option,Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem	itural gas,
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option,Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem	itural gas,
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET= Extended Temperature LCD Display	itural gas,
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option	itural gas,
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emissions option,Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET = Extended Temperature LCD Display TB = RS485 Terminal Block for Panel Mount Enclosure Accessories:	itural gas,
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option,Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET = Extended Temperature LCD Display TB = RS485 Terminal Block for Panel Mount Enclosure Accessories: ST2 SETUP PRO - Advanced setup software for ST2 family	ttural gas, s Controller
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET= Extended Temperature LCD Display TB= RS485 Terminal Block for Panel Mount Enclosure Accessories: ST2 SETUP PRO - Advanced setup software for ST2 family OPC/DDE Server for RS232 Port available, see KWP-UCOM	tural gas, s Controller
option,Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option,Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET = Extended Temperature LCD Display TB = RS485 Terminal Block for Panel Mount Enclosure Accessories: ST2 SETUP PRO - Advanced setup software for ST2 family	utural gas, s Controller ND0-PRD BUS0-PRD
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET= Extended Temperature LCD Display TB= RS485 Terminal Block for Panel Mount Enclosure Accessories: ST2 SETUP PRO - Advanced setup software for ST2 family OPC/DDE Server for Modbus Suite available, see KWP-UCOM Modem Available, see MPP-56KN, MPP-2400 and MPP-240 Serial printer available, see P20, P220, P295	utural gas, s Controller ND0-PRD BUS0-PRD
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 2 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET= Extended Temperature LCD Display TB= RS485 Terminal Block for Panel Mount Enclosure Accessories: ST2 SETUP PRO - Advanced setup software for ST2 family OPC/DDE Server for RS232 Port available, see KWP-UCON OPC/DDE Server for Modbus Suite available, see KWP-UCON Modem Available, see MPP-56KN, MPP-2400 and MPP-240 Serial printer available, see P20, P220, P295 Ethernet Port Server available, see IEPS	ND0-PRD BUS0-PRD 0N
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET= Extended Temperature LCD Display TB= RS485 Terminal Block for Panel Mount Enclosure Accessories: ST2 SETUP PRO - Advanced setup software for ST2 family OPC/DDE Server for Modbus Suite available, see KWP-UCOM Modem Available, see MPP-56KN, MPP-2400 and MPP-240 Serial printer available, see P20, P220, P295	ND0-PRD BUS0-PRD 0N
option, Manifold Flowmeter Controller option) 10 = 2 Relay Super Chip (Includes: Peak Demand, AGA NX-19 calculation for na Stacked DP option, Datalogger option, Stack Emission: option, Manifold Flowmeter Controller option) 13 = Superchip; 2 relay, Positive heat only 14 = Superchip; 3 relay, Positive heat only 22 = Superchip; 2 relay, For use with 4 terminal multi-variable vortex meters 26 = Superchip; 3 relay, For use with 4 terminal multi-variable vortex meters TM = Trap monitor RS485 network card IM = Internal Modem IM-56K = 56K Internal Secure Modem M = Modem Power Option ET = Extended Temperature LCD Display TB= RS485 Terminal Block for Panel Mount Enclosure Accessories: ST2 SETUP PRO - Advanced setup software for ST2 family OPC/DDE Server for RS232 Port available, see KWP-UCOI OPC/DDE Server for Modbus Suite available, see KWP-MD Modem Available, see MPP-56KN, MPP-2400 and MPP-240 Serial printer available, see IEPS RS-422/485 to RS-232 Communication Adaptor available, se	ND0-PRD BUS0-PRD NON