
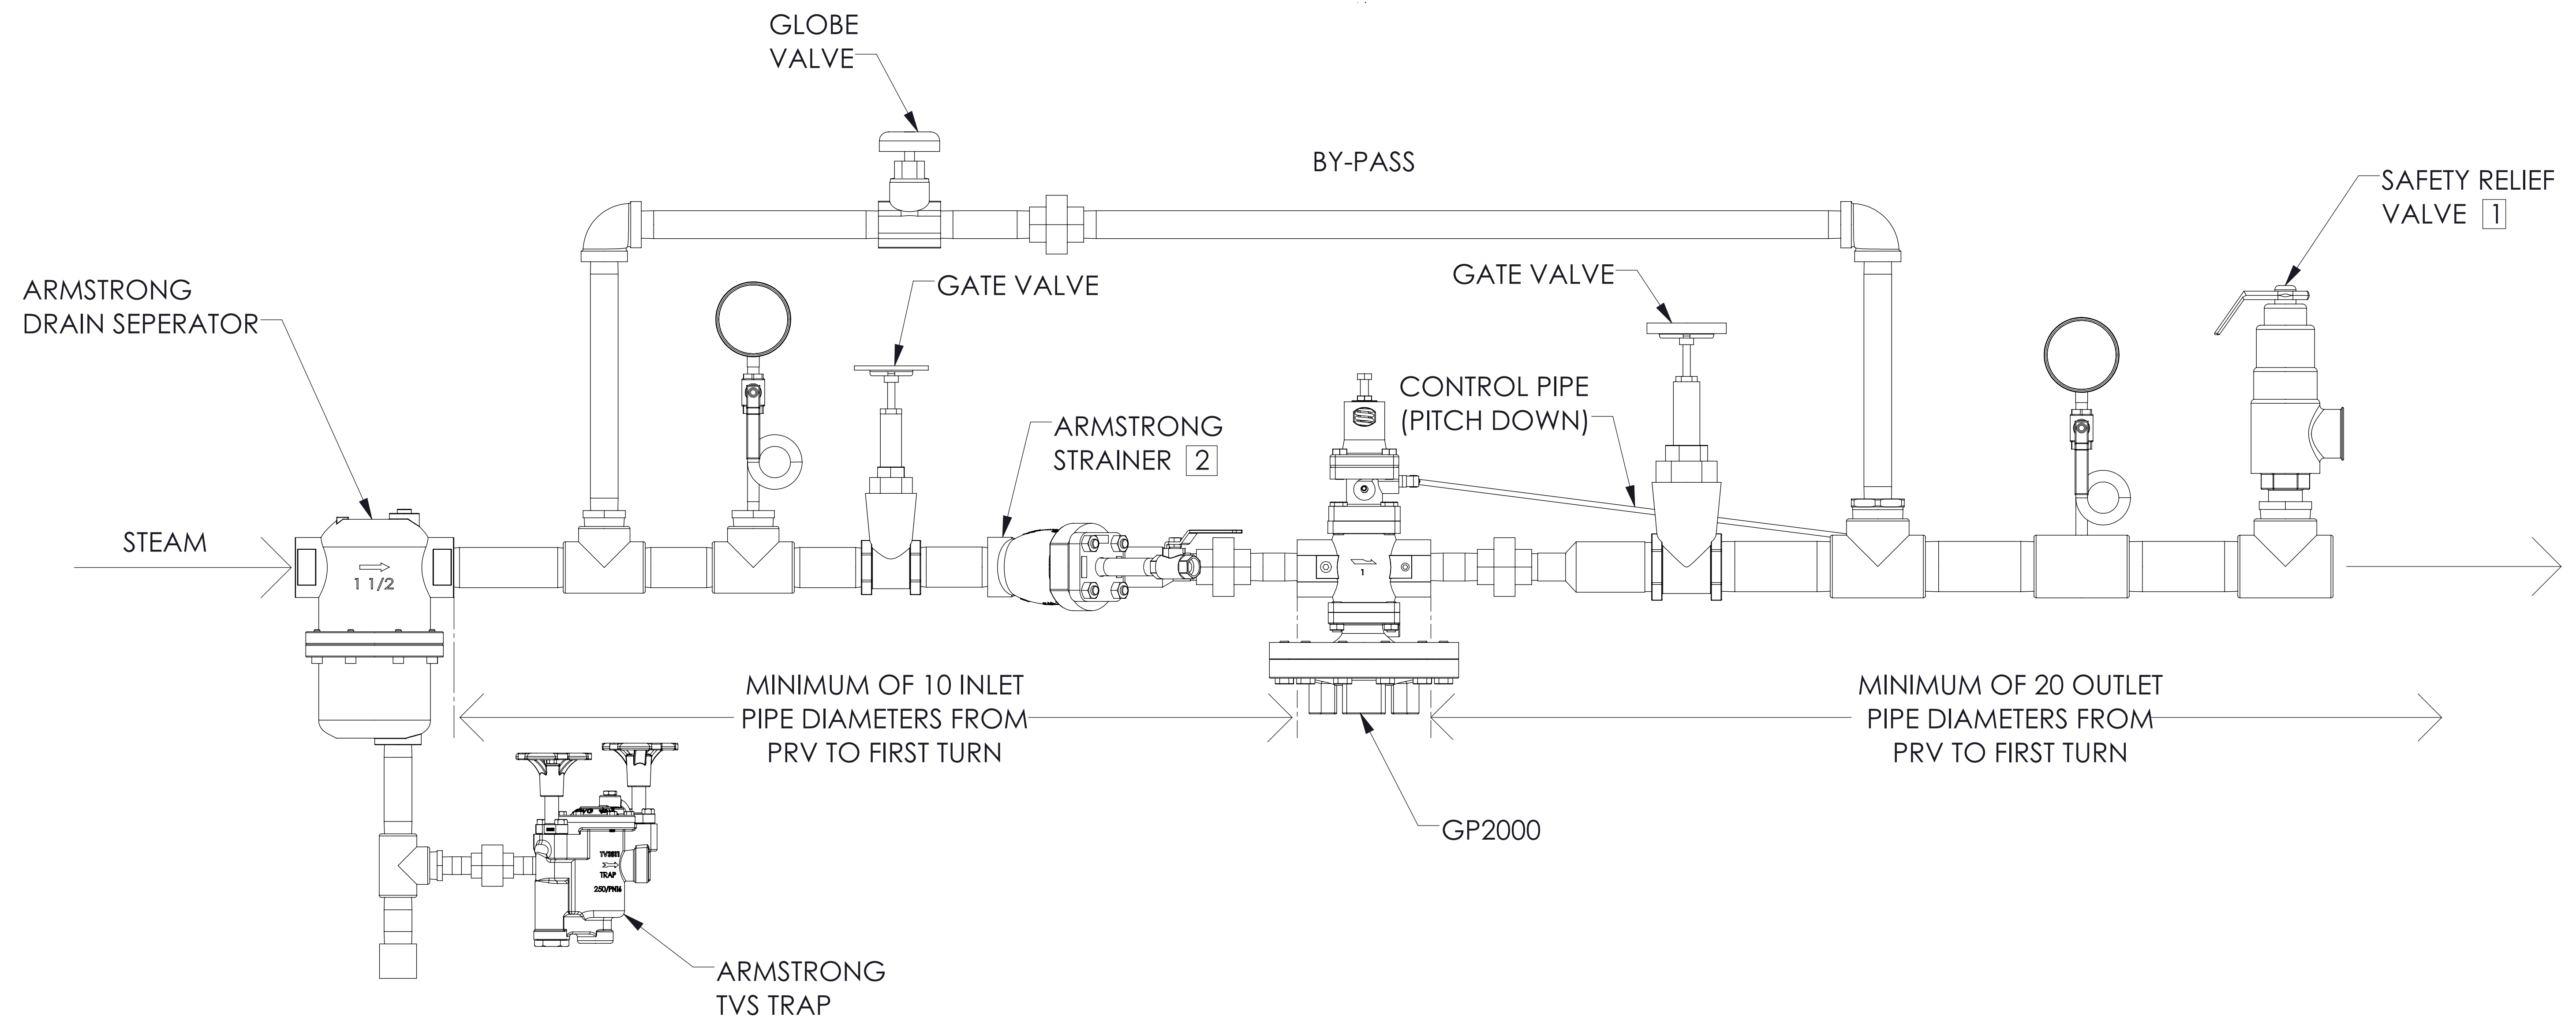



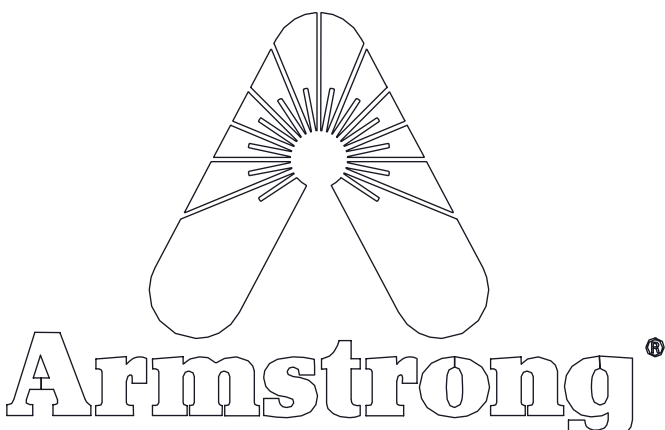

1. SAFETY RELIEF VALVE TO BE SET AT 10 PSI HIGHER OR 10% HIGHER THAN THE DOWNSTREAM PRESSURE, WHICHEVER IS GREATER.
2. IT IS SUGGESTED THAT THE INLET "Y" TYPE STRAINER BE INSTALLED ON IT'S SIDE TO AVOID THE COLLECTION OF LIQUID IN THE BODY THAT COULD BE CARRIED THROUGH THE REGULATOR AS A DAMAGING SLUG UNDER CERTAIN CONDITIONS.

 				ARMSTRONG INTERNATIONAL Copyright © 2010 ARMSTRONG INTERNATIONAL, INC.	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE SPECIFIED DIMENSIONING ENGLISH [mm]				GP2000 SINGLE STAGE REDUCTION INSTALLATION	
FRACTIONAL ± 1/64 ANGULAR: ± 2					