

Warranty

GE Sensing warrants equipment of its manufacture to the original buyer against defective materials or workmanship, for a period of one year for the sensor tip and two years for the rest of the product, from the date of shipment. The sensor element and calibration are not covered by this warranty.

Calibration

All GE Sensing RH and Temperature Products are fully tested and calibrated in accordance with the National Institute of Standards and Technology (NIST) prior to shipment. This is the highest quality calibration standard available.

Power Requirements

12–30 VDC power supply (furnished by the customer).

Specifications

Environmental Conditions

Operating Range: -40°F to 140°F (-40°C to 60°C)
0-99% RH non-condensing.

Storage Temperature: -67°F to +185°F (-55°C to +85°C)

Humidity

Sensing Element: Capacitive Sensor

Accuracy* [at 71.6°F (22°C)]: ±2% Version: ±2% 10-90% RH and ±5% 0-10% & 90-99% RH
5% Version: ±5% RH @ 0-99% RH
**Includes hysteresis, linearity and repeatability.*

Long Term Stability: Less than 1% drift per year, typical.

Temperature Effect:** Delta %RH =
(0.0014 × %RH + 0.1325) × T°C -
(0.0317 × %RH + 3.0876)
***Not needed for Signal-Conditioned Temperature units.*

Repeatability: See Accuracy.

Linearity: See Accuracy.

Hysteresis: < ±1.5% RH (30%RH 1h ->70%RH 1h ->90%RH 1h ->30%RH, V_{air} = 2m/sec)

Signal Outputs: 4-20 mA, 0-5V or 0-10V (user selectable)

Supply Voltage: 12 to 30 VDC

Maximum Load: (Current Output Only)
 $\Omega = \frac{\text{Supply Voltage} - 10}{0.02}$

Temperature - Thermistor

Direct Connection

Sensing Element: 10kΩ thermistor at 77°F (25°C)
3kΩ thermistor at 77°F (25°C)

Signal Output: Direct Connection, user selectable
3k or 10k (see Figure 3).

Accuracy: Refer to DC95F103W (10k) & DC95F302W (3k) from GE Infrastructure Sensing

Temperature - RTD

Signal Conditioning

Sensing Element: 1000Ω thin film platinum RTD with signal conditioning.

Accuracy at 71.6°F (22°C): ±0.5°F (±0.3°C)

Long Term Stability: Less than 0.2°F per year.

Sensor Interchangeability: ±0.5°F (±0.3°C)

Signal Outputs: 4-20mA, 0-5V, 0-10V (user selectable)

Supply Voltage: 12 to 30 VDC

Maximum Load: (Current Output Only)
 $\Omega = \frac{\text{Supply Voltage} - 10}{0.02}$

Certification

CE Marked
Complies with EMC Directive 89/336/EEC and LVD 73/23/EEC.
IP 42 rating for Duct Mount and Outside Air Transmitters.

Contact Information

To contact the factory, use the following information:
GE Sensing
1100 Technology Park Drive
Billerica, MA 01821-4111
Web: www.gesensing.com
Telephone: 978-437-1000

Installation

For your convenience, the transmitters can be mounted using the base as a mounting template (see Figure 1 or 2).

Wall Mount

Locate the transmitter where it will be exposed to an unrestricted air circulation that is representative of the average humidity and/or temperature of the controlled space. Avoid locations where excessive moisture, corrosive fumes, vibration, or high ambient temperatures are present.

The wall mount transmitter is designed to install onto a standard electric switch box. Mount the transmitter on an indoor wall approximately 4 to 6 feet above the floor. The base assembly should be positioned with the letters **FR/ABS** located on the left side.

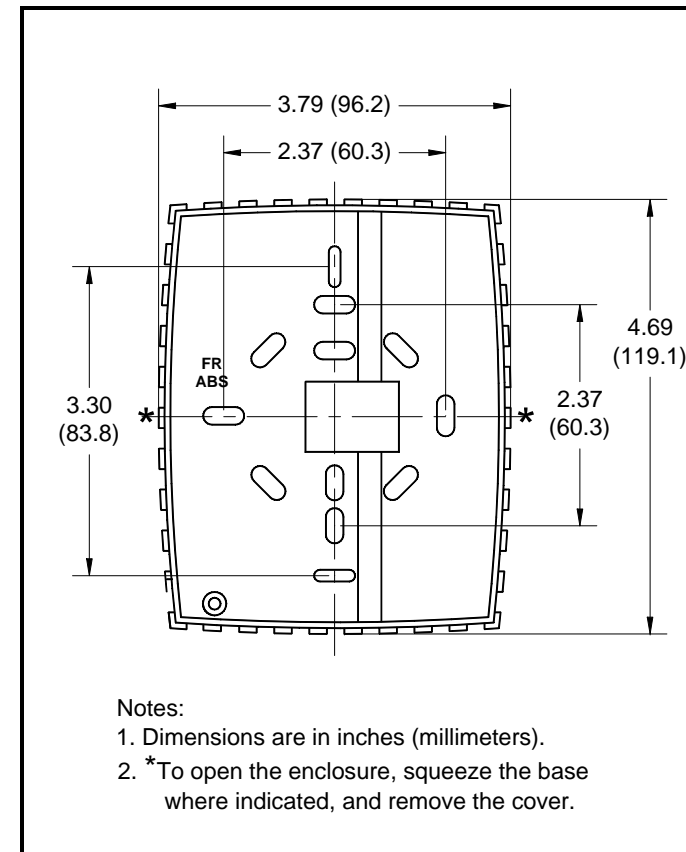


Figure 1: Wall Mount - Mounting Dimensions

Duct Mount

The transmitter should be mounted away from fans, corners, heating and cooling coils, and other equipment that will affect the measurement of relative humidity. It should be mounted in a location that receives adequate air flow for proper operation.

The duct mount transmitter should be mounted so that the sensor probe is in the center of the duct.

Outside Air Mount

The transmitter should be mounted in a sheltered area that is protected from rain. Ideally, the transmitter should be located on the north side of the building (under an eave) to prevent sun-heated air from rising up the building's wall and affecting the relative humidity of the sensor.

The outside air mount transmitter should be mounted with the sensor pointing down to prevent water collection in the sensor cavity.

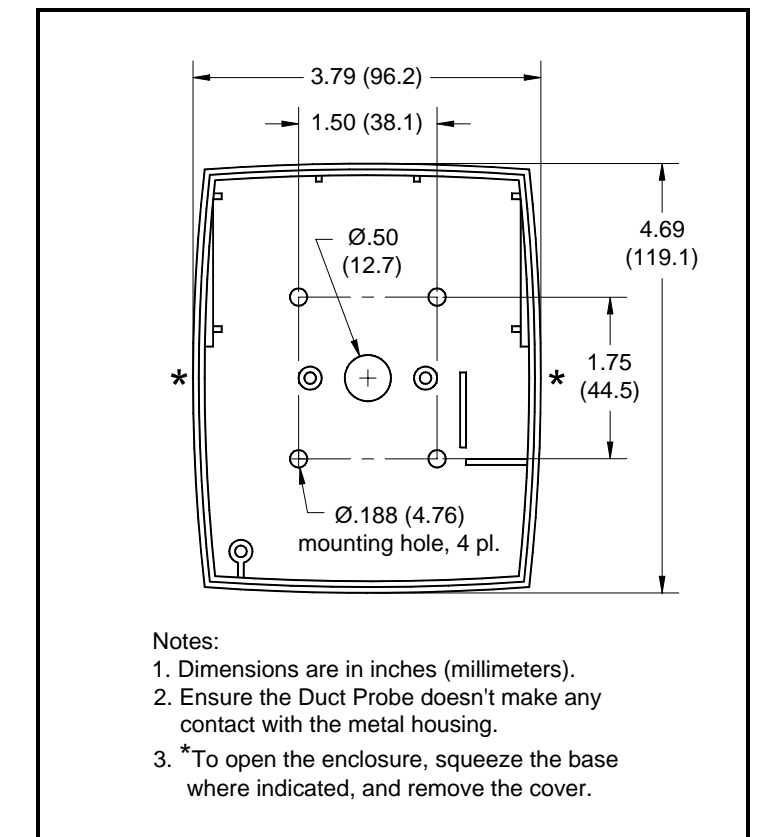


Figure 2: Duct / Outside Air - Mounting Dimensions

Wiring

Match your transmitter with the corresponding diagrams (Figure 4 through Figure 11), set the switches and wire accordingly. (See Figure 3 below for switch and terminal block locations.) Ensure that all the installation and wiring is in compliance with all national and local codes.

Note: All Voltage Outputs are measured with respect to the POWER SUPPLY / CONTROLLER GROUND.

Wiring for the transmitter should be a shielded, twisted pair, 16-22 AWG. Use only copper conductors. Do not run transmitter wires and AC power wires together in the same conduit or wire bundle.

Caution!

Running transmitter wires and AC power wires, including earth ground, in the same conduit or wire bundle may cause malfunction due to electrical noise.

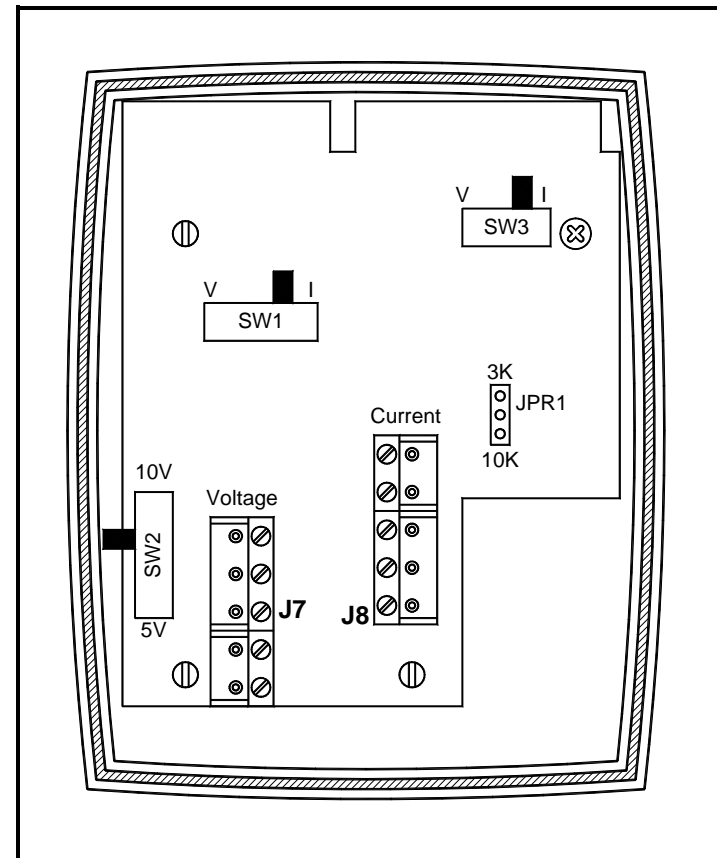


Figure 3: Connector/Switch Locations - Inside Cover

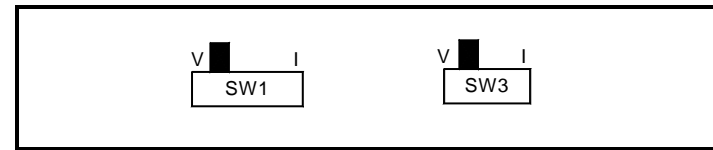


Figure 4: Switch Positions for Voltage Mode

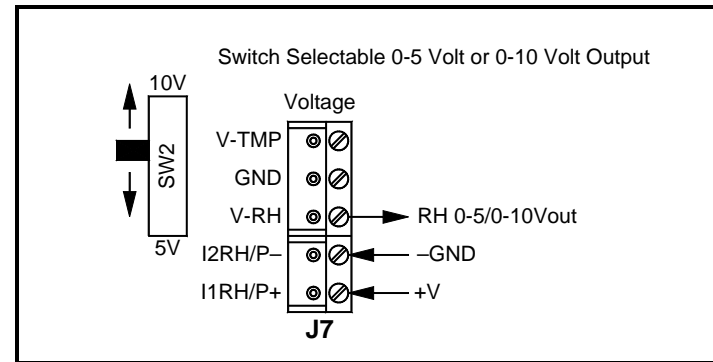


Figure 5: RH Only - Voltage

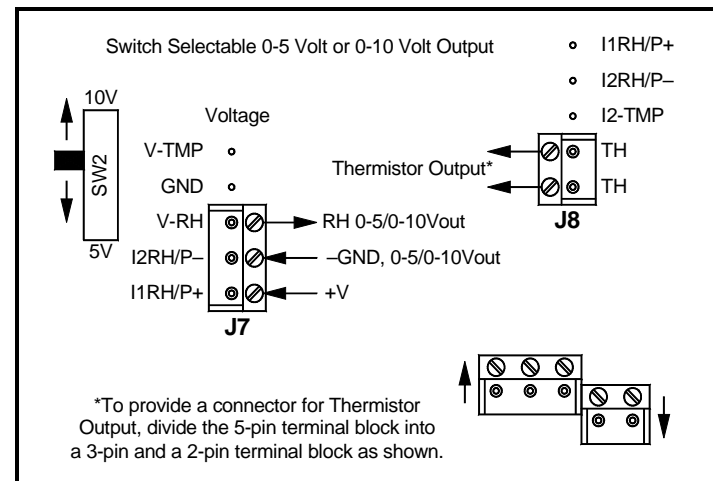


Figure 6: RH and Temp. (Direct Connection) - Voltage

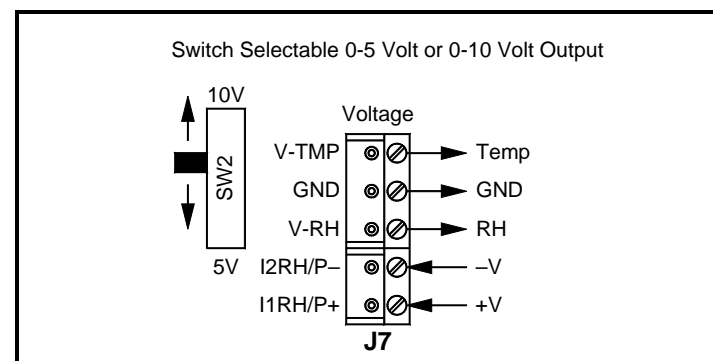


Figure 7: RH and Temp. (Signal Condition) - Voltage

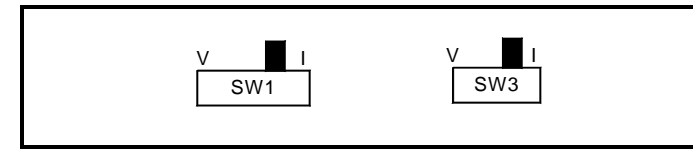


Figure 8: Switch Positions for Current Mode

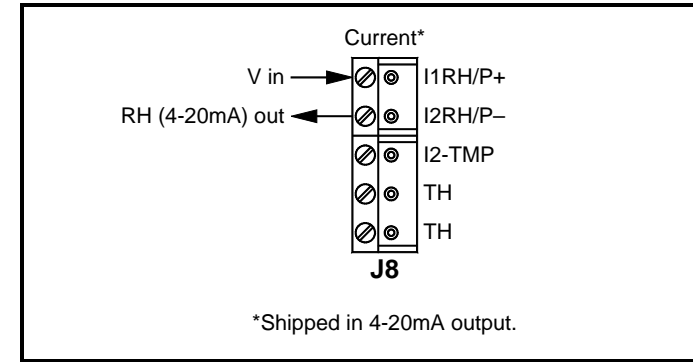


Figure 9: RH Only - Current

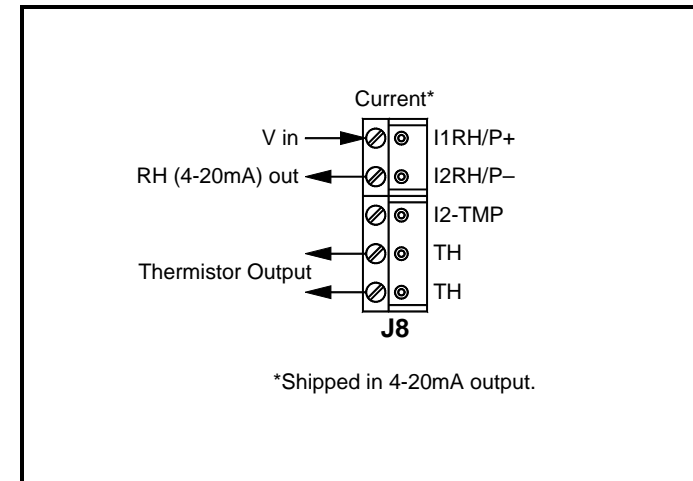


Figure 10: RH and Temp. (Direct Connection) - Current


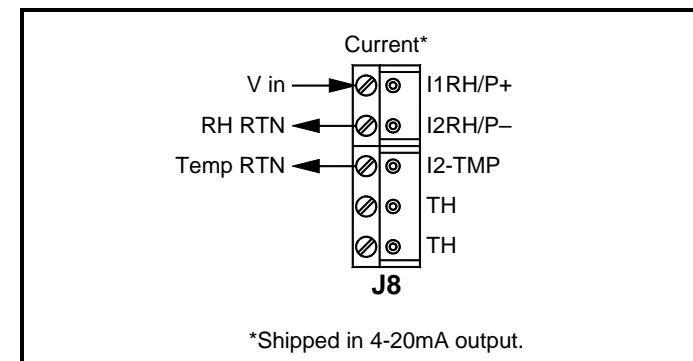


Figure 11: RH and Temp. (Signal Condition) - Current

Wiring (cont.)

CE COMPLIANCE

1. Ensure that the probe earth ground wire (for Duct and Outside Air units only), the shield wire and the PCB earth ground wire are connected to the mounting screw or the NEAREST (<1.5m) earth ground.
2. The other end of the shield wire MUST be connected to the power supply /controller earth ground ONLY.

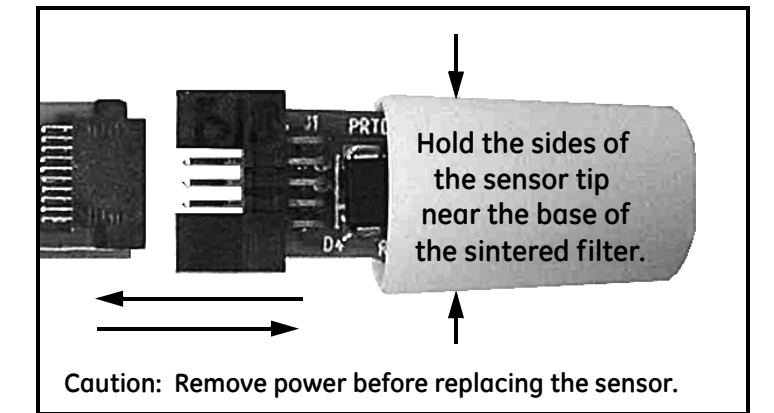

Caution: Remove power before replacing the sensor.

Figure 12: Remove/Install the Sensor Tip

Table 1: HumiTrac Transmitter Accuracy

Model		Accuracy		
		5%	2%	2% with NIST Certificate
Space (Wall) Mount	RH Only	P40250121	P40250109	P40250139
	RH & 3/10K Ω Thermistor	P40250122	P40250110	P40250141
	RH & 1000Ω PRTD (0 to 50°C)*	P40250123	P40250111	P40250142
	RH & 1000Ω PRTD (-40 to 60°C)*	P40250125	P40250112	P40250143
Duct Mount	RH Only	P40250129	P40250117	P40250147
	RH & 3/10K Ω Thermistor	P40250130	P40250118	P40250149
	RH & 1000Ω PRTD (0 to 50°C)*	P40250131	P40250119	P40250150
	RH & 1000Ω PRTD (-40 to 60°C)*	P40250133	P40250120	P40250151
Outside Air	RH Only	P40250126	P40250113	P40250144
	RH & 3/10K Ω Thermistor	P40250127	P40250114	P40250145
	RH & 1000Ω PRTD (-40 to 60°C)*	P40250128	P40250115	P40250146
	Replaceable Sensor Tip (RH Only)	P40250161	P40250162	NA
Replaceable Sensor Tip (RH & Temp.) 1000Ω PRTD*	P40250163	P40250165	NA	

*Signal conditioned temperature output corresponding to 4-20mA, 0-5V or 0-10V (user selectable)